



Foothill-De Anza Community College District



SUSTAINABILITY ACTION PLAN



WORKING DRAFT Version 8
November 2022

Produced by the
Energy and Sustainability
Advisory Committee
(ESAC)

ACKNOWLEDGMENTS

Foothill-De Anza Community College District Board of Trustees

- Patrick J. Ahrens, President
- Laura Casas, Vice President
- Pearl Cheng
- Peter Landsberger
- Gilbert Wong
- Pierce Tao, De Anza College Student Trustee
- Chamu Palaniappan, Foothill College Student Trustee

Administration

- Judy C. Miner, Chancellor
- Lloyd Holmes, President, De Anza College
- Bernadine Chuck Fong, Interim President, Foothill College
- Susan Cheu, Vice Chancellor, Business Services
- Joel Cadiz, Executive Director, Facilities and Operations
- Ajani M. Byrd, Dean of Institutional Equity, Diversity, and Inclusion, Foothill College
- Alicia Cortez, Dean of Equity and Engagement, West Valley College

Energy and Sustainability Advisory Committee (ESAC)

- Co-Chair: Joel Cadiz, Executive Director, Facilities and Operations
- Co-Chair: Robert Cormia, Instructor, Chemistry, Foothill College
- Susan Cheu, Vice Chancellor, Business Services
- Tom Armstrong, Director, Capital Construction Program (retired August 2021)
- Anthony Caceres, Special Projects Coordinator
- Julie Ceballos, Writer/Editor/Web Content Developer, Marketing and Public Relations, Foothill College
- Nur Afizah Fadhilah, Chair, Environmental Sustainability, De Anza Student Government (starting June 2021 and graduated in June 2022)
- Pam Grey, Vice President, Administrative Services, De Anza College
- Cynthia Kaufman, Faculty Director, Vasconcellos Institute for Democracy in Action, De Anza College
- Jennifer Mahato, Director, College Operations, De Anza College
- Carla Maitland, Acting Assistant to the Chancellor
- Diana Martinez, Laboratory Technician, Environmental Studies, De Anza College
- Todd Nelson, Director, Facilities and Maintenance
- Belen Simmet, Executive Assistant, Facilities and Operations
- Bret Watson, Vice President, Finance and Administrative Services, Foothill College
- Yuetong Zhang, Chair, Environmental Sustainability, De Anza Student Government (through May 2021)

Other Plan Contributors

- Matt Sullivan PE LEED AP, Principal, Sullivan Consulting

TABLE OF CONTENTS


SECTION 1.	EXECUTIVE SUMMARY	1
SECTION 2.	BACKGROUND	3
2.1	HISTORY OF SUSTAINABILITY EFFORTS TO DATE	3
2.2	CREATION OF THE SUSTAINABILITY ACTION PLAN	3
2.3	ENERGY AND SUSTAINABILITY ADVISORY COMMITTEE.....	4
2.4	THE POLICY CONTEXT OF ENERGY AND SUSTAINABILITY PLANNING	4
SECTION 3.	MISSION STATEMENT, GOALS, AND OBJECTIVES	8
3.1	SUSTAINABILITY ACTION PLAN PLANNING STRUCTURE	8
3.2	MISSION STATEMENT.....	9
3.3	SUSTAINABILITY ACTION PLAN GOALS.....	9
3.4	OBJECTIVES.....	10
SECTION 4.	PROGRAMS AND PROJECTS FOR IMPLEMENTATION	15
4.1	MANAGEMENT AND ORGANIZATIONAL STRUCTURE	15
4.2	CARBON REDUCTION PROGRAMS.....	18
4.3	ENERGY EFFICIENCY.....	19
4.4	FACILITIES OPERATION	21
4.5	SUSTAINABLE BUILDING PRACTICES	24
4.6	ON-SITE GENERATION AND RENEWABLE ENERGY.....	27
4.7	TRANSPORTATION, COMMUTING, CAMPUS FLEET AND TRAVEL.....	28
4.8	WATER, WASTEWATER AND SUSTAINABLE LANDSCAPING	29
4.9	SOLID WASTE REDUCTION AND RECYCLING	31
4.10	SUSTAINABLE PROCUREMENT	34
4.11	STUDENT AND CURRICULUM DEVELOPMENT	35
4.12	CAMPUS AND COMMUNITY OUTREACH & AWARENESS.....	37
4.13	FOOD SYSTEMS.....	39
4.14	DIVERSITY, EQUITY, AND ENVIRONMENTAL JUSTICE.....	39
SECTION 5.	MEASURE AND REPORT PERFORMANCE	41
5.1	MEASURING PERFORMANCE	41
5.2	REPORTING PERFORMANCE.....	41
SECTION 6.	APPENDICES	46
	APPENDIX A – DISTRICT PROPOSITION 39 PROJECTS, 2013-2019	
	APPENDIX B – 2021 CCC BOARD OF GOVERNORS CLIMATE ACTION AND SUSTAINABILITY PLAN	
	APPENDIX C – IMPLEMENTATION PROGRAMS AND PLANS CHECKLIST	
	APPENDIX D – MEASURE G BOND ENERGY-SAVING PROJECTS	
	APPENDIX E – 2021 BENCHMARKING STUDY RESULTS	
	APPENDIX F – TOTEM ANALYSIS WHITE PAPER	
	APPENDIX G – GLOSSARY OF TERMS	

SECTION 1. EXECUTIVE SUMMARY

The Foothill-De Anza Community College District is committed to fostering sustainability. District Board [Policy 1200](#) states “We are driven by an equity agenda and guided by core values of excellence, inclusion, and sustainability,” and the district will use this as a guiding light for our sustainability efforts. We understand sustainability, broadly, to mean actions that reduce ecological impacts and increase social equity and well-being, while also being economically prudent. This plan focuses on sustainability efforts in college and district operations. It looks at the impacts of policies on our students’ experiences while studying with us and after they leave. And it is designed to lead others in the community to accomplish strong sustainability efforts.

The passage of the California Global Warming Solutions Act (AB-32), subsequent legislation and Executive Orders requiring carbon emissions reduction and the adoption of the 2021 California Community Colleges Board of Governors’ Climate Action and Sustainability Framework has made it imperative for California community colleges to act. Additionally, the UN Intergovernmental Panel on Climate Change (IPCC) Sixth Assessment Report [Update](#) issued in April 2022 could not be more explicit about the use of fossil fuels, climate change and the narrow window to respond to this crisis. This Sustainability Action Plan (SAP) takes an organized and comprehensive approach to incorporate energy efficiency, equity, and sustainability elements, while addressing state regulations and leveraging available resources and complementary programs. It also prepares the district for significant decarbonization during the crucial 2020-2030 period.

Sustainability is integrating three important spheres: environmental stewardship¹, or the responsibility for environmental quality shared by all those whose actions affect the environment; social equity², or continually working to break down barriers to racial justice and equity for the students in our colleges and viewing sustainability through an equity lens; and economic vitality to create thriving, healthy, diverse, and resilient communities for this generation and generations to come. As illustrated by the diagram on the right, the practice of sustainability recognizes how these issues are interconnected and require a systems approach and an acknowledgment of complexity.³ This plan aims to prepare Foothill-De Anza for the environmental and regulatory challenges of the 21st century, while ensuring that policies implemented increase equity in the short term, lead to a more equitable and sustainable future and prepare students for good jobs in a green economy. It is forward-thinking and considers sustainability best practices that not only minimize negative environmental impacts but also enhance the built environment, the biosphere and its living inhabitants.

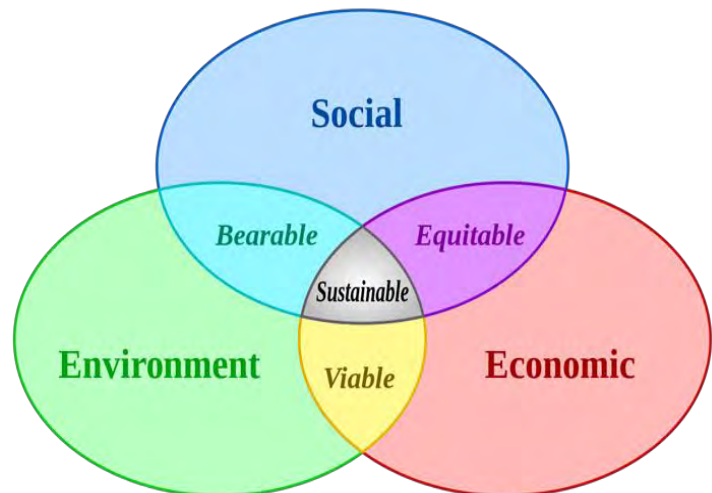

¹ [Environmental Stewardship and Sustainability - JMU](#)

² [Diversity, Equity, Inclusion, and Accessibility \(DEIA\) | California Community Colleges Chancellor's Office \(cccco.edu\)](#)

³ [UCLA - What is Sustainability?](#)

The Foothill-De Anza Community College District includes Foothill College in Los Altos Hills, De Anza College in Cupertino, and the Foothill College Sunnyvale Center. This Sustainability Action Plan encompasses the entire district's goals and priorities and articulates the district's sustainability mission, goals, and objectives and the implementation strategies to meet these goals. The Foothill-De Anza Energy and Sustainability Advisory Committee (ESAC), with a membership of students, faculty members, administrators, and classified professionals, has developed the plan in coordination with campus stakeholders using a participatory governance approach to ensure that the plan meets the diverse needs of various campus communities.

Due to this document's technical nature, a glossary of terms is included in the appendix. In addition, footnotes and hyperlinks are provided throughout the text to provide more detail about concepts, measures, and programs discussed in the plan.

SECTION 2. BACKGROUND

2.1 HISTORY OF SUSTAINABILITY EFFORTS TO DATE

The Foothill-De Anza Community College District has been proactive in energy efficiency and sustainability for many years. In 2007 and 2008, Foothill College and De Anza College established sustainability committees to plan and implement various energy and sustainability programs and projects. The Board of Trustees established policies for district sustainability that were incorporated into the 2010 District Sustainability Plan, the 2016 Facilities Master Plan, the 2017-2023 District Strategic Plan, and the 2018 Foothill College Sustainability Management Plan. In addition, the district has been active in recycling efforts, encouraging public transit use for students and employees, implementing energy and water-saving projects, and pursuing efficient new construction of campus facilities, cogeneration and solar photovoltaic power generation. Students have also been very active through the De Anza Student Government (formerly the De Anza Associated Student Body) Environmental Sustainability Committee, the Foothill College Sustainability Committee, and the current districtwide Energy and Sustainability Advisory Committee. The Foothill-De Anza Foundation was one of the earliest institutions to divest from fossil fuel investments in 2013. Our district's proud history of student advocacy was crucial in conceiving the landmark Kirsch Center for Environmental Studies at De Anza, creating the pathbreaking bus pass programs, and advocating for fossil fuel divestment.

The district also took full advantage of funding provided by Proposition 39, the California Clean Energy Jobs Act of 2012, to plan and install \$2,386,191 of energy projects between 2013 and 2019. These projects save 418,726 kWh and 82,886 therms annually and provide energy cost savings to the district of \$108,444 each year. These energy savings also translate to over 1.6 million pounds of avoided CO₂ emissions annually. Proposition 39 was a very successful program for the district. Details of projects installed, Proposition 39 funding, project costs and energy savings are listed in Appendix A.

In 2021, the district developed a districtwide Energy Master Plan (EMP), which established broad goals for energy efficiency, renewable energy, and greenhouse gas (GHG) emissions reduction and articulated a plan of action to realize these goals. The EMP also integrated capital improvement projects from the 2020 Measure G \$898 million bond program into the plan. This 2022 Sustainability Action Plan has incorporated the elements of the EMP, the policy goals of the 2021 California Community Colleges Board of Governors Climate Action and Sustainability Framework, and comprehensive sustainability measures related to water, wastewater, solid waste and recycling, transportation, procurement, food systems, diversity and equity, curriculum, and forward-looking regenerative and nature positive principles to create a cutting-edge plan to address the environmental, fiscal, and social issues the district faces in the coming years. While the district has made significant progress on the path to sustainability, it is poised to accomplish much more by implementing this Sustainability Action Plan.

2.2 CREATION OF THE SUSTAINABILITY ACTION PLAN

To create this Sustainability Action Plan, the Energy and Sustainability Advisory Committee followed the California Community Colleges sustainability planning template process. The template was created by a collaboration of the state Chancellor's Office, Citrus Community College District, the California Energy Commission, and consulting firm Newcomb Anderson McCormick. It was developed in 2011, successfully used in early 2012 at Citrus College to develop a campus-specific sustainability plan, and subsequently employed by many other community college

districts. The template is designed to assist colleges with setting goals, objectives, timelines and criteria for success. It highlights the best practices of other community colleges to develop robust yet flexible plans tailored to each district and campus. Districts and campuses can use the template to prioritize their efforts based on college-specific goals and objectives, areas of interest, capabilities and available resources. In addition, the template provides tools for developing action plans to achieve sustainability and measure program implementation results. Above all, the process is intended to be inclusive and collaborative and involve college students, faculty and staff in its implementation. This flow chart illustrates the template planning process.



2.3 ENERGY AND SUSTAINABILITY ADVISORY COMMITTEE

The Energy and Sustainability Advisory Committee (ESAC) was established to share timely, relevant, and accurate local and state energy and sustainability information with constituency representatives and to provide a forum for identifying opportunities to promote an expansive approach to environmental sustainability that includes considerations of equity and social justice at its core. The committee comprises students, faculty members, classified professionals and administrators representing various district stakeholder groups. The plan was developed by ESAC using the district participatory governance process. ESAC regularly updated diverse student, faculty and facilities committees to describe progress and gain feedback during the planning process.

The acknowledgments page of the Sustainability Action Plan lists ESAC membership. The committee's co-chairs are Joel Cadiz, executive director of Facilities and Operations, and Robert Cormia, Foothill College chemistry instructor.

2.4 THE POLICY CONTEXT OF ENERGY AND SUSTAINABILITY PLANNING

Sustainability can provide environmental, economic and social benefits to campuses; however, state policies and regulations also serve as motivation for the district to pursue these practices. California has been at the forefront of efforts to establish aggressive policies and standards for environmental protection and reduce greenhouse gas (GHG) emissions that contribute to global warming, while also maintaining a focus on increasing equity in the process. In 1970, the state adopted the California Environmental Quality Act (CEQA), intending to inform governments and the public about the potential environmental impacts of projects. Since then, the state has accelerated these policies through several executive orders and legislation to decarbonize the energy system. From 2005 onward, legislation has been passed to directly regulate GHG emissions by utilizing incentive mechanisms, cap-and-trade programs, and mandatory reporting while encouraging voluntary activities such as purchasing emissions offsets and offering renewable energy certificates. Compliance with state policies and regulations regarding these issues is an essential factor for consideration by the district.

The following paragraphs describe the numerous policy and regulatory drivers that led to the creation of this plan.

2.4.1 2021 Board of Governors Climate Action and Sustainability Framework

In September of 2021, the California Community Colleges Board of Governors (BOG) adopted a Climate Action and Sustainability Framework (BOG Framework) to guide the community college system to comply with various California regulations related to environmental protection and other sustainability goals. A Climate Action and Sustainability Steering Committee, made up of volunteers from community colleges, the Student Senate for California Community Colleges, the California Community Colleges Chancellor's Office, and the Foundation for California Community Colleges, developed the BOG Framework to provide broad expertise and statewide input into the policy. The BOG Framework sets goals for reducing GHG emissions, renewable energy, zero-emissions vehicles, Zero Net Energy (ZNE) buildings, green building standards, sustainable purchasing practices, solid waste reduction, water and wastewater, food systems, curriculum development, and environmental justice and diversity. The framework was used as an essential document in ESAC's planning process, and many of the policies and programs have been included in the Sustainability Action Plan. The BOG Framework can be viewed in Appendix B.



2.4.2 California State Climate Regulations

California has been very aggressive over the past 40 years in establishing legislation and executive orders to improve energy efficiency and reduce GHG emissions. These efforts have accelerated in the past ten years as the effects of climate change have become more prevalent, resulting in the need to mitigate the impacts on future generations. The following is a summary of the most critical recent state actions.

2.4.2.1 Global Warming Solutions Act of 2006 (AB 32)

Assembly Bill (AB) 32, the Global Warming Solutions Act, which was adopted in 2006 by the California Legislature, established two critical requirements regarding climate change mitigation. The first caps California GHG emissions at 1990 levels by 2020. The second establishes an enforcement mechanism for the GHG emissions reduction program with monitoring and reporting implemented by the California Air Resources Board (CARB). In 2008, CARB released the AB 32 Scoping Plan, which describes measures to implement the requirements set by the legislation. In addition to partnering with local governments to encourage the establishment of regional emission reduction goals and community regulations, the scoping plan uses various mechanisms to reduce emissions statewide, including incentives, direct regulation, and compliance mechanisms.

In 2017, CARB updated the scoping plan to reflect the state policy of reducing GHG emissions by 40% below 1990 levels by 2030. In May 2022, CARB adopted a 2022 Scoping Plan Update that assesses progress toward the statutory 2030 target and lays a path to achieving carbon neutrality no later than 2045. The 2022 Scoping Plan Update focuses on outcomes needed to achieve carbon neutrality by assessing pathways for clean technology, energy deployment, natural and working lands, and others. It is designed to meet the state's long-term climate objectives and support a range of economic, environmental, energy security, environmental justice and public health priorities. The 2022 Scoping Plan Update can be found [here](#).

2.4.2.2 Clean Energy and Pollution Reduction Act of 2015 (SB 350)

The Clean Energy and Pollution Reduction Act of 2015 requires that the annual amount of electricity generated and sold to retail customers from eligible renewable energy resources (known as the Renewable Portfolio Standard (RPS)) be increased from 33% to 50% by December 31, 2030. It also requires the California Energy Commission (CEC) to establish annual targets for statewide energy efficiency savings and demand reduction to achieve a cumulative doubling of statewide energy efficiency savings in electricity and natural gas by January 1, 2030. The bill was authored by State Senator Kevin De León and enacted in 2015.

2.4.2.3 Executive Order B-18-12

Executive Order B-18-12, signed by Governor Brown on April 25, 2012, required 50% of new state buildings beginning design after 2020 to be Zero Net Energy (ZNE) and that all new buildings and major renovations beginning design after 2025 be constructed ZNE. It also requires state agencies to achieve ZNE for 50% of the square footage of the existing state-owned building area by 2025.

2.4.2.4 Executive Order B-55-18 (Carbon Neutrality by 2045)

Executive Order B-55-18, signed by Governor Jerry Brown on September 10, 2018, established new statewide goals to achieve carbon neutrality as soon as possible, but no later than 2045, and to achieve and maintain net negative emissions. The order added to previous statewide goals for reducing greenhouse gas emissions.

2.4.2.5 100% Carbon-Free Energy by 2045 (SB 100)

SB 100 set a 2045 goal of powering all retail electricity sold in California and state agency electricity needs with renewable and zero-carbon resources, such as solar and wind energy that do not emit climate-altering greenhouse gases. It updated the state's Renewables Portfolio Standard goal to ensure that by 2030 at least 60% of California's electricity is generated from renewable sources. The law also required the California Energy Commission (CEC), California Public Utilities Commission (CPUC), and CARB to use programs under existing laws to achieve 100% clean electricity and to issue a joint policy report on SB 100 by 2021 and every four years thereafter. The legislation was authored by State Senator Kevin De León and enacted in 2018.

2.4.2.6 California's Short-Lived Climate Pollutant Reduction Strategy (SB 1383)

SB 1383 is a new state law designed to keep food and other compostable materials out of landfills to reduce methane emissions contributing to climate change. Under the law, edible food currently thrown away must be recovered and donated for people to eat. The remaining organics must be collected for composting, and



recyclables must also be kept out of landfills. County waste management agencies began implementing the regulations in January 2022. Businesses, multi-family properties, residences, schools and other institutions are required to implement the law by subscribing to curbside compost and recycling collection services and garbage service.

2.4.2.7 The Inflation Reduction Act of 2022

The Inflation Reduction Act of 2022 (IRA) is a federal law that aims to curb inflation by reducing the deficit, lowering prescription drug prices, and investing in domestic energy production while promoting clean energy. It was passed by Congress and signed into law by President Joe Biden on August 16, 2022. The law, which will raise \$737 billion and authorize \$369 billion in spending on energy and climate change, represents the largest investment in addressing climate change in U.S. history. According to several independent analyses, the law is projected to bring the U.S. significantly closer to President Biden's goal of reducing greenhouse gas emissions to 50% below 2005 levels by 2030. The district should explore avenues to obtain funding authorized by the bill for the implementation of measures in the Sustainability Action Plan. This will include consulting with the state Chancellor's Office and the statewide Association of Chief Business Officers (ACBO) Facilities Task Force, which advises community college districts on facilities, energy and sustainability issues.


While not legislation, the United Nations [Sustainable Development Goals](#) (SDGs), adopted by all United Nations Member States in 2015, provide a shared blueprint for peace and prosperity for people and the planet, now and into the future. At its heart are the 17 SDGs, which are an urgent call for action by all countries — developed and developing — in a global partnership. The UN recognizes that ending poverty and other deprivations must be linked with strategies that improve health and education, reduce inequality, and spur economic growth while tackling climate change and working to preserve our oceans and forests. The district will use these goals as inspiration and guidance when implementing the Sustainability Action Plan.

SECTION 3. MISSION STATEMENT, GOALS, AND OBJECTIVES

The Foothill-De Anza Community College District Energy and Sustainability Advisory Committee, utilizing the California Community Colleges sustainability planning template process, established the sustainability action plan's mission, goals and objectives through facilitated committee workshops and participatory governance presentations that maximized stakeholder input. After adoption, ESAC identified implementation programs and projects to make the mission, goals and objectives a reality and to ensure that they were aligned with the district's educational and equity goals.

3.1 SUSTAINABILITY ACTION PLAN PLANNING STRUCTURE

ESAC developed a planning structure designed as an inclusive, logical, comprehensive and streamlined approach for creating the Sustainability Action Plan (SAP). The illustration below details this process.

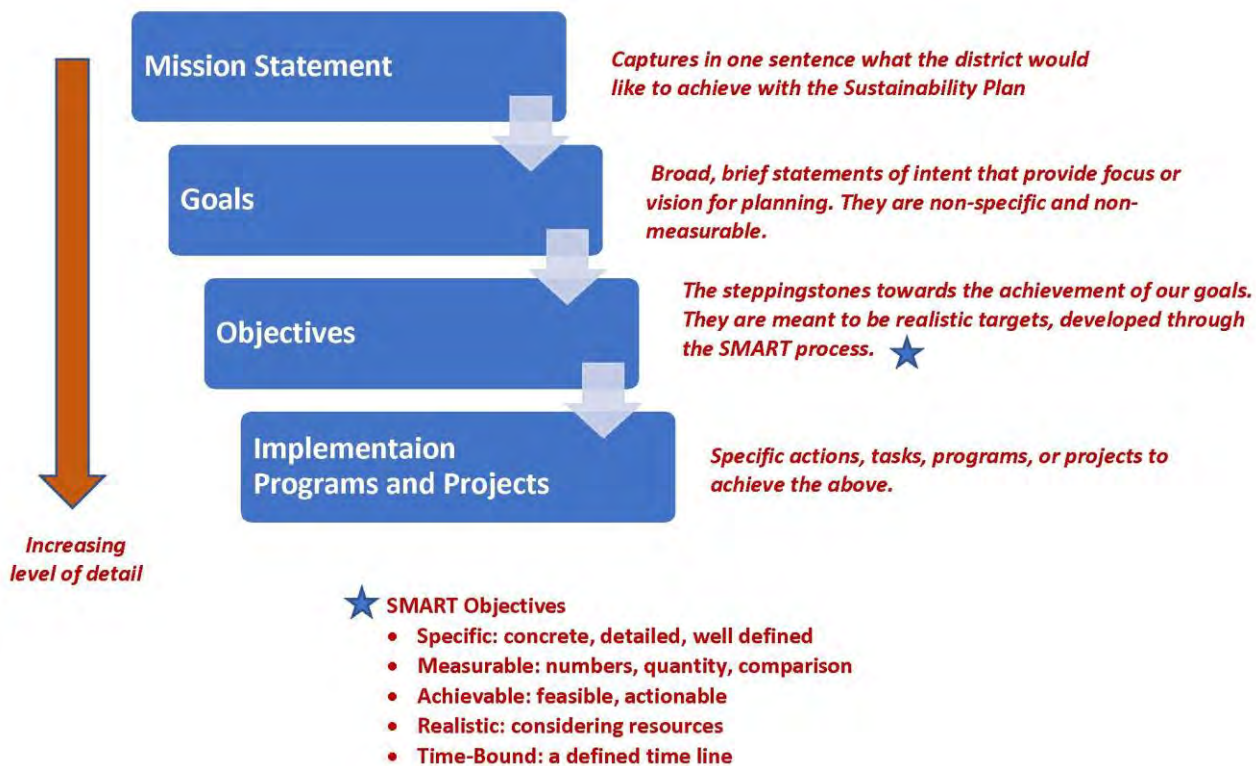

The planning structure starts with a broad mission statement that captures in one sentence what the district would like to achieve with the Sustainability Action Plan. The next level of planning articulates goals in broad, brief statements of intent that provide a focus for planning. Next, objectives were identified as “steppingstones” toward achieving the goals using the SMART process: Specific, Measurable, Achievable, Realistic, and Time-Bound. Finally, detailed implementation programs and projects were developed as specific actions to implement the plan.

3.2 MISSION STATEMENT

ESAC developed the following mission statement to guide the district’s sustainability action planning efforts.

The Foothill-De Anza Community College District Sustainability Action Plan guides our policies, goals and objectives for environmental stewardship, social equity, and financial responsibility. It encompasses the impacts of the actions of students, faculty, staff, and administrators on our district and our communities.

3.3 SUSTAINABILITY ACTION PLAN GOALS

To realize the mission statement, ESAC defined the following energy and sustainability goals.

Table 1 – Sustainability Action Plan Goals

Goal No.	Description
1	Develop a Sustainability Action Plan to identify measures to reduce resource use impacts, improve sustainability, and strengthen campus resilience by employing all appropriate funding sources.
2	Establish an inclusionary process where students, faculty, and staff play a meaningful role in district sustainability efforts and understand the environmental, societal, and economic impacts of resource use while integrating these activities as learning opportunities to fulfill our responsibility as a higher education institution.
3	Advocate for social equity, inclusion, intersectionality ⁴ , and environmental justice in curriculum and college programs.
4	Establish objectives, criteria, and implementation plans to achieve carbon neutrality and monitor progress over time to ensure they are achieved.

⁴ [A lens, a prism, for seeing the way in which various forms of inequality often operate together and exacerbate each other.](#)

Goal No.	Description
5	Explore restorative and regenerative design principles ⁵ that contribute positive impacts.
6	Support state and federal energy policies and greenhouse gas (GHG) reduction goals, including the most up-to-date California Community Colleges Board of Governors Climate Action and Sustainability Framework.
7	Establish the Foothill-De Anza Community College District as a model for a broad environmental justice approach to sustainability to face the challenges of the 21 st century.

3.4 OBJECTIVES

Based on the mission and goals, ESAC developed the following Sustainability Action Plan SMART objectives providing specific, measurable, achievable, realistic, and time-bound priorities for completing the Sustainability Action Plan. The table also references the associated plan goals to provide a link to better illustrate program structure.

Table 2 – Sustainability Action Plan Objectives

No.	Objective	Timeline	Associated Goal
Leadership and Management			
1	Investigate the most effective ways to institutionalize energy and sustainability management in district operations. (FDACCD EMP) ⁶	Ongoing	1,7
2	Ensure activities consider broader social, economic, and environmental impacts. (FDACCD EMP)	Ongoing	2, 3

⁵ <https://www.hdrinc.com/insights/6-things-know-about-regenerative-design>

⁶ Objective Source Reference Legend

BOG = CCC Board of Governors 2021 Climate Action and Sustainability Framework

FDACCD EMP = Foothill-De Anza CCD 2021 Energy Master Plan

No.	Objective	Timeline	Associated Goal
Energy and GHG Emissions			
3	Strive to reduce GHG emissions by 75% by 2030. (BOG) ⁷	2030	4,6
4	Strive to reduce GHG emissions by 100% by 2035. (BOG)	2035	4,6
5	Strive to decrease EUI by 25% compared to the campus benchmark and annually produce or procure 75% of site electrical consumption using renewable energy by 2030. (BOG)	2030	4,6
6	Strive to decrease EUI by 40% compared to the campus benchmark and accomplish Net Zero Energy ⁸ Campus by 2035. (BOG)	2030	4,6
7	Evaluate campus resiliency opportunities (PV, BES, Microgrid). (FDACCD EMP)	2022-2025	1
Green Building			
8	Strive for all new buildings and major renovations to be constructed as ZNE ready, to be LEED or WELL Platinum with a minimum LEED Silver (self-certified), and evaluate and strive for existing buildings to be LEED Operations and Maintenance (O&M) Gold or WELL Gold equivalent, and strive to reduce the use of natural gas in buildings by 100% by 2035. (BOG)	2035	6
9	Investigate restorative and regenerative design principals for inclusion into district building standards by 2023 which focus on decreased energy usage, increased student learning, and increased ecosystem outcomes such as positive habitat impacts.	2023	5
Water and Wastewater			
10	Reduce potable water consumption by 15% from 2019 ⁹ and monitor and comply with future county water usage restrictions.	2022	1

⁷ [Scope 1 and 2 Emissions Only - Definition](#)

⁸ [DGS ZNE Definition](#)

⁹ [Santa Clara County Water Agency Mandatory Reduction Goals](#)

No.	Objective	Timeline	Associated Goal
11	Strive to reduce potable water usage by 25% from the baseline level. (BOG)	2022	1,6
12	Strive to reduce potable water usage from baseline level by 50% by 2035; limit stormwater runoff and discharge to predevelopment levels for temperature, rate, volume and duration of flow (BOG)	2035	1,6
Transportation			
13	Deploy EV charging infrastructure consistent with the state of California goals and timelines for electrification of transportation. (FDACCD EMP)	2025-2030	4,6
14	Reduce Vehicle Miles Traveled (VMT) for students, faculty, and staff by 25-50% by 2035 by coordinating with other ongoing district programs. (FDACCD EMP) ¹⁰	2035	4
15	Strive to have 50% of new fleet vehicles that are zero-emission vehicles and 50% of rolling stock that are zero emissions by 2030. (BOG)	2030	4,6
16	Strive to have 100% of new fleet vehicles that are zero-emission vehicles and 100% of rolling stock that are zero emissions by 2035. (BOG)	2035	4,6
Solid Waste			
17	Strive to achieve zero waste to the landfill, and reduce total material consumption compared to the benchmark of 10% by 2030. (BOG)	2030	4,6
18	Strive to increase material circularity by 25% and decrease consumption of materials by 25% by 2035. (BOG)	2035	1,6

¹⁰ [Scope 3 Emissions Definition from US EPA](#)

No.	Objective	Timeline	Associated Goal
Sustainable Procurement			
19	Increase procurement of sustainable products and services by 25% compared to benchmark levels by 2030. (BOG)	2025	1,6
20	Strive to increase procurement of sustainable products and services by 50% compared to benchmark levels by 2035. (BOG)	2035	1,6
Food Systems			
21	Strive to increase district sustainable food purchases to 20% of the total food budget by 2030 and to have 80% of the food served on campus meeting the goals of the Real Food Challenge ¹¹ or equivalent by 2035, while attending to the equity impacts of food prices and health impacts for students. (BOG)	2035	1,6
Diversity, Equity, and Environmental Justice			
22	Consistent with the Vision for Success, the district will create connections between plans, projects, and committees (including those specific to diversity, equity, and inclusion efforts) and include them in the Sustainability Action Plan. (BOG)	2025	3,6
Campus and Community Engagement			
23	Develop processes to communicate and engage students, faculty, and staff in energy and sustainability activities in meaningful ways. (FDACCD EMP)	2023	2
24	Enhance campus and community education and engagement. (FDACCD EMP)	2023	2
Curriculum			
25	Encourage and facilitate student learning activities related to sustainability and carbon reduction and increase career pathways to green jobs. (FDACCD EMP)	2023	2,3,7

¹¹ As defined by the [Real Food Challenge](#)

The draft mission, goals, and objectives were reviewed with the De Anza College Academic Senate, the De Anza Facilities team, and the Foothill College Classified Senate for feedback and input. The objectives were used to guide the development and adoption of the implementation programs and projects described in the next section of the Sustainability Action Plan. The objectives will apply to all district facilities, including Foothill College, De Anza College, the Sunnyvale Center, and the district offices. ESAC should monitor progress toward achieving the objectives during plan implementation as described in Section 5, “Measure and Report Performance.”

SECTION 4. PROGRAMS AND PROJECTS FOR IMPLEMENTATION

Based on the goals and objectives described in the previous section, the Energy and Sustainability Advisory Committee has identified the following programs and projects to improve campus sustainability, increase equity, and reduce GHG emissions. These programs and projects are also reflected in the Implementation Programs and Plans Checklist, located in Appendix C, which outlines program details, priorities, responsibility for implementation and the timeline for completion. The ESAC will use the checklist as an action plan to manage the implementation process.

4.1 MANAGEMENT AND ORGANIZATIONAL STRUCTURE

To effectively implement the Sustainability Action Plan, it will be necessary for the district to have a policy mandate for energy efficiency and environmental and social sustainability, the institutional structure required to manage the process, financial resources, and programmatic expertise to accomplish plan goals. The district has plans to implement the following programs to meet these needs.

4.1.1 Adopt a District Sustainability Policy

As described earlier, the Foothill-De Anza Community College District has been proactive in sustainability policy for many years. The Board of Trustees established policies for district sustainability that have been incorporated into the 2010 District Sustainability Plan, 2016 Facilities Master Plan, 2017-2023 District Strategic Plan, and 2018 Foothill College Sustainability Management Plan. In addition, the board adopted the Energy Master Plan in 2021 and endorsed the creation of this Sustainability Action Plan, which addresses districtwide and site-specific needs for each college regarding energy and sustainability.

4.1.2 Appoint a Sustainability Coordinator and Establish an Office of Sustainability

Recognizing the necessity for a coordinated effort and human resources to manage a large and complex program, the district approved the Energy and Sustainability Manager position in early 2022 to coordinate the implementation of the Sustainability Action Plan. It is anticipated that the position will be filled by the end of 2022 or early 2023.

Programs and projects are also listed in the Implementation Programs and Plans Checklist (Appendix C), which outlines program details, priorities, responsibility for implementation, and the timeline for completion. The checklist will be used as an Action Plan to manage the implementation process.

4.1.3 *Appoint a District Energy and Sustainability Committee*

The district established the Energy and Sustainability Advisory Committee (ESAC) to share timely, relevant, and accurate local and state energy and sustainability information with constituency representatives and to provide a forum for participation in defining opportunities to promote environmental sustainability. ESAC is an advisory body and part of the district's participatory governance process. The role and responsibilities of ESAC include:

- Review and make recommendations to promote environmental and social sustainability
- Review and make recommendations on energy use and GHG emissions reduction
- Look outward/forward on strategic planning to promote environmental and social sustainability
- Communicate and disseminate reports and updates to respective constituency groups and the community

In addition, ESAC has been tasked with managing the Sustainability Action Plan development and implementation.

4.1.4 *Explore Funding and Resources to Support Sustainability Activities*

A critical activity for this Sustainability Action Plan is identifying funding and resources for its implementation. The district will develop a funding plan and schedule to implement prioritized sustainability activities and projects. Funding sources could include the Measure G bond program, district and campus general funds, grants, utility incentives, state construction funds or other sources. The funding plan should be one of the first steps taken after adoption of the plan.

4.1.5 *Employ Sustainability Professionals, As Required*

Many of the projects identified in this plan require technical or programmatic expertise not available among district personnel. When appropriate, specialists should be engaged to assist in designing and implementing energy projects to ensure project success. The district will ensure that the individual or company being hired has experience relevant to the project for which they are being hired. Experience working with other California community colleges is also a plus.



Plans already established include the development of a request for qualifications/request for proposals (RFQ/RFP) to conduct an Electrification and Utility Upgrade Feasibility Study, which would quantify measures and costs to eliminate natural gas usage at college facilities to achieve GHG reduction goals. The RFQ/RFP has an anticipated release date to qualified engineers or architects in the fall or winter of 2022.

4.1.6 Evaluate Tracking and Reporting Sustainability Performance Using the AASHE Sustainability Tracking, Assessment & Rating System (STARS)

The district should evaluate the Association for the Advancement of Sustainability in Higher Education (AASHE) Sustainability Tracking, Assessment & Rating System™ (STARS®) to measure sustainability performance annually and report the results to the Board of Trustees. STARS is a transparent, self-reporting framework for colleges and universities to measure sustainability performance. The framework encompasses long-term sustainability goals for high-achieving institutions and entry points of recognition for institutions taking the first steps toward sustainability. More than 1,000 colleges and universities use STARS to measure sustainability progress. Basic access to STARS for self-reporting is free, and a paid subscription provides peer-reviewed progress reports and recognition on the AASHE website and other publications. For more information about STARS and AASHE, go [here](#). STARS takes an expansive approach to sustainability and includes issues of equity and environmental justice at the core of its metrics. For example, institutions are given credit for having bathrooms appropriate for transgender students, access to affordable systems of transportation, and programs accessible to low-income students.

The state Chancellor's Office has embraced this program for district sustainability tracking, and ESAC should coordinate activities with Chancellor's Office staff to ensure best practices implementation.

4.1.7 Integrate Sustainability Planning Into Educational and Facilities Master Plans

District and campus master plans and sustainability planning go hand in hand. Foothill-De Anza has a history of coordinated planning and has incorporated sustainability into the 2010 District Sustainability Plan, the 2016 Facilities Master Plan, the 2017-2023 District Strategic Plan, and the 2018 Foothill College Sustainability Management Plan. The district should integrate the mission, goals, objectives and measures identified in this Sustainability Action Plan into existing and future master plans.

4.1.8 Investigate the Most Effective Ways to Institutionalize Energy and Sustainability Management

The district recognizes that it is essential to institutionalize energy and sustainability into planning activities and everyday operations. Temporary, one-off efforts to manage sustainability activities result in short-term solutions that make it difficult to maintain progress into the future. To avoid these common pitfalls, ESAC should investigate the most effective ways and best practices to incorporate a broad approach to sustainability into the organization and foster a culture of sustainability in district operations. This will require districtwide operational and community training about new systems and processes at all levels. The first step in this process will be establishing and filling the previously described position of district Energy and Sustainability Manager.

4.1.9 Participate in California Community Colleges Systemwide Energy and Sustainability Committees

The California Community Colleges system, led by the state Chancellor's Office, has established several shared governance committees to develop and implement best practice energy and sustainability policies and programs and integrate them into local district operations statewide. These committees generally consist of Chancellor's Office and district personnel who participate in regular meetings and workshops that focus on college facility and finance issues, including energy efficiency and a broad approach to sustainability. These committees include the Chancellor's Office Climate Policy Steering Committee, the Association of Chief Business Officers (ACBO) Facilities Task Force, and the Community Colleges Facilities Coalition (CCFC). In addition, regional committees consisting of

personnel from local districts meet on a regular basis to discuss these issues as well.

Foothill-De Anza already participates in the ACBO Facilities Task Force but should broaden its activities and membership to the other statewide committees to help evaluate and implement policy, share experiences and expertise, and help influence future energy and sustainability efforts at the systemwide level.



4.2 CARBON REDUCTION PROGRAMS

One of the district's highest priorities is reducing greenhouse gas (GHG) emissions and achieving carbon neutrality to mitigate climate change. The district should undertake the following activities to achieve its carbon reduction goals. These efforts will support California's policy goals for GHG reduction and establish Foothill-De Anza Community College District as a leader in energy efficiency and sustainability among community colleges statewide.



4.2.1 Implement Measure G Bond Projects

On March 3, 2020, voters in the Foothill-De Anza Community College District approved an \$898 million general obligation bond measure (Measure G) to upgrade facilities preparing students for university transfer and careers in fields such as health care, nursing, technology, engineering and sciences; to upgrade and repair aging classrooms as well as labs for science, technology, engineering and math-related fields of instruction; and to acquire, construct, repair facilities, equipment and sites. The Measure G implementation plan includes many energy-saving and GHG reduction projects at each district location, including new construction, major renovations, and energy-saving retrofits for existing lighting, HVAC, and central plant systems. The bond projects will significantly improve energy performance in the district and be an essential element in achieving carbon neutrality goals. The complete list of Measure G energy-saving projects is included in Appendix D of the Sustainability Action Plan.

4.2.2 Perform a Feasibility Study for District Electrification

As one of its first steps in implementing the SAP, ESAC recommends engaging a qualified energy consultant to conduct a feasibility study to electrify facilities operations and eliminate natural gas systems, such as HVAC and hot water equipment, to achieve carbon neutrality. This study will evaluate the most effective technologies to replace existing natural gas equipment with electrically powered equipment, such as electric heat pumps and

thermal energy storage. The study would also assess the necessary campus electric utility upgrades to support electrification and any PG&E service changes needed. An analysis of electrification costs, potential funding sources (including Measure G funds), energy savings, emissions reductions, and return on district investment with recommendations would be prepared as a road map for the district to achieve carbon neutrality.

4.2.3 *Develop an Energy Data Foundation for a Usage Analysis at All Three Campuses to Support GHG Reduction Goals.*

To meet district GHG reduction goals, the district should quantify electricity and natural gas usage pre-and post-COVID as a baseline for planning. The Energy Benchmarking Study prepared in 2021 (Appendix E) provided an analysis of electric and gas usage in the calendar years 2018 and 2019 to understand pre-COVID usage. This study documented energy use at the campus master meters. More detailed analysis will be required at a building and system level to better understand usage patterns and opportunities to reduce excess use. In addition, data should be collected based on 2022 use and forecasts for post-COVID as students, faculty and staff return to campus. This data will be employed for the Electrification Feasibility Study described previously.



Specific tasks that should be accomplished for this project include the following.

- Work with an energy consultant or a mechanical contractor to specify and install electric, natural gas, and BTU meters on individual buildings and central plant systems — especially pool boilers and microturbine systems — to develop a thermal energy model for natural gas efficiency and HVAC electrification.
- Continue working with utility Électricité de France (EDF) Innovation Labs in Los Altos, California, and San Francisco State University to evaluate the replacement of natural gas hot water boilers with a thermal microgrid (electric heat pumps and heat recovery systems) at the Central Energy Facility on campus. This analysis, using TOTEM (Tool for Optimization of Thermal and Electric Microgrids), will model the campus’s combined electric (power and energy) and thermal (HVAC) system to understand and evaluate thermal microgrid replacement of the natural gas uses. A TOTEM Analysis White Paper describing this project in detail can be found in Appendix F.
- One of the BOG Framework goals is for campuses to establish GHG emissions inventories and develop Climate Action Plans (CAP) by 2025. The energy data captured by this task should be used to create the CAP, identifying GHG reduction measures that will go together with implementing the Sustainability Action Plan.

4.3 ENERGY EFFICIENCY

Energy efficiency is the most cost-effective way to reduce campus energy use and its carbon footprint. When appropriately implemented, efficiency measures can decrease energy use without compromising comfort, improve indoor air quality, and enhance student, faculty and staff performance. Energy efficiency should be a

higher priority than renewable or other on-site energy generation due to more favorable economics and the need to avoid oversizing renewable energy systems.


The following energy efficiency programs and projects should be implemented in the district. This would include the energy efficiency projects projected for Measure G funding.

4.3.1 Set Energy Efficiency Goals

Planning for energy conservation is a district priority. It is essential to set goals for reducing any resource to define success. The district performed an Energy Benchmarking Study in 2021, employing the U.S. Environmental Protection Agency (EPA) Portfolio Manager software to establish energy usage and GHG emission baselines. Using this data, the district can develop annual energy use and GHG emission reduction goals and plan appropriate energy efficiency, demand reduction, or clean self-generation measures to achieve these goals. In addition, the BOG Framework has established both Energy Use Intensity (EUI) — electricity and natural gas use per gross square foot per year — reduction goals and a goal to accomplish a zero net Energy (ZNE) campus, which the district should strive to achieve by 2035.

4.3.2 Evaluate Mechanisms for the Implementation of Energy Efficiency Projects

The district can evaluate various mechanisms for identifying and implementing energy efficiency projects and programs, including in-house staff, engineering consultants, design-build contractors and energy service companies (ESCOs). The district has extensive experience with these various mechanisms for energy project delivery and can leverage this knowledge to implement the Sustainability Action Plan. In addition, the district should evaluate best practices provided by other California community college districts for delivering energy projects.

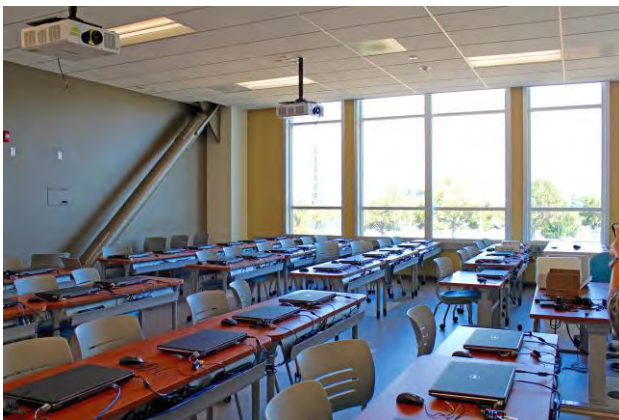

4.3.3 Conduct Facility Prioritization Surveys

Conducting a facility prioritization survey to identify and prioritize buildings for efficiency measures is a suggested first step. Priorities are typically based on energy use intensity with buildings with the highest EUI given the highest priority. The district is planning on installing meters at the building level, which can be used to benchmark energy use. Where metered data does not exist, those buildings that are determined to be high-energy users based on experience of college/district staff should be targeted first.

4.3.4 Conduct Comprehensive Facility Energy Audits

Based on the facility prioritization survey, the committee suggests the district engage an energy consultant to conduct ASHRAE Level 2 Energy Audits to identify energy-saving projects, project costs, energy savings and return on investment. The consultant would develop an audit report with recommendations for projects that best meet the district's goals. Energy audits can also be enhanced by using energy models that forecast the energy

performance of retrofitted or renovated facilities to provide more certainty of project outcomes.

4.3.5 Implement Energy Audit Recommendations

Based on the audits and available resources, the district should implement the audit recommendations. Priorities should be determined by potential energy savings, return on investment and available resources. Ongoing audits should be conducted as technologies change and building systems become obsolete.

4.3.6 Participate in Demand Response Programs

The district should evaluate participating in utility demand response programs to that provide incentives for voluntarily reducing campus loads during high usage peak periods. The district should meet with PG&E to explore the program to determine if participating is in the colleges' best interest.

4.3.7 Install Energy Efficient Equipment

All equipment replacements identified in the SAP should be energy-efficient and be included as performance specifications in procurement documents. This includes lighting, HVAC (including electrification measures), pumping, motors and other equipment and systems. Appliances and office equipment should be EPA Energy Star rated.

4.3.8 Manage Plug Loads

Plug loads refer to energy used by equipment plugged into an electrical outlet. A typical office's plug loads include computers, monitors, printers and copiers. Plug loads can average approximately 30% of electricity use in office settings, much of which can be attributed to parasitic loads (or the power draw of a plug-load that is not performing useful work). Reducing or managing plug loads is often overlooked when planning energy efficiency measures in facilities. The district should evaluate plug load management strategies, including manual control, automatic controllers, timers, occupancy sensors, load sensing controllers and other measures.

4.3.9 Evaluate and Apply Best Practices Energy Efficiency Measures

The district should evaluate practices from other community colleges, the UC and CSU systems, and other institutions that have successfully implemented energy efficiency measures and adopt as appropriate. The California community colleges have organized committees at the systemwide and regional levels that share best practice facilities, energy, and sustainability initiatives that are extremely valuable for this purpose. Conferences, corporate and non-profit Zoom webinars, and state and federal agencies, such as the California Energy Commission (CEC) or the U.S. EPA, involved with energy efficiency and sustainability programs are good sources of best practices. The district should leverage these sources to better plan energy and sustainability.

4.4 FACILITIES OPERATION

In addition to installing energy-efficient equipment, the district should strive to operate high-performing facilities, buildings, and energy infrastructure systems optimized for comfort, productivity, and energy and resource efficiency. The following programs and projects should be evaluated for implementation.

4.4.1 Encourage and Support Energy Efficiency Training of Staff

The engineering, maintenance, and operations staff at Foothill and De Anza colleges have been trained to operate energy-consuming equipment and systems efficiently. Ongoing training programs should be developed and implemented to ensure that the staff is up-to-date on equipment, mechanical and electrical systems, and facility operational changes. This will be especially important as the district transitions to a carbon-free operating environment with the associated sophisticated systems.

4.4.2 Upgrade Building and Energy Management Systems

The district has installed the Gridium Snapmeter Energy Information System (EIS) at both college campuses and the Sunnyvale Center to monitor and track energy usage, evaluate trends in use over time, and develop analytic metrics to assist in managing and reducing energy usage. Currently, the system monitors electricity and natural gas use, solar photovoltaic generation, pool cogeneration systems and a few distinct buildings on the campuses. One of the district's goals is to install whole-building meters at all campus facilities to benchmark individual buildings and troubleshoot high-energy users for mitigation strategies to reduce usage. In addition, many of the existing meters are currently nonfunctional and should be repaired or replaced to provide accurate data for analysis.

The district employs Pordis Consulting and Design Services to analyze energy usage data obtained through utility and solar generation meters. Pordis monitors energy consumption and provides recommendations for changes in operations and equipment to improve energy performance and reduce costs. This has been a helpful service to the district and should be evaluated for future needs.

The district has installed several different building management systems (BMS) over the years. These systems are Novar, Tridium Niagara, and Siemens. The systems are installed at various campus buildings and do not communicate with each other or the Gridium or Pordis systems. As of this writing, the district has engaged a controls consultant to troubleshoot and improve the performance of the BMS.

4.4.3 Adjust Temperature Set Points and Schedule Operating Times

The district can avoid overcooling and overheating by raising cooling temperature set points and lowering heating temperature set points. Implementing hot water reset controls with setpoint changes for the campus central plants would help avoid wasting energy during milder weather.

A good guideline is to heat buildings at or below 68 F and cool buildings at or above 72 F to avoid excessive heating and cooling. To avoid unnecessary heat loss, domestic hot water temperatures should not be set above 120 F. These limits will not apply in areas where other temperature settings are required by law, specialized equipment, or scientific experimentation needs.

4.4.4 Evaluate Opportunities to Optimize Building Occupancy Scheduling

Scheduling of building and facility usage should be optimized to reduce the number of buildings operating at partial or low occupancy. To the extent possible, academic and nonacademic programs should be consolidated to achieve the highest building utilization. Campus and district staff should make all attempts to change or update

building operating schedules to match the changes in academic programs. Making significant changes in this area will require a concerted education process for building users by district facilities staff.

4.4.5 Optimize HVAC Equipment Scheduling

All air conditioning equipment, including supply and return air fans, should be shut off on weekends, holidays, and for varying periods each night, except where it would adversely affect instruction, electronic data processing installations, or other scientifically critical or 24-hour operations. The district should avoid cooling and heating spaces when unnecessary. This would be accomplished by scheduling HVAC systems off during unoccupied times while implementing a pre-cooling strategy to cool the building in the early morning before outside temperatures warm up. For central plant systems, scheduling lockouts for chillers and boilers could be employed to avoid running this equipment when unneeded. It's important to note that some facilities are used late into the evening and on weekends, and accommodations should be made to ensure these operational needs are supported.

4.4.6 Install Meters and Benchmark at the Building and System Level

As described above, in March and April 2021, the district performed a benchmarking study of energy usage at the master metered campus level for Foothill College, De Anza College, and the Sunnyvale Center. The results established Energy Use Intensity (EUI) for each site in [kBTu/square feet](#), which were compared to other similar uses and community college campuses as a starting point for energy planning.

Benchmarking energy use at the campus level is an essential first step in identifying high energy use facilities. However, to better isolate excess usage and investigate mitigation measures, the district should install electric, natural gas, and BTU meters (to measure central plant hot water energy) at every building and central plant system on the campuses. The district could then connect the individual building meters to the Gridium EIS and EPA Portfolio Manager to understand usage trends, benchmark them to similar higher education uses, and target measures to improve energy performance at the building level.

4.4.7 Pursue Monitoring-Based Commissioning (MBCx)/Retro-commissioning (RCx)

For buildings or central plant systems determined to be high energy users through the benchmarking process, the district should implement a Monitoring-Based Commissioning (MBCx) or Retro-Commissioning (RCx) process to reduce energy usage at those facilities. MBCx is a process that optimizes building performance for comfort and energy use by using meters and analyzing system performance. RCx is a process that identifies individual energy efficiency projects to improve the control of the system to reduce energy use. For more information about MBCx and RCx, go to the [U.S. Department of Energy Best Practices for MBCx](#).

The district has employed the MBCx/RCx process in recent years as part of the Proposition 39 program. In 2016, two MBCx projects were completed successfully at the De Anza pool cogeneration system and the S-Quad building complex. These projects save 18,000 kWh and 8,000 therms



annually with an avoided energy cost of \$9,812 each year. The district should also employ the strategies of Continuous Commissioning of facilities, which is an ongoing process to resolve operating problems, improve comfort and optimize energy use.

4.4.8 Perform Regular Maintenance on Equipment

Effective preventive and regular maintenance programs keep equipment and systems operating optimally and reduce excess energy use. The district should continue routine maintenance schedules to ensure proper maintenance and revise practices necessary to optimize energy performance. Good maintenance planning includes understanding the life cycle of equipment and when it is better to replace rather than repair, which can also provide excellent opportunities for energy-efficient upgrades.

4.4.9 Prepare a Climate Adaptation and Resiliency Plan

As the effects of climate change become more evident, it will be important for the district to consider development of a Climate Adaptation and Resiliency Plan to prepare the campuses for current and future emergencies, wildfires and drought. Due to the instability of the electric grid and ongoing [PG&E Public Safety Power Shutoffs \(PSPS\)](#), the district should evaluate [energy supply resiliency](#) options. These could include solar photovoltaic (PV)/battery energy storage [microgrid](#) systems, which consist of solar PV generation, battery energy storage, and sophisticated controls that permit the “islanded” operation of certain campus facilities and systems in the event of a utility power outage. These facilities could serve as emergency community gathering spots or cooling centers during extreme heat events.

4.5 SUSTAINABLE BUILDING PRACTICES

Construction and renovation of new and existing facilities provide a significant opportunity to reduce the environmental impacts of the built environment through sustainable building practices, which also can lead to increased well-being of building users. The district should continue to evaluate energy- and resource-efficient green building practices in the design and construction of all new and renovated facilities.

4.5.1 Establish a Green Building Standard

It is highly recommended that the district adopt appropriate green building standards for new construction and major renovation projects to implement the Measure G bond program. This will ensure that projects will be energy-efficient and help the district achieve its carbon reduction goals. Minimum standards are mandated by state building codes such as CALGreen. CALGreen is California’s first green building code and the first in the nation state-mandated green building code. It is formally known as the [California Green Building Standards Code](#), Title 24, Part 11, of the California Code of Regulations. CALGreen aims to improve public health, safety and general welfare through enhanced design and construction of buildings using concepts that reduce negative impacts, promote those principles with a positive environmental impact and encourage sustainable construction practices. The CALGreen code is roughly equivalent to LEED Silver.

While state building codes provide high levels of construction energy efficiency, the path to decarbonization will require advanced strategies beyond state codes. The California Community Colleges Board of Governors has recommended standards that include requirements for [Zero Net Energy \(ZNE\)](#)-ready new construction, LEED and

WELL Gold, and LEED Operations and Maintenance strategies for existing buildings.

ESAC has adopted a modified version of the BOG Framework as follows: ***Strive for all new buildings and major renovations to be constructed as ZNE ready, to be LEED or WELL Platinum with a minimum LEED Silver (self-certified), strive for all existing buildings to be LEED Operations and Maintenance (O&M) Gold or WELL Gold equivalent, and strive to reduce the use of natural gas in buildings by 100% by 2035.*** ESAC recommends that the Board of Trustees adopt this standard for all new construction and major renovation projects.

4.5.2 Implement Sustainable Design Practices

New green building standards will require that new construction, renovation, maintenance and repair projects be designed to consider optimum energy utilization, low life cycle operating costs, and compliance with the district's goals and applicable energy codes and regulations. The district should address energy-efficient and sustainable design early in the project planning and design phases to maximize cost-effectiveness.

The following elements should be considered in the design of all buildings for the district:



- Siting and design considerations that optimize local geographic features to improve the sustainability of the project, such as proximity to public transportation, consideration of microclimates, and passive or active solar energy opportunities
- Durable systems and finishes with long life cycles that minimize maintenance and replacement
- Optimization of layout and design of spaces to accommodate reconfiguration, with the expectation that the facility should be renovated and reused (versus demolished)
- Optimization of indoor environmental quality for occupants
- Utilization of environmentally preferable products and processes, such as recycled content materials and recyclable materials
- Systems that monitor, trend and report operational performance
- An active program for recycling and reuse of materials in each building
- Outdoor spaces designed to use permeable pavement and provide shade through tree planting to prevent the heat island effect
- Sustainable landscaping practices
- ENERGY STAR® rated equipment in new or renovated buildings
- Construction and demolition recycling program for all new construction and major renovations
- Repurpose buildings for new uses rather than demolition and reconstruction

4.5.3 Use an Integrated Systems Approach in Building Design



Sustainable building strategies should be evaluated to identify economic and environmental performance criteria, evaluate life cycle savings, and adopt an integrated systems approach. Such an approach treats the entire building as one system. It recognizes that individual building features, such as lighting, windows, heating and cooling systems, should be evaluated and designed as interactive systems.

4.5.4 Hire Sustainable Building Design Professionals

The district has historically utilized architectural firms, LEED consultants and energy engineers experienced in all phases of the building design process to construct energy and resource-efficient buildings. The district should also take advantage of the utility-provided energy efficiency new construction design programs, such as the CPUC-funded [California Energy Design Assistance Program](#) (formerly known as Savings by Design) and the Silicon Valley Clean Energy [Building Electrification Technical Assistance program](#).

4.5.5 Commission New Buildings

All new buildings should be commissioned after construction or major renovations to ensure that systems are installed and operating as designed. Individual systems should also be commissioned to ensure that they run as efficiently as possible. This will be especially important based on the significant construction and renovations from the Measure G bond program. At a minimum, the district should comply with the State of California [Non-Residential Commissioning Requirements](#) in the 2019 Energy Code.

4.5.6 Develop Regenerative Design and Nature Positive Principles

The district should evaluate [regenerative design](#) practices and [nature positive](#) principles in building construction and major renovation projects. These would go further than the recommended green building standard described above. They will not only limit environmental damage but also enhance and actively regenerate or contribute positive impacts to the people who use them and the local ecology surrounding them. This is the next wave of the sustainability movement, and the district will be establishing itself as a true leader among community colleges in implementing these programs.

4.5.7 Set Net-Positive Goals and Plans

Regenerative and nature positive planning require setting net positive goals related to material circularity, climate

positive measures, collaborative action, community success, food reconnection, optimizing water use, personal action and climate resilience in sustainability planning. [Arizona State University](#) is a leader in this area, and the district should examine their work and others to evaluate these strategies.

4.6 ON-SITE GENERATION AND RENEWABLE ENERGY

The district has implemented many on-site solar PV and cogeneration projects on both the Foothill and De Anza campuses. In addition, the district has taken advantage of utility programs to purchase renewable and carbon-free offsite grid energy. Despite these renewable energy accomplishments, more should be done to achieve the carbon reduction goals of the district, especially electrification of HVAC and hot water systems.



4.6.1 Evaluate Load Shifting Technologies

A prerequisite for installing renewable energy systems is to maximize energy efficiency at facilities and reduce peak loads to prevent oversizing generation equipment and the resulting unnecessary costs. Section 4.3 of the Sustainability Action Plan addresses the energy efficiency component of this equation. Reducing peak electricity loads and utility demand charges can be accomplished by participating in [utility demand response programs](#). In addition, battery energy storage (BES) technologies charged by solar generation can supply loads in the afternoon and evening peak periods (4 p.m. to 9 p.m.). Thermal energy storage systems can provide chilled and hot water during the same period to offset electric usage.

4.6.2 Minimize Greenhouse Gas Intensity of Purchased Electricity

Another way to increase renewable or carbon-free energy at district facilities is through utility-purchased offsite green grid energy. The Sunnyvale Center already receives 100% renewable electricity through Silicon Valley Clean Energy. Both Foothill and De Anza colleges purchase grid electricity through Constellation New Energy, delivered through PG&E transmission and distribution networks, with a renewable power content of 27%.

The district should explore opportunities to improve the renewable content of purchased electricity for Foothill and De Anza through PG&E or third-party programs. In addition, the district should evaluate the feasibility and potential benefits of investing in offsite renewable generation through project ownership or power purchase agreements (PPAs) with a goal of 100% renewable energy at the campuses. The district will not pursue renewable energy by purchasing renewable energy credits.

4.6.3 Perform a Feasibility Study for Additional Solar PV at Campuses

The district has already installed significant solar PV systems at the Foothill and De Anza campuses. Additional solar capability will likely need to be installed to achieve the district carbon reduction goals. A feasibility study

should be prepared to determine if additional solar power can be installed at the campuses and determine the optimal sizing of these systems. This study would be incorporated into the proposed Electrification Feasibility Study (described in Section 4.2.2) to determine if campus loads will accommodate additional solar PV installations.

4.7 TRANSPORTATION, COMMUTING, CAMPUS FLEET AND TRAVEL

The district should strive to reduce vehicle miles traveled (VMT) for students and employees commuting to the campus to reduce greenhouse gas emissions and minimize the infrastructure costs related to parking. The district should also evaluate the expansion of existing electric vehicle (EV) charging infrastructure to meet the state of California CALGreen standards and the Division of the State Architect (DSA) requirements for accommodating EV chargers on the campuses.

4.7.1 *Participate in District Transportation Surveys and Analysis*

The district is conducting post-COVID transportation surveys for students and employees to better understand VMT to and from campuses, commuting patterns, EV charger usage and carpooling behaviors as a baseline for improvement. In addition, an analysis of continued remote learning and working is being evaluated as a means of VMT reduction. ESAC should engage with students to participate in this project as both a learning opportunity and foundation for solutions.

4.7.2 *Encourage and Enhance Public Transportation and Ridesharing Options*

Public transportation and ridesharing are options to reduce VMTs and greenhouse gases. The district should work with Santa Clara Valley Transportation Authority (VTA) to improve routes, increase campus bus service, reduce costs, and explore programs and best practices to help encourage and enhance public transportation ridership and facilitate carpooling and ridesharing. Other strategies that should be considered will be a continuation of SmartPass discounts for students and employees or other incentives to increase ridership, preferred campus parking for carpools, networking resources for carpools and vanpools, and engagement of car-sharing services. The district should also work with VTA to improve connections from De Anza College to Caltrain.



4.7.3 *Encourage and Enhance Bicycling Options*

The campuses should work with local municipalities to improve student and employee bicycle and pedestrian commuting options. Bicycle master plans adopted by local municipalities include the Cupertino [Bicycle Transportation Plan](#), the Town of Los Altos Hills [Pathways Project](#), and the city of Santa Clara [Bicycle Master Plan](#). The colleges should also review existing bicycling routes, bike racks, free or low-cost access to bikes, and public showering facilities to accommodate bicycling on campus more effectively.

4.7.4 Improve Campus Fleet and Travel

To comply with the BOG Framework, the district should adopt programs to reduce emissions from the campus vehicle fleet. This would include purchasing zero-emission fleet vehicles and other rolling stock to achieve 50% of total vehicles by 2030 and 100% by 2035.

4.7.5 Explore Student Distance Learning and Employee Remote Work

The COVID-19 pandemic was a crash course in remote learning and working in society. In a post-COVID world, there is an opportunity to improve and institutionalize these practices to benefit students and staff and reduce GHG emissions as an added benefit. The district already has many online courses but may need to improve student services in counseling, financial aid, mental health, tutoring, food resources, and tech resources and support to ensure equitable outcomes in online forms of education. [Arizona State University](#) is a leader in this area and could be a resource for program development.

4.7.6 Analyze and Install Electric Vehicle (EV) Charging Using On-Site Solar PV Electricity

The district has installed significant electric vehicle (EV) charging infrastructure in the past, including 10 Level 2 chargers on the De Anza campus and 13 at Foothill. The percentage and type of chargers required based on total parking spaces are included in the energy code and DSA requirements. The district should apply this guidance in planning for additional charging stations. In addition, the district should evaluate technologies and install autonomous vehicle fast-charging stations anticipating their future deployment.



4.7.7 Evaluate the Implementation of a Green Parking Permit program by 2030

The district should evaluate the criteria and benefits of a green parking permit program for implementation by 2030 as the BOG Framework recommends. A green parking permit could provide preferential location or free parking for low-GHG vehicles qualified through scoring criteria such as the U.S. EPA [SmartWay Vehicle](#) rating system. In addition, the equity issues surrounding such a program should be evaluated.

4.8 WATER, WASTEWATER AND SUSTAINABLE LANDSCAPING

California is experiencing a historic drought leading to unprecedented wildfires, damage to delta and other ecosystems, and challenges balancing agricultural and urban water use. Water conservation is an essential

component of sustainability and should be aggressively pursued by the district. Government agencies have established water use restrictions, but efforts should be made to go beyond these limits. The district should also reduce stormwater pollution by minimizing chemical fertilizers and pesticide use in association with landscaping practices. Regenerative and nature-positive principles should be evaluated to reduce stormwater runoff.

The district should pursue the following strategies to reduce water usage, stormwater runoff and water pollution.

4.8.1 *Establish Water Conservation Goals*

Much like energy efficiency goals, the district should establish goals to reduce water consumption on campus. The Santa Clara County Water District, as of June 2022, has mandatory water use reduction requirements of 15% over 2019 levels. As the 2022 drought stretches on, newly mandated reductions will likely come from the state and local agencies. In response to the drought, the district should strive to meet the BOG Framework goal of a 20% water use reduction over the 2019 baseline.

4.8.2 *Implement Water Conservation Strategies*

The district should develop and implement water conservation strategies to meet conservation goals and minimize penalties that may come from water districts due to the drought. Strategies could include the following:

- Maximize the resources of the [Santa Clara Valley Water Agency](#) for water conservation. These include landscape programs, rebates, outdoor and indoor conservation practices, water savings devices and other resources.
- Adopt water conservation landscaping practices.
- Install irrigation submeters on landscaped areas larger than 2,500 square feet and monitor regularly.
- Perform regular surveys to ensure that landscape sprinklers and irrigation are functioning properly.
- Submeter buildings for water usage and make data available to student conservation projects.
- Ensure that low-flow devices are installed on all appropriate plumbing and that they are operating properly.
- Explore rainwater harvesting techniques and implement where practical.



4.8.3 *Reduce Storm Water, Sewer Discharges and Water Pollution*

Stormwater and sewer discharges are a prime source of pollutants entering the environment and place the campus at risk for fines or other regulatory penalties. Stormwater management is an area where regenerative and nature-positive strategies can be used to reduce risks. The district should employ the following methods to reduce

discharges.

- Raise awareness to reduce discharges and pollutants - Ensure that staff, faculty and students are aware of the detrimental effects of contaminants in stormwater and sewer discharges. Ensure that chemicals, pharmaceuticals and other hazardous substances do not enter the sewage system. Use signage, and work to educate the campus community that only rainwater should enter storm drains. Follow all regulations regarding sewer and storm drain discharges.
- Reduce stormwater runoff - Utilize permeable paving, drainage swales and other methods as appropriate to minimize stormwater discharges and soil erosion. Nature-positive and regenerative strategies would include green roofs that capture stormwater and detention ponds which help recharge local aquifers.
- Utilize the California Community Colleges Storm Water Management Program [template](#).
- As recommended by the BOG Framework, follow the U.S. EPA Municipal Separate Storm Sewer Systems (MS4) requirements by 2030.

4.8.4 Adopt Sustainable Landscaping Practices

Sustainable landscaping practices conserve water and can contribute to achieving many other goals for sustainability. The district should evaluate adopting the [Bay-Friendly Landscape Guidelines](#) or other sustainable landscaping practices. The Bay-Friendly Landscape Guidelines were developed by the Alameda County Waste Management Authority (www.stopwaste.org) for the professional landscape industry to offer an integrated, regenerative, and nature-positive approach to landscape management. The guidelines are organized around seven principles for the protection of the environment:

- Landscape locally
- Landscape for less to the landfill
- Nurture the soil
- Conserve water
- Conserve energy
- Protect water and air quality
- Create and protect wildlife habitat

The guidelines consist of 55 practices to fulfill these principles, applicable throughout the state. The program is

comprehensive and may be used in total or selectively by the district to meet specific goals. Many jurisdictions in the San Francisco Bay Area have adopted the Bay-Friendly Landscape Guidelines and have found them to be effective. The district should engage Foothill's horticultural department in implementing this program.



4.9 SOLID WASTE REDUCTION AND RECYCLING

The district should strive to minimize solid waste to reduce greenhouse gas emissions and landfill deposits. Each campus receives waste disposal services from different municipally contracted companies that handle waste and

recycling slightly differently. Below is a summary of the providers and services offered.

[Recology South Bay](#) serves both Foothill and De Anza. Recology offers a three-bin service to their customers, including trash, mixed recyclables and organic waste (green and food waste). However, the three-bin service has not been implemented at either campus, and all waste is removed as a single stream. The combined waste is transported to a material recovery facility (MRF), where it is sorted to remove recyclables. The Sunnyvale Center is served by [Specialty Solid Waste and Recycling](#). This is also a single-stream service. This district would like to improve recycling and composting options and should take several steps to achieve this, as described below.

4.9.1 Create Waste Reduction Goals

The district should develop goals to reduce the waste stream and increase the waste diversion of readily recyclable and compostable materials. The goals should be based on the BOG Framework recommendation to progress toward zero waste in the landfill and reduce total material consumption by 10% by 2030. While these goals are very challenging, the district should strive to achieve them by implementing aggressive plans to minimize waste.

4.9.2 Maximize Programs Offered by Contracted Waste Hauler

As previously described, while Recology offers a three-bin service to its customers, it has not been implemented at Foothill or De Anza. Based on discussions with the City of Santa Clara, it does not appear that Specialty offers this program. The district should schedule meetings with its waste haulers to explore how the waste management, recycling and composting programs can be improved so that a source-separated program can be implemented.

4.9.3 Reduce Waste Stream to the Landfill

There are many strategies that the district should evaluate to reduce the waste stream to the landfill, including the following:

- As recommended in the BOG Framework, conduct a [Material Circularity Analysis](#) and implement end-of-life management strategies for waste.
- Raise awareness of waste reduction and the proper disposal of materials.
- Minimize unnecessary waste, such as reducing junk mail and faxes, eliminating printed documents when electronic documents will suffice, avoiding purchase of products with unnecessary packaging, and avoiding use of new edition textbooks in courses where the textbook content has changed very little.
- Reduce paper use by setting printers to print double-sided, sending electronic publications and announcements rather than printing paper copies, limiting class handouts by distributing handouts online, and encouraging the use of electronic and used textbooks as well as online homework and electronic testing.
- Minimize disposable items by encouraging the use of reusable items through incentives such as discounts for those who use reusable bags and coffee mugs and by discouraging the use of bottled water by providing adequate public drinking fountains and “hydration stations” with filtered water.
- Use recycled and locally sourced and manufactured materials.
- Implement source reduction programs in custodial practices.
- Purchase 100% recycled garbage bags for custodial and landscaping purposes.

4.9.4 *Improve Existing Recycling Programs*

Education is key to improvement of waste reduction and successful recycling. The best programs will have limited results if people do not understand how to use them or are not motivated to comply. The district should evaluate different strategies to improve recycling, as follows:

- Implement a source-separated program to reduce contamination of recyclables and compostables to increase waste diversion rates.
- Employ the educational, training and signage resources from Recology and agencies such as [Stopwaste.org](https://www.stopwaste.org) to help raise awareness and to educate students, faculty and staff on proper disposal practices.
- Consider sorting recyclables on-site to improve recycling rates.
- Encourage faculty, administration, staff and facilities operations to lead by example by properly disposing of trash, recyclables, organics, electronic waste and hazardous waste.
- Perform annual waste audits to track compliance and contamination and adjust programs for improved performance.
- Evaluate the number and placement of bins on campus, both indoor and outdoor, to maximize recycling.
- Educate students and staff by including information on the climate and health impacts of bottled water versus tap water.
- Address the [behavioral issues](#) associated with poor recycling practices to avoid contamination and placement of materials into the incorrect containers. The district should focus on this crucial human component and continue aggressively pursuing waste reduction and recycling efforts in all aspects of campus operations. The need to educate users on waste separation should be ongoing. A successful program may require modifications to waste containers and more informative signage to increase participation and reduce contamination.

4.9.5 *Collect and Sell or Donate Recyclable Material*

Recyclable material can be a source of revenue for the district. The sale of recyclable material can be used to fund other sustainability programs on campus. The district should explore options to implement flea markets or thrift shops selling recyclable items such as furniture, classroom projectors or computers. Other resources for [donating](#) recyclables should also be explored.

4.9.6 *Green Waste and Food Waste Composting*

Landfilling food and yard waste results in methane gas releases exacerbating climate change. The California Legislature passed [SB 1386, the Short-lived Climate Pollutants \(SLCP\) Organic Waste Reductions program](#) to implement statewide organic waste composting and surplus food recovery. This legislation became effective on January 1, 2022, and the district must comply with the program. Contract waste haulers are required to offer these services to their customers. The district should work to ensure that the SB 1383 requirements are fully met for all three campus sites.

4.9.7 *Construction and Demolition Recycling*

[Construction and demolition \(C&D\) recycling](#) is mandatory by state law and is managed by the municipality where

each campus is located. Common C&D materials include lumber, drywall, metals, masonry (brick, concrete, etc.), carpet, plastic, pipe, rocks, dirt, paper, cardboard or green waste related to land development. Many of these materials can be reused or recycled, thus prolonging the supply of natural resources, and potentially saving money in the process. Of these, metals are the most recycled material, while lumber makes up most debris that still goes to a landfill. According to the [2014 Disposal-Facility-Based Characterization of Solid Waste in California](#), construction and demolition materials account for between 21.7% to 25.5% of the disposal waste stream. Previous study estimates have ranged from 29% in 2008 to 24% in 2004. Construction contractors for new building and major renovation projects implement C&D recycling based on contract requirements by the district and ensure that debris is collected on-site and delivered to an approved C&D recycling facility. The district should continue this practice to reduce sending as much construction debris to the landfill as possible.

4.9.8 Conduct a Waste Category Assessment

As recommended by the BOG Framework, the district should conduct an annual [waste category assessment](#) to determine what makes up the waste stream for each college. Records examinations, facility walk-throughs and waste sorting are three common approaches to conducting a waste assessment. Benchmarking the actual waste stream provides a starting point for improvement.

4.10 SUSTAINABLE PROCUREMENT

The district should establish purchasing policies to meet the goals of environmental, economic, and social equity sustainability and use its market power to influence suppliers to be more sustainable. The district has developed several strategies for sustainable procurement, and the BOG Framework has established goals and targets to implement sustainability in procurement. The district should evaluate and implement programs as described below.



4.10.1 Develop Sustainable Purchasing Practices and Procedure

The district should develop and adopt a sustainable procurement policy and administrative procedure as recommended in the BOG Framework. The district should strive to increase procurement of sustainable products and services by 25% compared to benchmark levels by 2030 and 50% by 2035 to comply with BOG Framework goals. In addition, the district should strive to increase material circularity by 25% and decrease the consumption of materials by 25% by 2035.

Sustainable purchasing of products and materials should include such items as appliance and information technology hardware, cleaning and janitorial supplies, flooring, furniture, lighting, office supplies, water

appliances and fixtures, chemicals, packaging, plastic foam, recycled and recyclable materials, green construction materials, and low VOC carpet, paint and finishes. The district should evaluate guidance and best practices for sustainable procurement, such as the University of California [Sustainable Procurement Guidelines](#), to develop the procedure.

4.10.2 Evaluate and Implement Socially Responsible Purchasing

Socially responsible purchasing is the acquisition of goods and services that meet the needs of the district and colleges while also being environmentally friendly, socially responsible, and ethically sourced. As an example, Drexel University has developed a [Socially Responsible Purchasing Policy](#) that includes the following goals:

- Advocating for the inclusion of qualified diverse suppliers.
- Ensuring that diverse suppliers are considered in requests for proposals.
- Communicating our purchasing plans to local suppliers and organizations.
- Participating in local supplier fairs.
- Requiring our top suppliers to report their Tier 2 spend (dollars spent by these partners with diverse suppliers on behalf of Drexel).

The district should evaluate this and other models to develop a socially responsible purchasing policy as recommended by the BOG Framework.

4.11 STUDENT AND CURRICULUM DEVELOPMENT

The purpose of the California Community Colleges system is to educate students and foster their success by preparing them to be engaged members of society and to be ready for the careers of tomorrow. As economic, environmental and social sustainability becomes increasingly important in all facets of society, the California Community College system has a responsibility for moving the current and future generations toward a sustainable future.

Greening educational curriculum — using campuswide infrastructure as a pedagogical tool to inform students about systems thinking and develop a holistic view of education for sustainable development — is a priority in achieving this goal. By embedding social responsibility and sustainable development strategies into existing courses and encouraging new curricula with an environmental and sustainability focus, the community college system can play a crucial role in developing an environmentally sustainable future.

The district should strive to create opportunities for student involvement, so that on-campus sustainability initiatives are transparent, accessible, and have a visible focus. Through this process, students, faculty, staff and administrators would be able to work together to become effective agents for positive change.

4.11.1 Provide Professional Development and Create a Faculty Forum

Since much of the change in the curriculum will be driven by faculty, providing opportunities for professional growth for individual faculty members will increase the success of sustainability integration. Flex hours can be used to hold workshops on sustainability in the curriculum and start the discussion among faculty. In addition, forums and seminars could be held throughout the year for faculty to learn more about sustainability and to create

conversations and partnerships between departments to foster the development of sustainability in the curriculum. The district should also provide recognition for faculty that take leadership in integrating sustainability into the curriculum.

4.11.2 Highlight Climate Action and Sustainability in Various Venues

The BOG Framework recommends that districts highlight climate action and sustainability in various venues such as convocation, student orientation and professional development. ESAC should explore ways to introduce sustainability issues into these and other campus venues, which can serve student education and outreach to the larger community.

4.11.3 Establish Climate Change and Sustainability Education as an Immersive Experience



Another BOG Framework recommendation is for districts to explore partnerships that allow climate change and sustainability education to be an immersive experience for students, such as community-engaged learning and continued learning. Students could engage in immersive learning strategies through the use of campus landscapes, buildings and systems, food service, waste and recycling, energy, water and wastewater and other campus operations. The district should explore adopting [Campus as a Living Lab](#) initiatives to help test, accelerate and scale sustainability solutions as well as other immersive sustainability educational strategies.

4.11.4 Training Opportunities for Students

By engaging and recruiting students for participation in energy and sustainability projects, the district can provide a critical training opportunity. For example, students could assist in data gathering, analysis, project scoping, and following projects through design, installation, startup and commissioning. Students could augment their classroom learning with hands-on experience by applying what they have learned to the real world. Career pathways that lead to

good jobs in the emerging green economy should be supported, and students should be given opportunities to learn about those career pathways.

4.11.5 Curriculum Development

ESAC should reach out to the college academic senates to explore learning opportunities related to energy and sustainability activities for students. One option could be to invite a member of each college academic senate to participate in ESAC meetings and then report back to the full senate for consideration. This strategy and possibly others should be evaluated and will require leadership from the faculty for adoption.

4.11.6 Research True Economic, Social and Environmental Impacts of Energy and Sustainability Activities

Many energy efficiency and sustainability projects have some negative impacts that are often overlooked when making plans and decisions designed to improve sustainability. While these technologies' life cycle environmental benefits may outweigh the status quo fossil fuel energy system, the tradeoffs should be understood so informed decisions can be made.

The district should work to ensure energy and sustainability activities consider economic constraints, actual environmental and social impacts (including material, manufacturing, and disposal impacts), equipment maintenance considerations and lifecycle analysis. This should be an evaluated, quality control process, using data and information as a basis for decisions. Students should be engaged as a resource for research and reporting findings to ESAC and district administration.

4.12 CAMPUS AND COMMUNITY OUTREACH & AWARENESS

The sustainability of a college campus is highly dependent on individual members of the student body, faculty and staff. While having energy-efficient equipment, installing low-flow water devices, and providing separate bins for source separation of waste can make a district more sustainable, behavioral changes can significantly impact the effectiveness of these activities. Additionally, it is essential to maintain transparency and keep the campus and local community informed of the district's progress with sustainability planning and actions.

One of our priorities for the implementation of this plan will be to effectively communicate the goals and programs to the campus communities and to engage them in the process. This will involve strategies, such as those described below, and will be a focus of ESAC as the Sustainability Action Plan is rolled out.

4.12.1 Enhance ESAC Website

ESAC has established a website to communicate energy and sustainability planning and activities to students, faculty, staff, and the larger community. While the existing webpage fulfills the primary goals of communicating sustainability activities, ESAC should improve and enhance the site to provide a more detailed, comprehensive, and up-to-date picture of energy and sustainability programs and projects for all campus stakeholders. The website can serve as a publicity tool for sustainability events and student groups and as a coordination tool for conveying information to the local community. The website should be managed by the Energy and Sustainability Manager or a designated member of ESAC. It should be updated with the latest district and campus developments and provide links to any public reports about sustainability efforts described in Section 5 of the Sustainability Action Plan. The existing website can be found [here](#). ESAC should encourage the campuses to develop web sites that help students better access public transportation and other low carbon ways to get to campus; direct students to classes and careers in the emerging green economy, and help them understand what they can do to contribute to campus sustainability efforts.

4.12.2 Hold Workshops, Presentations, and Sustainability Events

ESAC should develop and conduct open workshops or presentations to allow campus and community members to stay informed about sustainability activities, ask questions, and participate in decisions. Workshops and

presentations should be well-publicized and open to all. They should be led by individuals who can knowledgeably field questions from the audience and effectively facilitate the workshop process. Events could include sustainability workshops, new student orientation on district sustainability programs, raising awareness and education on recycling practices, Earth Day workshops and presentations, and e-waste collection at events. Bulletin boards throughout the campuses could be used to advertise events and activities.

4.12.3 *Campus Specific Outreach and Awareness*

In addition to sustainability events, the district should implement other campus-focused outreach strategies designed to inform, engage and encourage participation in sustainability activities from the campus community. These could include:

- Post behavioral reminders to conserve energy and water, reduce and sort waste properly, turn off automobile engines to prevent idling, and encourage other sustainable habits.
- Develop new student orientation to introduce students to the district's sustainability plans, goals, and commitments. Encourage students to become active members of the college and community during their time as a student and beyond. A similar program should be developed for new employees so they can be educated in the district's sustainability culture.
- Establish a campus newspaper or newsletter to include articles about local and campus sustainability events and efforts. The Energy and Sustainability Manager or a member of ESAC should coordinate with the campus newspaper or newsletter to submit regular editorials or articles to keep the campus informed about ongoing efforts.



4.12.4 *Community Outreach and Partnerships*

As the BOG Framework recommends, the district should explore community partnerships to support and promote sustainability activities and programs, including partnerships with local municipalities, non-profits, and private philanthropic organizations. Other forms of community collaboration could include working with K-12 schools, community volunteers and service organizations. Community outreach should be an essential element of the Sustainability Action Plan.

4.12.5 *Inter-Campus Collaboration*

It is vitally important that both Foothill and De Anza cooperate and collaborate on energy and sustainability programs and activities to ensure the best possible chance that common district goals are achieved. Unfortunately, many multi-college districts operate in silos where each campus works independently on energy and sustainability, resulting in duplication of efforts, inefficient resource utilization, and little sharing of lessons learned and best practices. As a districtwide committee, ESAC should provide the opportunity for collaboration and allow a consistent approach for both campuses to meet their operational needs. The new Energy and Sustainability Manager will be a district position and can provide this coordination as well.

4.13 FOOD SYSTEMS

The district should be committed to providing sustainable food that considers producers, consumers, communities and the earth in its food services operations. The BOG Framework defines specific goals for sustainable food that the district should evaluate for implementation. The district should pursue the following initiatives to improve sustainability in food service.



4.13.1 Develop and Implement Sustainable Food Purchasing Goals and Programs

As recommended in the BOG Framework, the district should strive to increase sustainable food purchases to 20% of the total food budget by 2030 and to ensure 80% of the food served meets the Real Food Challenge goals or equivalent by 2035. The Real Food Challenge is an organization focused on students that has defined [real food](#) with standards encompassing the many distinct sectors that make up the food system. Students lead the charge to encourage colleges to commit to buying and serving more food that meets the Real Food Challenge's

values-based criteria with the intent of creating change in the food chain for farmers, workers, eaters and the planet. These efforts need to consider the health impacts, cultural appropriateness, and prices of food available to our students.

4.13.2 Require Food Service Organizations to Track Their Food Purchases by the Real Food Challenge Guidelines

Foothill College contracts with [Pacific Dining Services](#) for food service operations for the main cafeteria and with KJ's Café Espresso Bar for two café locations. [De Anza's](#) Dining Services is a not-for-profit, community college-managed auxiliary service. At the time of contract or agreement renewal for both services, the district should develop a food service request for proposal based on the Real Food Guidelines and negotiate and award a contract to the company that best meets the campus goals for sustainable food.

4.14 DIVERSITY, EQUITY, AND ENVIRONMENTAL JUSTICE

The California Community College system is committed to promoting diversity, equity, and environmental justice from the state Chancellor's Office to the individual districts and colleges. As the country's largest and most diverse higher education system, California community colleges have a tremendous opportunity to break down existing barriers to equity. By building a faculty and staff that look like the students and communities they work in and committing to diversity, equity, inclusion and accessibility ([DEIA](#)), the community college system can take a giant leap toward being an organization that works for all students. The state Chancellors' Office recognizes the importance of environmental justice in its sustainability policies, which should be addressed in the Sustainability

Action Plan as described below.

4.14.1 Create Connections Specific to Diversity, Equity, and Inclusion Efforts to District Sustainability Planning and Implementation

The district should embrace the connection between sustainability and equity in planning and implementing campus sustainability activities. As the BOG Framework recommends, this work should be consistent with the California Community Colleges [Vision for Success](#) and the diversity and equity programs articulated in vision.

4.14.2 Explore Changes to Local Policies and Procedures with the District Board of Trustees to Bolster Climate and Environmental Justice



Working in collaboration with the colleges' offices of equity, ESAC should explore changes to district policies and procedures to improve the connection between sustainability and diversity, equity, inclusion and accessibility. For those initiatives that require institutional and districtwide policy changes, ESAC should propose changes through the established participatory governance process to the Board of Trustees for review at a regularly scheduled meeting to allow public input and comment.

4.14.3 Educational Programs and Events Underscoring the Intersectional Relationship of Environment, Climate, and Social Equity Issues

The U.S. EPA defines [environmental justice](#) as the fair treatment and meaningful involvement of all people, regardless of race, color, national origin, or income, concerning the development, implementation, and enforcement of environmental laws, regulations and policies. This goal will be achieved when everyone enjoys:

- The same degree of protection from environmental and health hazards, and
- Equal decision-making access to a healthy environment to live, learn and work.

Environmental *injustice* is the intersection between social justice and environmentalism regarding the inequalities someone experiences in both categories. ESAC should work with students and faculty to develop programs and events underscoring the intersectional relationship between environment, climate and social equity issues. This is also a crucial goal of the BOG Framework.

4.14.4 Work With Each College Office of Equity to Integrate Sustainability Planning With Campus Equity Plans

Both Foothill and De Anza colleges have established offices of equity and have developed student equity plans. Foothill College's equity plan is available [here](#), and De Anza's plan can be viewed at [this link](#). ESAC should work with the offices of equity to integrate diversity, inclusion, and environmental justice into sustainability at the

campuses.

SECTION 5. MEASURE AND REPORT PERFORMANCE

As with any successful program, the ongoing progress and performance of Sustainability Action Plan activities should be monitored and compared to goals, objectives and criteria. This will require continuous participation of ESAC, the Energy and Sustainability Manager, college staff, and other participants. Sustainability Action Plan activities should be communicated regularly to the larger campus community to ensure transparency and accountability. The following section describes the recommended process for measuring and reporting sustainability activities and achievements.

5.1 MEASURING PERFORMANCE



To monitor the district's progress toward reaching its sustainability goals, ESAC should collect information on critical metrics associated with Sustainability Action Plan objectives at regular intervals. This will provide a benchmark for progress over time and identify when corrective action is needed to ensure success. Metrics should be performance based and reflect the outcomes of energy and sustainability projects, such as reduced GHG emissions or VMTs, rather than the number of projects implemented. However, a description of implemented projects should be included as part of an annual report to show the district's actions to meet the goals.

5.2 REPORTING PERFORMANCE

Measuring and reporting performance and progress is essential in maintaining transparency in energy and sustainability activities and assessing progress toward goals. The target audience of the reports should be the Board of Trustees, participatory governance committees, and the district community at large.

Progress reports should include the following information:

- Recap of SAP mission, goals, and objectives
- Summary of the district's performance compared to the goals and objectives
- Accomplishments
- Next steps and planned activities
- Key contributor acknowledgments and contact information

ESAC recommends that the reports be made annually. The details of the performance metrics and reporting protocols are described in Table 3.

Table 3 – Performance Measurement and Reporting Protocols

SAP Objective	Performance Metric	Measurement Frequency	Reporting Protocol	Responsibility
1	Investigate the most effective ways to institutionalize energy and sustainability management in district operations.	Annual	Annual report to participatory governance committees (PGC)/Board of Trustees (BOT) in November; Posted on ESAC website.	Energy and Sustainability Manager
2	Ensure activities consider broader economic and environmental impacts.	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager
3	District Carbon Reduction Goals <ul style="list-style-type: none"> Reduce Scope 1 and 2 GHG emissions by 50% from 2005 levels by 2030 Transition to natural gas-free by 2035 Purchased electricity will be 100% renewable by 2045 (SB 100) Carbon Neutrality by 2045 (EO B-55-18) 	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager
4	Strive to reduce GHG emissions by 75% by 2030.	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager
5	Strive to reduce GHG emissions by 100% by 2035.	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager
6	Strive to decrease EUI by 25% compared to the campus benchmark and annually produce or procure 75% of site electrical consumption using renewable energy by 2030.	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager
7	Strive to decrease EUI by 40% compared to the campus benchmark and accomplish Net Zero Energy Campus by 2030.	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager
8	Evaluate campus resiliency opportunities (PV, BES, microgrid).	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager

SAP Objective	Performance Metric	Measurement Frequency	Reporting Protocol	Responsibility
9	Strive for all new buildings and major renovations to be constructed as ZNE ready, to be LEED or WELL Platinum with a minimum LEED Silver (self-certified), and evaluate and strive for existing buildings to be LEED Operations and Maintenance (O&M) Gold or WELL Gold equivalent, and strive to reduce the use of natural gas in buildings by 100% by 2035.	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager
10	Investigate restorative and regenerative design principals for inclusion into district building standards by 2023.	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager
11	Reduce potable water consumption by 15% by 2022 compared to 2019 and monitor and comply with future county water usage restrictions.	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager
12	Strive to reduce potable water usage by 25% from the baseline level.	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager
13	Strive to reduce potable water usage from baseline level by 50% by 2035; limit stormwater runoff and discharge to predevelopment levels for temperature, rate, volume, and duration of flow by 2035.	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager
14	Deploy EV charging infrastructure consistent with California goals and timelines for electrification of transportation by 2025-2030.	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager
15	Reduce vehicle miles traveled (VMT) for students, faculty and staff by 25-50% by 2035 by coordinating with other ongoing district programs.	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager
16	Strive to have 50% of new fleet vehicles that are zero-emission vehicles and 50% of rolling stock that are zero emissions by 2030.	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager

SAP Objective	Performance Metric	Measurement Frequency	Reporting Protocol	Responsibility
17	Strive to have 100% of new fleet vehicles that are zero-emission vehicles and 100% of rolling stock that are zero emissions by 2035.	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager
18	Strive to achieve zero waste to landfill, and reduce total material consumption compared to the benchmark of 10% by 2030.	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager
19	Strive to increase material circularity by 25% and decrease consumption of materials by 25% by 2035.	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager
20	Increase procurement of sustainable products and services by 25% compared to benchmark levels by 2025.	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager
21	Strive to increase procurement of sustainable products and services by 50% compared to benchmark levels by 2035.	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager
22	Strive to increase district sustainable food purchases to 20% of the total food budget by 2030 and to have 80% of the food served on campus meeting the goals of the Real Food Challenge or equivalent by 2035.	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager
23	Consistent with the Vision for Success, the district will create connections between plans, projects, and committees (including those specific to diversity, equity, and inclusion efforts) and include them in the Sustainability Action Plan by 2025.	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager
24	Develop processes to engage students, faculty and staff in energy and sustainability activities in a meaningful way by 2023.	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager

SAP Objective	Performance Metric	Measurement Frequency	Reporting Protocol	Responsibility
25	Develop processes to communicate and engage students, faculty and staff in energy and sustainability activities in a meaningful way by 2023.	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager
26	Enhance campus and community education and engagement by 2023.	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager
27	Encourage and facilitate student learning activities related to sustainability and carbon reduction by 2023.	Annual	Annual report to PGC/BOT in November; Posted on ESAC website.	Energy and Sustainability Manager

SECTION 6. APPENDICES

APPENDIX A – District Proposition 39 Projects, 2013-2019

**APPENDIX B – 2021 California Community Colleges Board of Governors Climate Action
and Sustainability Framework**

APPENDIX C – Implementation Programs and Plans Checklist

APPENDIX D – Measure G Bond Energy-Saving Projects

APPENDIX E – 2021 Benchmarking Study Results

APPENDIX F – TOTEM White Paper

APPENDIX F – Glossary of Terms

PROPOSITION 39 PROJECTS

Attached is the listing of Proposition 39 projects completed from 2013-2019 at the district. This data was obtained through the California Energy Commission Proposition 39 searchable database.



Local Education Agency (LEA) Name:	Foothill-DeAnza Community College District
Site Name:	Foothill College
Address:	12345 El Monte Rd
City:	Los Altos Hills
Zip Code:	94022

Application Number: FOOTHI-1314-001

Estimated Annual Savings



0 (kWh)
Electric



0 (therms)
Natural Gas



\$0
Energy Cost

Estimated Prop. 39 Funds Allocated: \$100,000

Estimated Project Cost \$100,000

Energy Measures Installed:

- ASHRAE Level 2 Energy Audit



Local Education Agency (LEA) Name:	Foothill-DeAnza Community College District
Site Name:	Foothill College
Address:	12345 El Monte Rd
City:	Los Altos Hills
Zip Code:	94022

Application Number: FOOTHI-1314-007

Estimated Annual Savings



16,371 (kWh)
Electric



0 (therms)
Natural Gas



\$2,030
Energy Cost

Estimated Prop. 39 Funds Allocated: \$91,586

Estimated Project Cost \$104,592

Energy Measures Installed:

- B2500 Gym Lighting LEDs



Local Education Agency (LEA) Name:	Foothill-DeAnza Community College District
Site Name:	Foothill College
Address:	12345 El Monte Rd
City:	Los Altos Hills
Zip Code:	94022

Application Number: FOOTHI-1415-001

Estimated Annual Savings



112,614 (kWh)
Electric

+



1,916 (therms)
Natural Gas

+



\$15,344
Energy Cost

Estimated Prop. 39 Funds Allocated: \$327,945

Estimated Project Cost \$356,888

Energy Measures Installed:

- Foothill Library Boiler Replacement and Pump Upgrade with VFD
- B2600 Gym Lighting LEDs



Local Education Agency (LEA) Name:	Foothill-DeAnza Community College District
Site Name:	Foothill College
Address:	12345 El Monte Rd
City:	Los Altos Hills
Zip Code:	94022

Application Number: FOO THI-1516-001

Estimated Annual Savings



25,000 (kWh)
Electric



0 (therms)
Natural Gas



\$7,550
Energy Cost

Estimated Prop. 39 Funds Allocated: \$60,636

Estimated Project Cost \$66,636

Energy Measures Installed:

- Foothill B7400 MBCx



Local Education Agency (LEA) Name:	Foothill-DeAnza Community College District
Site Name:	DeAnza College
Address:	21250 Stevens Creek Blvd
City:	Cupertino
Zip Code:	95014

Application Number: FOOTHI-1314-001

Estimated Annual Savings



0 (kWh)
Electric



0 (therms)
Natural Gas



\$0
Energy Cost

Estimated Prop. 39 Funds Allocated: \$100,000

Estimated Project Cost \$100,000

Energy Measures Installed:

- ASHRAE Level 2 Energy Audit



Local Education Agency (LEA) Name:	Foothill-DeAnza Community College District
Site Name:	DeAnza College
Address:	21250 Stevens Creek Blvd
City:	Cupertino
Zip Code:	95014

Application Number: FOO THI-1314-005

Estimated Annual Savings



140,944 (kWh)
Electric

+



54,064 (therms)
Natural Gas

+



\$56,403
Energy Cost

Estimated Prop. 39 Funds Allocated: \$713,853

Estimated Project Cost \$770,000

Energy Measures Installed:

- HHW Pump VFD Retrofit, 2 x 15 hp
- Pool Boiler and Distribution Retrofit



Local Education Agency (LEA) Name:	Foothill-DeAnza Community College District
Site Name:	DeAnza College
Address:	21250 Stevens Creek Blvd
City:	Cupertino
Zip Code:	95014

Application Number: FOOTHI-1415-001

Estimated Annual Savings



63,061 (kWh)
Electric



13,778 (therms)
Natural Gas



\$17,305
Energy Cost

Estimated Prop. 39 Funds Allocated: \$32,609

Estimated Project Cost \$59,733

Energy Measures Installed:

- Library AHUs Premium Efficiency Motors
- De Anza Library AHU-2, 4, 9, 10 VAV Upgrade



Local Education Agency (LEA) Name:	Foothill-DeAnza Community College District
Site Name:	DeAnza College
Address:	21250 Stevens Creek Blvd
City:	Cupertino
Zip Code:	95014

Application Number: FOOTHI-1415-005

Estimated Annual Savings



42,736 (kWh)
Electric



0 (therms)
Natural Gas



\$5,128
Energy Cost

Estimated Prop. 39 Funds Allocated: \$405,001

Estimated Project Cost \$735,816

Energy Measures Installed:

- Science Building Chiller



Local Education Agency (LEA) Name:	Foothill-DeAnza Community College District
Site Name:	DeAnza College
Address:	21250 Stevens Creek Blvd
City:	Cupertino
Zip Code:	95014

Application Number: FOOTHI-1516-001

Estimated Annual Savings



18,000 (kWh)
Electric



8,000 (therms)
Natural Gas



\$9,812
Energy Cost

Estimated Prop. 39 Funds Allocated: \$280,206

Estimated Project Cost \$292,526

Energy Measures Installed:

- DeAnza Cogen MBCx
- DeAnza S-Quad MBCx

2021 CCC BOARD OF GOVERNORS CLIMATE ACTION AND SUSTAINABILITY FRAMEWORK

APPENDIX B

California Community Colleges Board of Governors Climate Action and Sustainability Framework

INTRODUCTION

In 2019, the California Community College Board of Governors (Board of Governors) adopted the Climate Change and Sustainability Policy. Building off this important work, the updated *Climate Action and Sustainability Framework* provides revised goals and recommendations for community college districts. This updated framework is more comprehensive and inclusive of all areas of the campus community. The *Climate Action and Sustainability Framework* aims to create environmental, social, and educational benefits for the communities we serve. The framework is designed to serve as a tool to prompt local discussion around ways California Community Colleges can leverage their expansive footprint by incorporating sustainability principles and climate science in their local practices.

The Board of Governors has been a bold proponent of climate action, energy conservation, and other sustainability measures and has had established policies since 2013. Over that time, the California Community Colleges Chancellor's Office has made minor policy adjustments until 2019, when the Chancellor's Office updated and the Board of Governors adopted the Climate Change and Sustainability Policy. The 2019 policy provided goals and guidance for community college districts to align with the key climate change strategy pillars, achieve energy conservation goals, build capital projects sustainably, and integrate physical plant management practices to reduce energy consumption to improve local environmental sustainability measures. Approaches have been consistent with state policy goals and efforts, including California legislation, California Code of regulations, and Gubernatorial Executive Orders that detail statewide energy conservation, greenhouse gas reduction, de-carbonization, sustainability, and climate change mitigation measures.

Climate change is one of the most pressing issues of our time. It requires our collective attention to explore actions and solutions that avoid the most catastrophic of modeled scenarios. Since 2019, the Board of Governors has charged community college districts with developing local climate action and sustainability resolutions. For this work and efforts to advance, it was important for a revised climate change and sustainability policy to reflect the needs of colleges and the perspective of a diverse set of stakeholders. As a result, Chancellor Oakley formed a Climate Action and Sustainability Steering Committee to help guide the Board of Governors policy and framework. The committee comprised volunteers from the ten community colleges, the Student Senate of California Community Colleges (SSCCC), the Chancellor's Office, and the Foundation for California Community Colleges. Specifically, the expertise of colleges representatives encompasses environmental science, sustainability, facilities management, academics, business operations. To date, the committee provides advice to the California Community Colleges Chancellor's Office and community colleges around climate crisis and sustainability policies and programs. Please see Appendix A for the list of steering committee members.

APPENDIX B

The steering committee has revised the 2019 Climate Change and Sustainability Policy under a new framework which establishes systemwide goals and targets. Further, the new framework integrates a comprehensive approach to leverage both colleges' physical and social impact footprint. Most importantly, this proposed revision compels bold action to protect our future.

CLIMATE ACTION AND SUSTAINABILITY FRAMEWORK

Examples of the impacts of climate change are abound. One heartbreaking illustration is California's fire season, which for the fifth year in a row has devastated entire communities and left lasting impacts for many California Community Colleges. The record-breaking losses of the past several years have also shown the increasing destruction of fire disasters, and have highlighted the need for longer-term strategies for climate emergency mitigation and resilience. We have our clarion call for action.

The 2019 Climate Change and Sustainability Policy was an important first step for community colleges to align with California's 2017 Climate Change Scoping Plan (as adopted by the California Air Resources Board in 2017). The new *Climate Action and Sustainability Framework* aims to inspire and empower institutions to act on bold climate commitments and to create innovative climate solutions. It also recognizes district-level progress is achieved at different stages. As such, the Framework first asks California's community colleges to establish benchmarks. Next, the *Climate Action and Sustainability Framework* asks districts and colleges to tracking progress towards the goals for 2025, 2030, and ultimately 2035, the target year for the state of California to reduce greenhouse gas emissions by 100% below the baseline.

RESOURCES AND TOOLS FOR CAMPUS SUSTAINABILITY

To support districts and colleges in striving for bold climate action and sustainability goals, the California Community Colleges Chancellor's Office will continue to develop key supports for districts and explore resources that enable progress towards these goals. Specifically, the Chancellor's Office is exploring and advancing the following focus areas:

- **Analysis of Climate Change Impacts.** In the face of compounding emergencies, it is critical to think about the long-term effects and impacts to California's community colleges. More importantly, it is our imperative to think about our future resiliency. A comprehensive analysis of the potential climate change and environmental risks facing each district can present the Chancellor's Office with strategies to prepare and respond.
- **Advocacy.** California Community Colleges can integrate within its advocacy agenda requests for resources focused on Climate Action and Sustainability, specifically as it related to facilities and scheduled maintenance.
- **Climate Action Data.** Explore the adoption of the Sustainability Tracking, Rating and Assessment System (STARS) as a tool for measuring campus sustainability progress for California community colleges to use. STARS is a self-reporting tool that measures sustainability performance.

APPENDIX B

- **Sustainability Toolkit.** Through the Facilities Planning Unit, create an online climate action and sustainability toolkit which include resources, templates, and promising practices to assist campuses in advancing climate action and sustainability efforts in areas such as facilities operations, design and construction, procurement, information technology, among other key services and supports.
- **District Goals.** Recommend each campus to submit to the Chancellor's Office measurable sustainability objectives, including:
 - District commitments to address climate and environmental justice in the communities they serve.
 - District carbon emissions baselines, carbon emissions inventories and local Climate Action Plans to reduce emissions by at least 75% by 2030.
 - District sustainability plans that meet or exceed the Climate Action and Sustainability Framework goals.

CLIMATE ACTION AND SUSTAINABILITY GOALS

Campuses physical footprint and facilities present an important asset districts can leverage to meet the Climate Action and Sustainability Framework goals. To help coordinate climate and sustainability activities, each California community college district is encouraged to designate a sustainability officer responsible for carrying out and/or coordinating its campus sustainability program efforts.

Greenhouse Gas Emissions Reduction

1. The California community colleges can conduct an emissions inventory baseline and create a climate action plan by 2025.
2. In alignment with statewide goals adopted by the California Air Resources Board (CARB), California Community Colleges can strive to eliminate greenhouse gas (GHG) emissions by 2035. To achieve this, it is recommended to reduce campus/district GHG emissions by at least 75% by 2030 and 100% by 2035 to align with the state's goals. Emissions will include both state and auxiliary organization purchases of electricity and natural gas; fleet and marine vessel usage; and other emissions over which the college or self-support entity has direct control.
3. Districts and colleges can track and report of their greenhouse gas inventory in alignment with the [American College and University President's Climate Commitment](https://secondnature.org/webinars/getting-started-on-your-acupcc-climate-action-plan-2/) (secondnature.org/webinars/getting-started-on-your-acupcc-climate-action-plan-2/) guidelines. Possible metrics to measure include GHG emissions per FTES.
4. The California community colleges are encouraged to promote the use of alternative transportation and/or alternative fuels to reduce GHG emissions related to college-associated transportation, including commuter and business travel.

As districts leaders develop new plans, important emphasis should be placed on designing new construction, remodeling, renovation, and repair projects with

APPENDIX B

consideration of optimum energy utilization, low life cycle operating costs, and compliance with all applicable energy codes (enhanced Title 24 energy codes) and regulations. In the areas of specialized construction that are not regulated through the current energy codes, such as historical buildings, museums, and auditoriums, the campuses should ensure these facilities are designed to consider energy efficiency and maximize resources to subsidize energy efficiency. Moving forward, energy efficient and sustainable design features in project plans encouraged.

The Chancellor's Office will monitor building sustainability/energy performance and maintain information on design best practices to support the energy efficiency goals and guidelines of this policy. The sustainability performance will be based on Leadership in Energy and Environmental Design (LEED) principles with consideration to the physical diversity across the campuses.

Green Buildings

- 1.** California community colleges are encouraged to benchmark their energy usage intensity for each building. Districts and colleges may develop a zero net energy (ZNE) and campus electrification strategy. They also have the option to conduct Leadership in Energy and Environmental Design (LEED) or WELL assessment of existing buildings.
- 2.** Districts and colleges are encouraged to strive for all new buildings and major renovations to be constructed as ZNE ready, all new buildings to be certified LEED or WELL Gold, and strive to reduce the use of natural gas in buildings by 30% by 2030.
- 3.** Districts and colleges are encouraged to strive for all new buildings and major renovations to be constructed as ZNE and certified Zero Carbon, all existing buildings to be LEED Operations and Maintenance (O&M) Gold or WELL Gold equivalent, and for the use of natural gas in buildings to be reduced by at least 75% by 2035.

Energy

- 1.** California's local community colleges should consider establish a campus Energy Use Intensity (EUI) score and conduct Effective Useful Life (EUL) analysis of all gas-using appliances and systems; plan for electrification of systems with EUL of less than 10 years.
- 2.** Districts and colleges should strive to decrease EUI by 25% compared to the campus benchmark and annually produce or procure 75% of site electrical consumption using renewable energy by 2030.
- 3.** Districts and colleges should strive to decrease EUI by 40% compared to the campus benchmark and accomplish Net Zero Energy Campus by 2035.

Water

- 1.** Districts and colleges should consider local benchmarks for potable water usage. Districts can also identify potential non-potable water resources, create a landscape zoning map and irrigation metering strategy and adopt best practices such as the

APPENDIX B

California Community College Model Stormwater Management Program. For more information on Municipal Separate Storm Sewer Systems, please visit the [California State Water Boards website](https://www.waterboards.ca.gov/water_issues/programs/stormwater/municipal.html) for requirements.
(https://www.waterboards.ca.gov/water_issues/programs/stormwater/municipal.html)

2. Districts and colleges are encouraged to reduce potable water usage by 25%. To achieve this goal, districts and colleges can ensure that landscape irrigation systems of 2500 square feet or greater are separately metered (unless using local or municipal reclaimed water system); ensure that landscape planting materials are 90% native species to the climate and geographical area of the college; ensure that irrigated turf grass does not exceed 50% of the landscaped areas on campus; and are recommended to follow Municipal Separate Storm Sewer Systems (MS4) requirements by 2030.
3. By 2035, California community colleges are encouraged to reduce potable water usage from baseline level by 50%; limit stormwater runoff and discharge to predevelopment levels for temperature, rate, volume and duration of flow through the use of green infrastructure and low impact development for the campus; and limit stormwater runoff and discharge to predevelopment levels for temperature, rate, volume and duration of flow through the use of green infrastructure and low impact development for new buildings and major modifications.

Waste

1. Districts and colleges are encouraged to conduct a waste categorization assessment; benchmark and comply with [Title 14, Division 2, Chapter 5](http://www.calrecycle.ca.gov/Laws/Regulations/Title14/#Div2Chap5) (www.calrecycle.ca.gov/Laws/Regulations/Title14/#Div2Chap5) (Beverage Container Recycling and Litter Reduction Act); benchmark and comply with [Title 14, CCR Division 7](http://www.calrecycle.ca.gov/Laws/Regulations/Title14/#Div7) (www.calrecycle.ca.gov/Laws/Regulations/Title14/#Div7); develop a total material consumption benchmark; conduct an [AB 341](http://leginfo.legislature.ca.gov/faces/billNavClient.xhtml?bill_id=201120120AB341) (leginfo.legislature.ca.gov/faces/billNavClient.xhtml?bill_id=201120120AB341) compliance assessment; and centralize reporting for waste and resource recovery by 2025.
2. Districts and colleges should strive to achieve zero waste to landfill, conduct a circularity analysis, and reduce total material consumption compared to the benchmark by 10% by 2030.
3. Districts and colleges are encouraged to strive to increase material circularity by 25%, and decrease consumption of materials by 25% by 2035.

Purchasing and Procurement

1. California's local community colleges are encouraged to benchmark sustainability characteristics of existing products and services, adopt a sustainable procurement policy and administrative procedure, and purchase environmentally preferable electronic products by 2025.

APPENDIX B

2. Districts and colleges should strive to increase procurement of sustainable products and services by 25% compared to benchmark levels by 2030.
3. Districts and colleges should strive to increase procurement of sustainable products and services by 50% compared to benchmark levels by 2035.

In order for the California community colleges to reach these goals, campuses can promote use of suppliers and/or vendors who reduce waste, re-purpose recycled material, or support other environmentally friendly practices in the provision of goods or services to the colleges under contract. This may include additional evaluation points in solicitation evaluations for suppliers integrating sustainable practices.

In order to move to zero waste, campus practices can: (1) encourage use of products that minimize the volume of trash sent to landfills or incinerators; (2) participate in the CalRecycle Buy-Recycled program or equivalent; and (3) increase recycled content purchases in all Buy- Recycled program product categories.

Districts and colleges should strive to continue to report on all recycled content product categories, consistent with [PCC § 12153-12217](#) (leginfo.legislature.ca.gov/faces/codes_displaySection.xhtml?sectionNum=12153.&nodeTreePath=3.2.12.1&lawCode=PCC) and shall implement improved tracking and reporting procedures for their recycled content purchases.

Transportation

1. The California community colleges can conduct accounting and conditions assessment of fleet vehicles; assess remainder rolling stock for potential electrification; develop Electric Vehicle (EV) charging infrastructure to encourage faculty, staff and students to use EVs; promote accessible shared transport methods; and make pedestrian and bicycle access improvements by 2025.
2. Districts and colleges should strive to have 50% of new fleet vehicles that are zero emission vehicles, 50% of rolling stock that are zero emissions, and can consider implementing green parking permits by 2030.
3. Districts and colleges should strive to have 100% of new fleet vehicles that are zero emission vehicles, and 100% of rolling stock that are zero emissions by 2035.

Food Systems

1. Districts and colleges should strive to have campus food service organizations track their sustainable food purchases. Such tracking and reporting can be grounded in the [Real Food Challenge](http://www.realfoodchallenge.org/resources/real-food-resources/) (www.realfoodchallenge.org/resources/real-food-resources/) guidelines, or equivalent, with consideration to campus-requested improvements.
2. Campuses are encouraged to strive to increase their sustainable food purchases to 20% of total food budget by 2030, and to have 80% of food served on campus meeting the goals of the Real Food Challenge or equivalent by 2035.

APPENDIX B

LOOKING TO THE FUTURE

Consideration for Advancing the Climate Action and Sustainability Framework

Considerations for the Future

As climate change remains an increasing threat to Californians' health, safety, and economic well-being—wildfires, and widespread drought throughout the State being some of the most recent reminders of the changing environment's impact on our community – it's important to consider the impact California Community Colleges can make if they look beyond just their facilities footprint and leverage the role they play in increasing knowledge and education about the challenges we face. The following section invites our broader academic community to consider ways they can support the advancement of the Climate Action and Sustainability Framework.

Building Alignment to Campus Operations and Teaching & Learning

Environmental Justice: Aligning to Diversity, Equity, and Inclusion Strategy

1. Consistent with the *Vision for Success*, the California Community Colleges can create connections between plans, projects and committees (including those specific to Diversity, Equity, and Inclusion efforts) and the Climate Action and Sustainability Plan.
2. Districts and colleges can explore how to improve connections between environmental and social justice initiatives and program on campus and foster a more diverse and inclusive engagement in climate action and sustainability initiatives. In addition, the campuses can measure engagement of diverse audiences in climate action and sustainability initiatives to assess equitable participation.
3. Districts and colleges can explore changes their local policies and administrative procedures with their elected board to bolster climate/environmental justice efforts.
4. Districts and colleges can develop educational programs or hold annual event underscoring the intersectional relationship of environment, climate and social equity issues.

Planning and Administration: Coordination and Planning

1. The California Community Colleges can form sustainability committee or offices to advise and implement sustainability initiatives on campus. The campuses can publish a plan that includes measurable sustainability objectives and/or include the integrated concept of sustainability in the institution's master plan.
2. Districts and colleges can update their local plan and complete peer or independent STARS Reporting Assurance.

Advancing Climate Action Education & Engagement

1. Identify and develop community partnerships, including private philanthropy, to support and promote sustainability activities and programs.

APPENDIX B

- 2.** Districts and colleges can consider developing an inventory of courses focused on climate change, sustainability and action to engage current and future students. This can also encourage collaboration and for interdisciplinary pathways.
- 3.** Districts and colleges can explore partnership which allow climate change and sustainability education to be an immersive experience for students such as community engaged learning, continued learning, and campus as a living lab initiatives.
- 4.** California's community colleges can highlight climate action and sustainability in various venues such as convocation, student orientation, professional development.

APPENDIX B

APPENDIX A: STEERING COMMITTEE MEMBERS

- 1.** Karen Groppi, Instructor, Engineering Department, Environmental Sustainability Specialist, Cabrillo College
- 2.** Farrah Farzaneh, Director of Facilities Planning and Construction, San Bernardino CCD
- 3.** Joseph Fullerton, Energy and Sustainability Manager, San Mateo County CCD
- 4.** Aris Hovasapian, Utility Program Manager, LACCD
- 5.** Ferris Kwar, Sustainability Project Manager, Santa Monica College
- 6.** Jennifer Keiper, Foundation for California Community Colleges
- 7.** Owen Letcher, Vice Chancellor of Facilities and Bond Program, Chabot-Las Positas CCD
- 8.** Nat Martin, Director of Sustainability, Los Rios CCD
- 9.** Hoang Nguyen, Director of Facilities Planning and Utilization, California Community Colleges Chancellor's Office
- 10.** Don Reid, Supervisor, American River College
- 11.** Sophia Ruiz, Student Senate for California Community Colleges, Mt. San Antonio College (graduated)
- 12.** Brian Turner, Program Assistant II, California Community Colleges Chancellor's Office
- 13.** Chay Yang, Specialist, California Community Colleges Chancellor's Office
- 14.** John White, Executive Director of Bond Program and Facilities Planning, College of the Desert

IMPLEMENTATION PROGRAMS AND PLANS CHECKLIST

A hard copy of the Implementation Programs and Plans Checklist is attached for reference. The electronic copy saved on the ESAC server should be used for managing Sustainability Action Plan implementation.

APPENDIX C

Sustainability Action Plan Summary Implementation Programs and Projects Checklist

District: Foothill-De Anza Community College District
Campus: District-wide
Project: Sustainability Action Plan
Date: Version 3 - August 2022


[Click Here to go to **Output Tab**](#)

Plan Section	Sustainability Action Plan Section Description	# of Programs Selected	# of Programs In-Progress	# of Selected Programs Completed
4.1	Management and Organizational Structure	9	4	2
4.2	Carbon Reduction Programs	3	2	0
4.3	Energy Efficiency	9	0	0
4.4	Facilities Operation	9	3	0
4.5	Sustainable Building Practices	7	1	0
4.6	On-Site Generation and Renewable Energy	3	0	0
4.7	Transportation, Commuting, and Campus Fleet & Travel	7	4	0
4.8	Water, Wastewater, and Sustainable Landscaping	4	0	0
4.9	Solid Waste Reduction and Recycling	8	4	0
4.10	Sustainable Procurement	2	0	0
4.11	Student and Curriculum Development	6	2	0
4.12	Campus and Community Outreach and Awareness	5	1	0
4.13	Food Systems	2	0	0
4.14	Diversity, Equity and Environmental Justice	4	1	0
Totals		78	22	2

APPENDIX C

Sustainability Programs Chart

District: Foothill-De Anza Community College District
Campus: District-wide
Project: Sustainability Action Plan
Date: Version 3 - August 2022

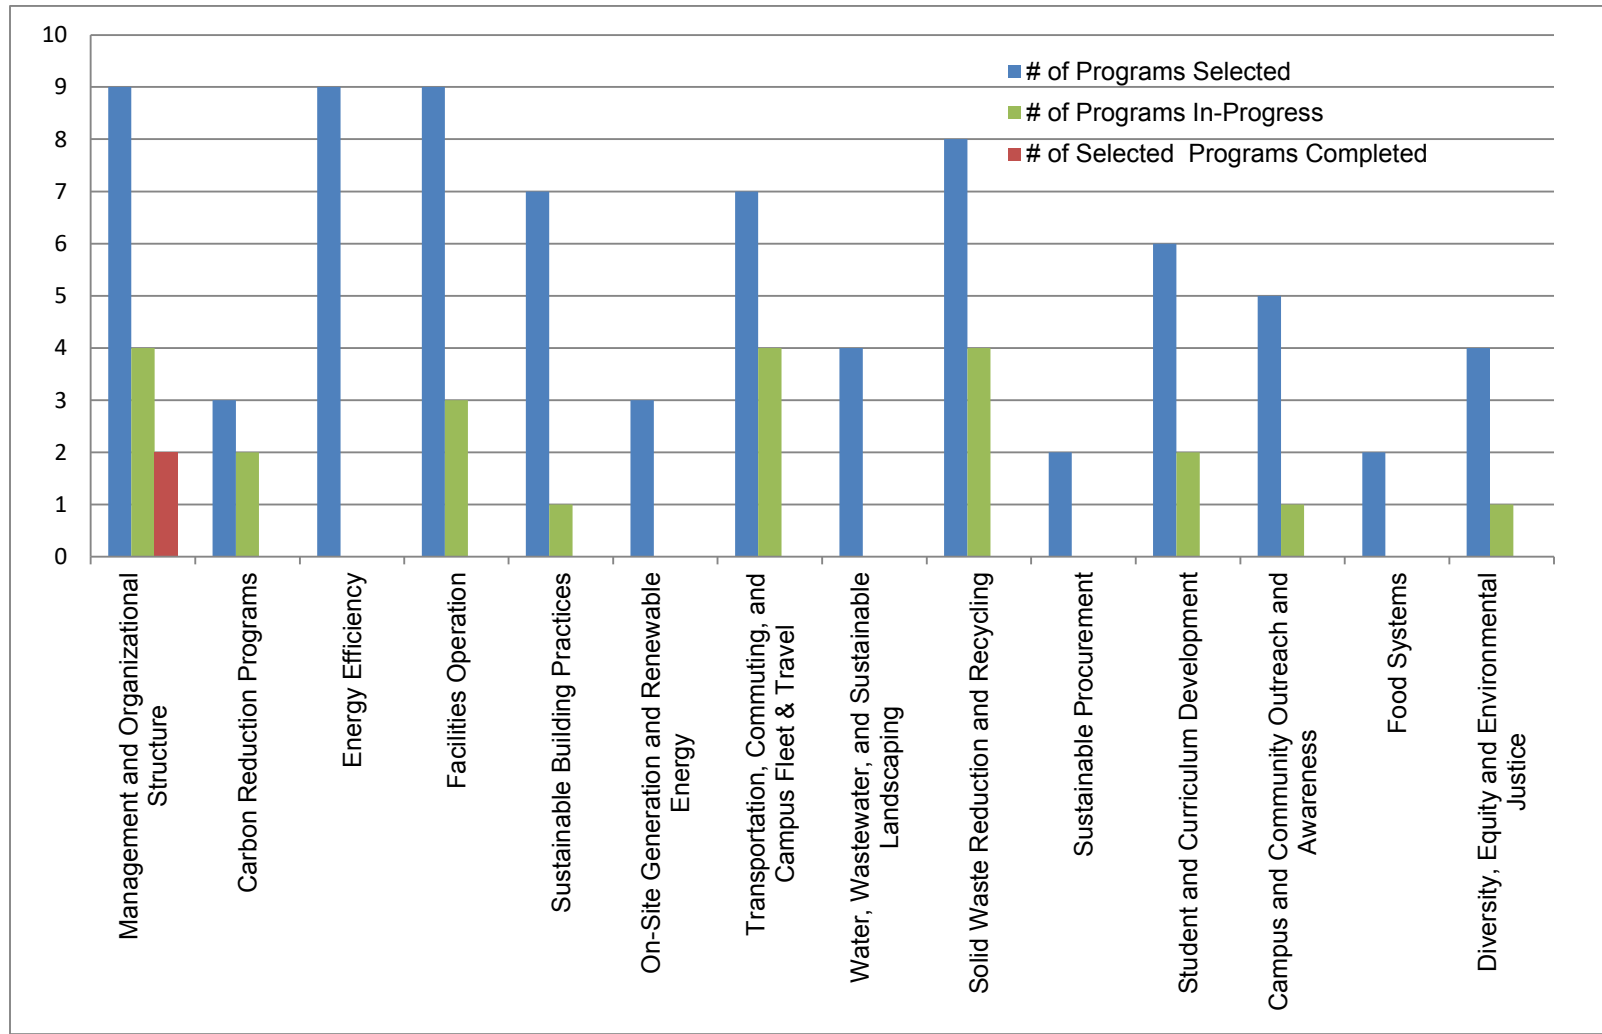

APPENDIX C

Sustainability Action Plan Implementation Programs and Projects Checklist

District: Foothill-De Anza Community College District
Campus: District-wide
Project: Sustainability Action Plan
Date: Version 3 - August 2022

Selected Programs and Projects for Implementation are Summarized Below			
Section 4.1 MANAGEMENT AND ORGANIZATIONAL STRUCTURE			Comments
<input checked="" type="checkbox"/>	4.1.1	Adopt a District Sustainability Policy	FROM EMP
<input checked="" type="checkbox"/>	4.1.2	Appoint a Sustainability Coordinator, Establish an Office of Sustainability	FROM EMP
<input checked="" type="checkbox"/>	4.1.3	Appoint a District Sustainability Committee	FROM EMP
<input checked="" type="checkbox"/>	4.1.4	Explore Funding and Resources to Support Sustainability Activities	FROM EMP
<input checked="" type="checkbox"/>	4.1.5	Employ Sustainability Professionals, as required	FROM EMP
<input checked="" type="checkbox"/>	4.1.6	Evaluate Track and Report Sustainability Performance using the AASHE Sustainability Tracking, Assessment & Rating System (STARS) system and report results to the Board of Trustees.	BOG POLICY
<input checked="" type="checkbox"/>	4.1.7	Integrate Sustainability Planning into Educational and Facilities Campus Master Plans	
<input checked="" type="checkbox"/>	4.1.8	Investigate most effective ways to institutionalize Energy and Sustainability Management	FROM EMP
<input checked="" type="checkbox"/>	4.1.9	Participate in CCC System-wide energy and Sustainability Committees	FROM EMP

APPENDIX C

Sustainability Action Plan Implementation Programs and Projects Checklist

District: Foothill-De Anza Community College District
Campus: District-wide
Project: Sustainability Action Plan
Date: Version 3 - August 2022

Selected Programs and Projects for Implementation are Summarized Below			
Section 4.2 CARBON REDUCTION PROGRAMS			Comments
<input checked="" type="checkbox"/>	4.2.1	Implement Measure G Bond Projects	FROM EMP. See "FHDA Bond Project List FINAL 052021"
<input checked="" type="checkbox"/>	4.2.2	Perform Feasibility Study for District Electrification.	FROM EMP
<input checked="" type="checkbox"/>	4.2.3	Develop an Energy Data Foundation to prepare for usage analysis at all three campuses to support GHG reduction goals.	FROM EMP

APPENDIX C

Sustainability Action Plan Implementation Programs and Projects Checklist

District: Foothill-De Anza Community College District
Campus: District-wide
Project: Sustainability Action Plan
Date: Version 3 - August 2022

Selected Programs and Projects for Implementation are Summarized Below			
Section 4.3 ENERGY EFFICIENCY			Comments
<input checked="" type="checkbox"/>	4.3.1	Set Energy Efficiency Goals	FROM EMP
<input checked="" type="checkbox"/>	4.3.2	Evaluate Mechanisms for the Implementation of Energy Efficiency Projects	FROM EMP
<input checked="" type="checkbox"/>	4.3.3	Conduct Facility Prioritization Survey	FROM EMP
<input checked="" type="checkbox"/>	4.3.4	Conduct Comprehensive Facility Energy Audits	FROM EMP
<input checked="" type="checkbox"/>	4.3.5	Implement New and Existing Audit Recommendations	FROM EMP
<input checked="" type="checkbox"/>	4.3.6	Participate in Demand Response Programs	FROM EMP
<input checked="" type="checkbox"/>	4.3.7	Install Energy Efficient Equipment	FROM EMP
<input checked="" type="checkbox"/>	4.3.8	Manage Plug Loads	FROM EMP
<input checked="" type="checkbox"/>	4.3.9	Evaluate and apply Best Practices Energy Efficiency Measures	CCC Sustainability Template

APPENDIX C

Sustainability Action Plan Implementation Programs and Projects Checklist

District: Foothill-De Anza Community College District
Campus: District-wide
Project: Sustainability Action Plan
Date: Version 3 - August 2022

Selected Programs and Projects for Implementation are Summarized Below			
Section 4.4 FACILITIES OPERATION			Comments
<input checked="" type="checkbox"/>	4.4.1	Encourage and Support Energy Efficiency Training of Staff	FROM EMP
<input checked="" type="checkbox"/>	4.4.2	Upgrade Building and Energy Management Systems	FROM EMP
<input checked="" type="checkbox"/>	4.4.3	Adjust Temperature Set Points and Schedule Operating Times	FROM EMP
<input checked="" type="checkbox"/>	4.4.4	Evaluate Opportunities to Optimize Building Occupancy Scheduling	FROM EMP
<input checked="" type="checkbox"/>	4.4.5	Optimize HVAC Equipment Scheduling	FROM EMP
<input checked="" type="checkbox"/>	4.4.6	Install Meters and Benchmark at the Building and System Level.	FROM EMP
<input checked="" type="checkbox"/>	4.4.7	Pursue Monitoring-Based (MBCx)/Retro-Commissioning (RCx)	FROM EMP
<input checked="" type="checkbox"/>	4.4.8	Perform Regular Maintenance on Equipment	FROM EMP
<input checked="" type="checkbox"/>	4.4.9	Prepare Climate Adaptation and Resiliency Plan	FROM EMP

APPENDIX C

Sustainability Action Plan Implementation Programs and Projects Checklist

District: Foothill-De Anza Community College District
Campus: District-wide
Project: Sustainability Action Plan
Date: Version 3 - August 2022

Selected Programs and Projects for Implementation are Summarized Below			
Section 4.5 SUSTAINABLE BUILDING PRACTICES			Comments
<input checked="" type="checkbox"/>	4.5.1	Establish a Green Building Standard	FROM EMP
<input checked="" type="checkbox"/>	4.5.2	Implement Sustainable Design Practices	FROM EMP
<input checked="" type="checkbox"/>	4.5.3	Use an Integrated Systems Approach in Building Design	FROM EMP
<input checked="" type="checkbox"/>	4.5.4	Hire Sustainable Building Design Professionals	FROM EMP
<input checked="" type="checkbox"/>	4.5.5	Commission New Buildings	FROM EMP
<input checked="" type="checkbox"/>	4.5.6	Develop Regenerative Design and Nature Positive Principles	FROM ADOPTED OBJECTIVES
<input checked="" type="checkbox"/>	4.5.7	Set Net-Positive Goals and Plans	FROM ADOPTED OBJECTIVES

APPENDIX C

Sustainability Action Plan Implementation Programs and Projects Checklist

District: Foothill-De Anza Community College District
Campus: District-wide
Project: Sustainability Action Plan
Date: Version 3 - August 2022

Selected Programs and Projects for Implementation are Summarized Below			
Section 4.6 ON-SITE GENERATION AND RENEWABLE ENERGY			Comments
<input checked="" type="checkbox"/>	4.6.1	Evaluate Load Shifting Technologies	FROM EMP
<input checked="" type="checkbox"/>	4.6.2	Minimize Greenhouse Gas Intensity of Purchased Electricity	FROM EMP
<input checked="" type="checkbox"/>	4.6.3	Perform Feasibility Study for additional Solar PV at Campuses	FROM EMP

APPENDIX C

Sustainability Action Plan Implementation Programs and Projects Checklist

District: Foothill-De Anza Community College District
Campus: District-wide
Project: Sustainability Action Plan
Date: Version 3 - August 2022

Selected Programs and Projects for Implementation are Summarized Below			
Section 4.7 TRANSPORTATION, COMMUTING, AND CAMPUS FLEET & TRAVEL			Comments
<input checked="" type="checkbox"/>	4.7.1	Participate in District transportation surveys and analysis	From EMP
<input checked="" type="checkbox"/>	4.7.2	Encourage and Enhance Public Transportation and Ridesharing Options	FROM OBJECTIVES
<input checked="" type="checkbox"/>	4.7.3	Encourage and Enhance Bicycling Options	FROM OBJECTIVES
<input checked="" type="checkbox"/>	4.7.4	Improve Campus Fleet & Travel	FROM OBJECTIVES BOG policy
<input checked="" type="checkbox"/>	4.7.5	Explore Student Distance Learning and Employee Remote Work	
<input checked="" type="checkbox"/>	4.7.6	Analyze and Install Electric Vehicle (EV) Charging using on-site Solar PV Electricity. Include analysis of fast-charging autonomous vehicles	FROM EMP
<input checked="" type="checkbox"/>	4.7.7	Implement a Green Parking Permit program by 2030	BOG Policy

APPENDIX C

Sustainability Action Plan Implementation Programs and Projects Checklist

District: Foothill-De Anza Community College District
Campus: District-wide
Project: Sustainability Action Plan
Date: Version 3 - August 2022

Selected Programs and Projects for Implementation are Summarized Below			
Section 4.8 WATER, WASTEWATER, AND SUSTAINABLE LANDSCAPING			Comments
<input checked="" type="checkbox"/>	4.8.1	Establish Water Conservation Goals	FROM OBJECTIVES
<input checked="" type="checkbox"/>	4.8.2	Implement Water Conservation Strategies	FROM OBJECTIVES
<input checked="" type="checkbox"/>	4.8.3	Reduce Storm Water, Sewer Discharges, and Water Pollution	FROM OBJECTIVES
<input checked="" type="checkbox"/>	4.8.4	Adopt Sustainable Landscaping Practices	FROM OBJECTIVES
<input type="checkbox"/>	4.8.5	<i>Enter Other Program and Project 2, text will change color</i>	

APPENDIX C

Sustainability Action Plan Implementation Programs and Projects Checklist

District: Foothill-De Anza Community College District
Campus: District-wide
Project: Sustainability Action Plan
Date: Version 3 - August 2022

Selected Programs and Projects for Implementation are Summarized Below			
Section 4.9 SOLID WASTE REDUCTION AND RECYCLING			Comments
<input checked="" type="checkbox"/>	4.9.1	Create Waste Reduction Goals	FROM OBJECTIVES
<input checked="" type="checkbox"/>	4.9.2	Maximize Programs Offered by Contracted Waste Hauler	CCC Sustainability Template
<input checked="" type="checkbox"/>	4.9.3	Reduce Waste Stream to the Landfill	FROM OBJECTIVES
<input checked="" type="checkbox"/>	4.9.4	Improve Existing Recycling Programs	CCC Sustainability Template
<input checked="" type="checkbox"/>	4.9.5	Collect and Sell All Recyclable Material	CCC Sustainability Template
<input checked="" type="checkbox"/>	4.9.6	Green Waste and Food Waste Composting	Required by State Law
<input checked="" type="checkbox"/>	4.9.7	Construction and Demolition (C&D) Recycling	FROM OBJECTIVES. Required by state law.
<input checked="" type="checkbox"/>	4.9.8	Conduct a Waste Category Assessment	BOG Policy

APPENDIX C

Sustainability Action Plan Implementation Programs and Projects Checklist

District: Foothill-De Anza Community College District
Campus: District-wide
Project: Sustainability Action Plan
Date: Version 3 - August 2022

Selected Programs and Projects for Implementation are Summarized Below			
Section 4.10 SUSTAINABLE PROCUREMENT			Comments
<input checked="" type="checkbox"/>	4.10.1	Develop Sustainable Purchasing Practices and Procedure	FROM OBJECTIVES.
<input checked="" type="checkbox"/>	4.10.2	Evaluate and Implement Socially Responsible Purchasing	FROM OBJECTIVES
<input type="checkbox"/>	4.10.4	<i>Enter Other Program and Project 1, text will change color</i>	
<input type="checkbox"/>	4.10.5	<i>Enter Other Program and Project 2, text will change color</i>	

APPENDIX C

Sustainability Action Plan Implementation Programs and Projects Checklist

District: Foothill-De Anza Community College District
Campus: District-wide
Project: Sustainability Action Plan
Date: Version 3 - August 2022

Selected Programs and Projects for Implementation are Summarized Below			
Section 4.11 STUDENT AND CURRICULUM DEVELOPMENT			Comments
<input checked="" type="checkbox"/>	4.11.1	Provide Professional Development and Create a Faculty Forum	CCC Sustainability Template
<input checked="" type="checkbox"/>	4.11.2	Highlight climate action and sustainability in various venues such as convocation, student orientation, and professional development	BOG Policy
<input checked="" type="checkbox"/>	4.11.3	Establish Climate Change and Sustainability Education as an Immersive Experience	BOG Policy
<input checked="" type="checkbox"/>	4.11.4	Training Opportunities for Students	FROM EMP
<input checked="" type="checkbox"/>	4.11.5	Curriculum Development	CCC Sustainability Template
<input checked="" type="checkbox"/>	4.11.6	Research true economic, social, and environmental impacts of energy and sustainability projects. Include students in this program.	FROM EMP

APPENDIX C

Sustainability Action Plan Implementation Programs and Projects Checklist

District: Foothill-De Anza Community College District
Campus: District-wide
Project: Sustainability Action Plan
Date: Version 3 - August 2022

Selected Programs and Projects for Implementation are Summarized Below			
Section 4.12 CAMPUS AND COMMUNITY OUTREACH & AWARENESS			Comments
<input checked="" type="checkbox"/>	4.12.1	Enhance ESAC Website	FROM EMP
<input checked="" type="checkbox"/>	4.12.2	Hold Workshops, Presentations, and Sustainability Events	CCC Sustainability Template
<input checked="" type="checkbox"/>	4.12.3	Campus Specific Outreach & Awareness	CCC Sustainability Template
<input checked="" type="checkbox"/>	4.12.4	Community Outreach and Partnerships	CCC Sustainability Template
<input checked="" type="checkbox"/>	4.12.5	Inter-Campus Collaboration	FROM EMP

APPENDIX C

Sustainability Action Plan Implementation Programs and Projects Checklist

District: Foothill-De Anza Community College District
Campus: District-wide
Project: Sustainability Action Plan
Date: Version 3 - August 2022

Selected Programs and Projects for Implementation are Summarized Below			
Section 4.13 FOOD SYSTEMS			Comments
<input checked="" type="checkbox"/>	4.13.1	Develop and Implement Sustainable Food Purchasing Goals and Programs	FROM OBJECTIVES BOG Policy
<input checked="" type="checkbox"/>	4.13.2	Require food service organizations to track their sustainable food purchases in accordance with Real Food Challenge guidelines.	BOG Policy
<input type="checkbox"/>	7.12.9.1	<i>Enter Other Program and Project 1, text will change color</i>	
<input type="checkbox"/>	7.12.9.2	<i>Enter Other Program and Project 2, text will change color</i>	

APPENDIX C

Sustainability Action Plan Implementation Programs and Projects Checklist

District: Foothill-De Anza Community College District
Campus: District-wide
Project: Sustainability Action Plan
Date: Version 3 - August 2022

Selected Programs and Projects for Implementation are Summarized Below		
Section 4.14 DIVERSITY, EQUITY, AND ENVIRONMENTAL JUSTICE	Comments	
<input checked="" type="checkbox"/>	4.14.1	Create connections specific to Diversity, Equity, and Inclusion efforts to FROM OBJECTIVES (BOG policy) District Sustainability Planning and Implementation.
<input checked="" type="checkbox"/>	4.14.2	Explore changes to local policies and procedures with the Board of Trustees to bolster climate and environmental justice BOG Policy
<input checked="" type="checkbox"/>	4.14.3	Develop educational programs and events underscoring the intersectional relationship of environment, climate, and social equity issues. BOG Policy
<input checked="" type="checkbox"/>	4.14.4	Work with each college Office of Equity to integrate sustainability planning with campus Equity Plans FROM OBJECTIVES
<input type="checkbox"/>	4.14.5	<i>Enter Other Program and Project 1, text will change color</i>
<input type="checkbox"/>	4.14.6	<i>Enter Other Program and Project 2, text will change color</i>

APPENDIX C

Sustainability Template Plan Implementation Programs and Plans Checklist

District: Foothill-De Anza Community College District
Campus: District-wide
Project: Sustainability Action Plan
Date: Version 3 - August 2022

Priority Implementation Plans Indicated Below

Section 4.1 MANAGEMENT AND ORGANIZATIONAL STRUCTURE						
Section	Selected Program or Project	Priority (select)	Status (select)	Associated OBJECTIVE	Target Completion Date	Assigned To
4.1.1	Adopt a District Sustainability Policy	High	Complete	1	Complete	ESAC
4.1.2	Appoint a Sustainability Coordinator, Establish an Office of Sustainability	High	In-Process	1	2022	Administration
4.1.3	Appoint a District Sustainability Committee	High	Complete	1	Complete	
4.1.4	Explore Funding and Resources to Support Sustainability Activities	High	Planned	1	Ongoing	Energy and Sustainability Manager
4.1.5	Employ Sustainability Professionals, as required	High	In-Process	1	Ongoing	Administration
4.1.6	Evaluate Track and Report Sustainability Performance using the AASHE Sustainability Tracking, Assessment & Rating System (STARS) system and report results to the Board of Trustees.	Med	Planned	1	2023	Energy and Sustainability Manager
4.1.7	Integrate Sustainability Planning into Educational and Facilities Campus Master Plans	Med	Planned	1	2024	Administration
4.1.8	Investigate most effective ways to institutionalize Energy and Sustainability Management	Med	In-Process	1	2022-2025	Energy and Sustainability Manager
4.1.9	Participate in CCC System-wide energy and Sustainability Committees	Med	In-Process	1	2022-2025	Energy and Sustainability Manager

Section 4.2 CARBON REDUCTION PROGRAMS						
Section	Selected Program or Project	Priority (select)	Status (select)	Associated OBJECTIVE	Target Completion Date	Assigned To
4.2.1	Implement Measure G Bond Projects	High	In-Process	4 thru 7	Bond Schedule	Bond Program/Facilities/Energy and Sustainability Manager
4.2.2	Perform Feasibility Study for District Electrification.	High	Planned	4 thru 7	2022	Facilities
4.2.3	Develop an Energy Data Foundation to prepare for usage analysis at all three campuses to support GHG reduction	High	In-Process	4 thru 7	2022	Energy and Sustainability Manager

APPENDIX C

Sustainability Template Plan Implementation Programs and Plans Checklist

District: Foothill-De Anza Community College District
Campus: District-wide
Project: Sustainability Action Plan
Date: Version 3 - August 2022

Priority Implementation Plans Indicated Below

Section 4.3 ENERGY EFFICIENCY						
Section	Selected Program or Project	Priority (select)	Status (select)	Associated OBJECTIVE	Target Completion Date	Assigned To
4.3.1	Set Energy Efficiency Goals	Med	Planned	4 thru 10	2022-2025	Energy and Sustainability Manager
4.3.2	Evaluate Mechanisms for the Implementation of Energy Efficiency Projects	High	Planned	4 thru 10	2022	Bond Program/Energy and Sustainability Manager
4.3.3	Conduct Facility Prioritization Survey	High	Planned	4 thru 10	2022-2025	Bond Program/Energy and Sustainability
4.3.4	Conduct Comprehensive Facility Energy Audits	Med	Planned	4 thru 10	2022-2025	Energy and Sustainability Manager
4.3.5	Implement New and Existing Audit Recommendations	Med	Planned	4 thru 10	2022-2025	Energy and Sustainability Manager
4.3.6	Participate in Demand Response Programs	Med	Planned	4 thru 10	2023	Energy and Sustainability Manager
4.3.7	Install Energy Efficient Equipment	Med	Planned	4 thru 10	2024	Energy and Sustainability Manager
4.3.8	Manage Plug Loads	Med	Planned	4 thru 10	2022-2025	Energy and Sustainability Manager
4.3.9	Evaluate and apply Best Practices Energy Efficiency Measures	High	Planned	4 thru 10	2022-2025	Energy and Sustainability Manager

APPENDIX C

Sustainability Template Plan Implementation Programs and Plans Checklist

District: Foothill-De Anza Community College District
Campus: District-wide
Project: Sustainability Action Plan
Date: Version 3 - August 2022

Priority Implementation Plans Indicated Below

Section 4.4 FACILITIES OPERATION						
Section	Selected Program or Project	Priority (select)	Status (select)	Associated OBJECTIVE	Target Completion Date	Assigned To
4.4.1	Encourage and Support Energy Efficiency Training of Staff	Med	Planned	9	2022	Energy and Sustainability Manager
4.4.2	Upgrade Building and Energy Management Systems	Med	In-Process	9	2022	Bond Program/Facilities
4.4.3	Adjust Temperature Set Points and Schedule Operating Times	Med	Planned	9	2023	Facilities
4.4.4	Evaluate Opportunities to Optimize Building Occupancy Scheduling	Med	Planned	9	2023	District/Campus/Facilities
4.4.5	Optimize HVAC Equipment Scheduling	Med	Planned	9	2023	Facilities/Energy and Sustainability Manager
4.4.6	Install Meters and Benchmark at the Building and System Level.	Med	Planned	9	2023	Bond Program/Facilities
4.4.7	Pursue Monitoring-Based (MBCx)/Retro-Commissioning (RCx)	Med	In-Process	9	2022	Bond Program/Facilities
4.4.8	Perform Regular Maintenance on Equipment	High	In-Process	9	2021	Facilities
4.4.9	Prepare Climate Adaptation and Resiliency Plan	Med	Planned	8	2022-2025	ESAC/Energy and Sustainability Manager

Section 4.5 SUSTAINABLE BUILDING PRACTICES						
Section	Selected Program or Project	Priority (select)	Status (select)	Associated OBJECTIVE	Target Completion Date	Assigned To
4.5.1	Establish a Green Building Standard	High	Planned	9	2022	ESAC/ Bond Program/ Facilities/ Energy and Sustainability Manager
4.5.2	Implement Sustainable Design Practices	High	Planned	9	2022	Energy and Sustainability Manager/Bond Program
4.5.3	Use an Integrated Systems Approach in Building Design	High	Planned	9	2022	Energy and Sustainability Manager/Bond
4.5.4	Hire Sustainable Building Design Professionals	High	In-Process	9	Ongoing	Energy and Sustainability Manager/Bond
4.5.5	Commission New Buildings	Med	Planned	9	2023	Energy and Sustainability Manager/Bond Program
4.5.6	Develop Regenerative Design and Nature Positive Principles	High	Planned	10	2023	Energy and Sustainability Manager
4.5.7	Set Net-Positive Goals and Plans	High	Planned	10	2023	Energy and Sustainability Manager

APPENDIX C

Sustainability Template Plan Implementation Programs and Plans Checklist

District: Foothill-De Anza Community College District
Campus: District-wide
Project: Sustainability Action Plan
Date: Version 3 - August 2022

Priority Implementation Plans Indicated Below

Section 4.6 ON-SITE GENERATION AND RENEWABLE ENERGY						
Section	Selected Program or Project	Priority (select)	Status (select)	Associated OBJECTIVE	Target Completion Date	Assigned To
4.6.1	Evaluate Load Shifting Technologies	Med	Planned	4 thru 7	2022-2025	Energy and Sustainability Manager
4.6.2	Minimize Greenhouse Gas Intensity of Purchased Electricity	High	Planned	4 thru 7	2022	Energy and Sustainability Manager/VC Business
4.6.3	Perform Feasibility Study for additional Solar PV at Campuses	High	Planned	4 thru 7	2023	Energy and Sustainability Manager

Section 4.7 TRANSPORTATION, COMMUTING, AND CAMPUS FLEET & TRAVEL						
Section	Selected Program or Project	Priority (select)	Status (select)	Associated OBJECTIVE	Target Completion Date	Assigned To
4.7.1	Participate in District transportation surveys and analysis	High	In-Process	14,15	2022-2023	Energy and Sustainability Manager/Colleges
4.7.2	Encourage and Enhance Public Transportation and Ridesharing Options	High	In-Process	15	2022-2023	Energy and Sustainability Manager/Colleges
4.7.3	Encourage and Enhance Bicycling Options	Med	Planned	15	2022-2023	Energy and Sustainability Manager/Colleges
4.7.4	Improve Campus Fleet & Travel	High	Planned	16,17	2022-2023	Energy and Sustainability Manager/Facilities
4.7.5	Explore Student Distance Learning and Employee Remote Work	High	In-Process	15	2022-2023	Energy and Sustainability Manager/Colleges
4.7.6	Analyze and Install Electric Vehicle (EV) Charging using on-site Solar PV Electricity. Include analysis of fast-charging autonomous vehicles	Med	In-Process	14	2025-2030	Energy and Sustainability Manager/Bond Program/Facilities
4.7.7	Implement a Green Parking Permit program by 2030	Low	Planned	14	2030	Energy and Sustainability Manager/Facilities

APPENDIX C

**Sustainability Template Plan
Implementation Programs and Plans Checklist**

District: Foothill-De Anza Community College District
Campus: District-wide
Project: Sustainability Action Plan
Date: Version 3 - August 2022

Priority Implementation Plans Indicated Below

Section 4.8 WATER, WASTEWATER, AND SUSTAINABLE LANDSCAPING						
Section	Selected Program or Project	Priority (select)	Status (select)	Associated OBJECTIVE	Target Completion Date	Assigned To
4.8.1	Establish Water Conservation Goals	High	Planned	11,12	2025	Energy and Sustainability Manager/Bond Program/Facilities
4.8.2	Implement Water Conservation Strategies	High	Planned	11,12	2023-2035	Energy and Sustainability Manager/Bond Program/Facilities
4.8.3	Reduce Storm Water, Sewer Discharges, and Water Pollution	High	Planned	13	2023-2036	Energy and Sustainability Manager/Bond Program/Facilities
4.8.4	Adopt Sustainable Landscaping Practices	High	Planned	11,12,13	2025	Energy and Sustainability Manager/Bond Program/Facilities

Section 4.9 SOLID WASTE REDUCTION AND RECYCLING						
Section	Selected Program or Project	Priority (select)	Status (select)	Associated OBJECTIVE	Target Completion Date	Assigned To
4.9.1	Create Waste Reduction Goals	High	Planned	18	2023	Energy and Sustainability Manager/Facilities
4.9.2	Maximize Programs Offered by Contracted Waste Hauler	High	In-Process	18	2023	Energy and Sustainability Manager/Facilities
4.9.3	Reduce Waste Stream to the Landfill	High	Planned	19	2023	Energy and Sustainability Manager/Facilities
4.9.4	Improve Existing Recycling Programs	Med	In-Process	18	2023	Energy and Sustainability Manager/Facilities
4.9.5	Collect and Sell All Recyclable Material	Med	Planned	18	2025	Energy and Sustainability Manager/Facilities
4.9.6	Green Waste and Food Waste Composting	High	In-Process	18	2022	Energy and Sustainability Manager/Facilities
4.9.7	Construction and Demolition (C&D) Recycling	High	In-Process	18	2022	Energy and Sustainability Manager/Facilities
4.9.8	Conduct a Waste Category Assessment	Med	Planned	18	2023	Energy and Sustainability Manager/Facilities

APPENDIX C

Sustainability Template Plan Implementation Programs and Plans Checklist

District: Foothill-De Anza Community College District
Campus: District-wide
Project: Sustainability Action Plan
Date: Version 3 - August 2022

Priority Implementation Plans Indicated Below

Section 4.10 SUSTAINABLE PROCUREMENT						
Section	Selected Program or Project	Priority (select)	Status (select)	Associated OBJECTIVE	Target Completion Date	Assigned To
4.10.1	Develop Sustainable Purchasing Practices and Procedure	High	Planned	20,21	2023-2025	Energy and Sustainability Manager/Food Systems Staff
4.10.2	Evaluate and Implement Socially Responsible Purchasing	Med	Planned	20,21	2025	Energy and Sustainability Manager/Food Systems Staff

Section 4.11 STUDENT AND CURRICULUM DEVELOPMENT						
Section	Selected Program or Project	Priority (select)	Status (select)	Associated OBJECTIVE	Target Completion Date	Assigned To
4.11.1	Provide Professional Development and Create a Faculty Forum	Med	Planned	26	2025	Deans/ Curriculum Committee
4.11.2	Highlight climate action and sustainability in various venues such as convocation, student orientation, and professional development	High	In-Process	26	2022	Deans/ Curriculum Committee/Energy and Sustainability Manager
4.11.3	Establish Climate Change and Sustainability Education as an Immersive Experience	High	Planned	26	2025	Deans/ Curriculum Committee/Energy and Sustainability Manager
4.11.4	Training Opportunities for Students	High	In-Process	26	2022-2025	Deans/ Curriculum Committee/Energy and Sustainability Manager
4.11.5	Curriculum Development	High	Planned	26	2022-2025	Campus/Senior Management/
4.11.6	Research true economic, social, and environmental impacts of energy and sustainability projects. Include students in this program.	High	Planned	2,26	2021	Energy and Sustainability Manager/ Faculty/ ESAC

APPENDIX C

Sustainability Template Plan Implementation Programs and Plans Checklist

District: Foothill-De Anza Community College District
Campus: District-wide
Project: Sustainability Action Plan
Date: Version 3 - August 2022

Priority Implementation Plans Indicated Below

Section 4.12 CAMPUS AND COMMUNITY OUTREACH & AWARENESS						
Section	Selected Program or Project	Priority (select)	Status (select)	Associated OBJECTIVE	Target Completion Date	Assigned To
4.12.1	Enhance ESAC Website	High	Planned	24,25	Ongoing	Energy and Sustainability Manager
4.12.2	Hold Workshops, Presentations, and Sustainability Events	Med	Planned	24,25	2023	Energy and Sustainability Manager/Colleges
4.12.3	Campus Specific Outreach & Awareness	Med	Planned	24,25	2023	Energy and Sustainability Manager/Colleges
4.12.4	Community Outreach and Partnerships	Med	Planned	24,25	2023	Energy and Sustainability Manager/Colleges
4.12.5	Inter-Campus Collaboration	High	In-Process	24,25	2022	Colleges/Energy and Sustainability Manager/Facilities

Section 4.13 FOOD SYSTEMS						
Section	Selected Program or Project	Priority (select)	Status (select)	Associated OBJECTIVE	Target Completion Date	Assigned To
4.13.1	Develop and Implement Sustainable Food Purchasing Goals and Programs	High	Planned	22	2025	Energy and Sustainability Manager/Food Systems Staff/Purchasing
4.13.2	Require food service organizations to track their sustainable food purchases in accordance with Real Food Challenge guidelines.	Med	Planned	22	2030	Energy and Sustainability Manager/Food Systems Staff/Purchasing

APPENDIX C

**Sustainability Template Plan
Implementation Programs and Plans Checklist**

District: Foothill-De Anza Community College District
Campus: District-wide
Project: Sustainability Action Plan
Date: Version 3 - August 2022

Priority Implementation Plans Indicated Below

Section 4.14 DIVERSITY, EQUITY, AND ENVIRONMENTAL JUSTICE						
Section	Selected Program or Project	Priority (select)	Status (select)	Associated OBJECTIVE	Target Completion Date	Assigned To
4.14.1	Create connections specific to Diversity, Equity, and Inclusion efforts to District Sustainability Planning and Implementation.	High	Planned	23	2025	Energy and Sustainability Manager/Colleges
4.14.2	Explore changes to local policies and procedures with the Board of Trustees to bolster climate and environmental justice	High	Planned	23	2025	Energy and Sustainability Manager/Administration
4.14.3	Develop educational programs and events underscoring the intersectional relationship of environment, climate, and social equity issues.	High	Planned	23,26	2025	Energy and Sustainability Manager/Deans/Faculty
4.14.4	Work with each college Office of Equity to integrate sustainability planning with campus Equity Plans	High	In-Process	23	7/14/1905	Energy and Sustainability Manager/Equity Offices

MEASURE G BOND ENERGY-SAVING PROJECTS

Attached is the listing of the Measure G Bond Energy-Saving projects. These projects will be evaluated as part of the Energy Master Plan implementation.

APPENDIX D

**FHDA Measure G Bond Energy-Saving Projects
Foothill College**

ID	Project Description	Energy Component	Notes
FH-002	Heating, Ventilation and Air Conditioning Equipment and System Components and Physical Plants Upgrades	Y	All new heating and cooling systems, distribution, etc
FH-003	Building Exterior, Roofing and Waterproofing Campus-wide Renovations	Y	Exterior shell repairs or replacement includes insulation, better windows, door and door seals, etc for energy saving, etc
FH-004	Infrastructure and Distribution Piping Improvements Heating, Ventilation and Air Conditioning Upgrades Campus-wide	Y	All new heating and cooling system infrastructure/s, distribution, etc
FH-005	Restroom Facilities Upgrades and Improvements	Y	Restroom repairs or replacement includes insulation, more efficient equipment or systems including hot water systems for energy saving, etc
FH-006	Renovate and Expand Student Success Centers	Y	Added space and repairs or replacement includes insulation, more efficient equipment or systems for energy saving, etc
FH-007	Renovate and Upgrade Existing Classroom Facilities	Y	Added classroom space and repairs or replacement includes insulation, more efficient equipment or systems for energy saving, etc
FH-008	Pool and Physical Educational Facilities Improvements	Y	Added PE area space and repairs or replacement includes insulation, more efficient equipment or systems for energy saving, etc
FH-013	Lighting Improvements Campus-wide	Y	Interior campus lighting replacement with LEDs will save energy
FH-014	Natural Gas Service and Distribution Electrification	Y	Limiting gas service and optimizing electrical systems for energy saving
FH-015	Electrical Systems Renovations and Upgrades Campus-wide	Y	Replacing electrical systems will save energy
FH-016	Building Management System Upgrades System-wide	Y	Replacing BMS will help save energy

APPENDIX D

**FHDA Measure G Bond Energy-Saving Projects
De Anza College**

ID	Project Description	Energy Component	Notes
DA-003	Perimeter Campus Roadway, Pathway, and Traffic Improvements	Y	Likely energy saving components, needs to be included for traffic impacts in CEQA documentation
DA-005	Replacement of the Creative Arts Quad Buildings	Y	All new heating and cooling system infrastructure/s, distribution, etc
DA-007	Building Exterior, Roofing and Waterproofing Campus-wide Renovations	Y	Exterior shell repairs or replacement includes insulation, better windows, door and door seals, etc for energy saving, etc
DA-008	Infrastructure and Distribution Piping Improvements Heating, Ventilation and Air Conditioning Upgrades Campus-wide	Y	All new heating and cooling system infrastructure/s, distribution, etc
DA-009	Heating, Ventilation and Air Conditioning Equipment and System Components & Physical Plant Operation Upgrades	Y	All new heating and cooling system infrastructure/s, distribution, etc
DA-010	Physical Plant replacement attached to Flint Center and Creative Arts Quad Buildings	Y	All new heating and cooling system infrastructure/s, distribution, etc
DA-012	Student Health Services Renovation	Y	Added space and repairs or replacement includes insulation, more efficient equipment or systems for energy saving, etc
DA-013	Building Interior and Exterior Improvements Campus-wide	Y	Any space with repairs or replacement includes insulation, more efficient equipment or systems for energy saving, etc
DA-014	Physical Education and Gymnasium Building Renovation	Y	Added space and repairs or replacement includes insulation, more efficient equipment or systems for energy saving, etc
DA-016	Pool and Physical Educational Quad Facilities Improvements	Y	Added space and repairs or replacement includes insulation, more efficient equipment or systems for energy saving, etc
DA-017	Automotive Technology Facilities Improvements and Modernization	Y	Added space and repairs or replacement includes insulation, more efficient equipment or systems for energy saving, etc

APPENDIX D

FHDA Measure G Bond Energy-Saving Projects Central Services Project List

ID	Project Description	Energy Component	Notes
CS-001	Equipment and Vehicles Acquisitions	Y	State-mandated EVs required as fleet vehicles
CS-003	ETS Storage Facilities	Y	All new heating and cooling system, connect to existing or new infrastructure/s, distribution, etc

APPENDIX D

FHDA Measure G Bond Energy Saving Projects Educational Technology Services (ETS) Project List

ID	Project Description	Energy Component	Notes
ETS-001	Learning Space Technology Upgrades and Enhancements	Y	Likely replacement of aged equipment with new, possible energy savings
ETS-002	Academic and Business Computer Refresh	Y	Likely replacement of aged equipment with new, possible energy savings
ETS-003	Servers and Disk Storage Equipment for Remote Desktop Support	Y	Likely replacement of aged equipment with new, possible energy savings
ETS-006	Building-based Network Service Room Upgrades	Y	Likely replacement of aged equipment with new, possible energy savings

APPENDIX D

FHDA Measure G Bond Energy Saving Projects District and District-wide Project List

ID	Project Description	Energy Component	Notes
DW-001	De Anza Event Center	Y	All new facility
DW-002	Relocation of Utilities for De Anza Event Center Facility	Y	All new heating and cooling systems, distribution, etc
DW-003	Griffin House Renovations	Y	All new heating and cooling systems in building, connections to existing or new utilities
DW-004	Carriage House	Y	Updated heating and cooling systems in building, connections to existing or new utilities
DW-005	District-wide Energy and Sustainability Projects	Y	New or updated infrastructure requires energy efficiency component/s

TOTEM WHITE PAPER

Attached is a White Paper describing the TOTEM (Tool for Optimization of Thermal and Electric Microgrids) analysis which will model Foothill College combined electric (power and energy) and thermal (HVAC) system to understand and evaluate thermal microgrid replacement of the natural gas uses.

APPENDIX E

A Path to Decarbonization for the California Community College System - White Paper Outline

Sonika Choudhary (EDF) and Robert Cormia (FHDA-CCD)

The California Community College System represents over 2 million students, 115 Colleges, and over 50 million (assignable) square-feet of buildings, with an average age of over 30 years. As a leader in demonstrating energy efficiency, and LEED building, California Community Colleges represent a “leading edge” for incorporating building technology that lowers energy use and cost, with significant impact on Greenhouse Gas Emissions. California’s SB32 2030 Decarbonization Goal brings a special opportunity to the California Community College system. California Community Colleges have already led with significant adoption of solar photovoltaic (PV) energy, cogeneration of heat and power, and support for Electric Vehicle (EV) charging on our campuses, combined with low carbon electricity procurement, have led to significant reductions in Greenhouse gas inventories. Given the age of our buildings, and especially energy infrastructure, the next step in modernization is to replace older, deprecated natural gas fired boilers with electric heat recovery systems. Foothill De Anza College District (FHDA-CCD) has committed to an 80% reduction in Greenhouse Gas Emissions by 2030, through a process that combines zero carbon emission electricity with elimination of natural gas from the central HVAC system, replaced by an electric heat recovery “thermal microgrid”. This whitepaper will describe the modeling and analysis requirements to plan such a system, including analysis of current energy use, modeling of power and energy requirements for heat recovery, microgrid architecture (storage and onsite solar PV), engineering and project management, and most importantly, how to fund and maintain the project. FHDA-CCD is partnering with Electricity de France (EDF) Innovation labs in Los Altos CA, on a project to begin modeling Foothill’s combined electric (power and energy) and thermal (HVAC) system, to understand and model a thermal microgrid. As an early adopter of a thermal microgrid, these transformative projects can be a model for the California Community College System, and our collective leadership in deep decarbonization. These capital and technology intensive projects also present an economic opportunity for vendors of equipment, system integrators, and utilities, to supply products, services, and end-to-end management for technically demanding infrastructure projects. An analysis of Stanford’s SESI (Stanford Energy System Innovation) program provides insights into the technical and financial paths to achieve transformation of fossil based systems to low carbon heat recovery and distribution, and guidance for the California Community College system. These projects are technically and financially viable paths to our decarbonization goals.

- California Community College system, 115 colleges, 2 million students
 - 50 million sq-ft, over half of the system is at least 50 years old
 - California deep decarbonization goals, 40% reduction by 2030, 80% by 2045
 - Electrification of buildings and carbon free electricity is the path to decarbonization
 - Thermal microgrids are the foundation of a low carbon - managed energy system
 - FHDA-CCD and EDF labs have developed a draft design for a total energy system
 - California Community Colleges have a leadership role in large-scale decarbonization
 - Technical and financially viable paths to California’s SB32 2030 decarbonization goals
1. California’s 2030 Decarbonization Goal

APPENDIX E

As a follow-on to California's landmark Global Warming Solutions bill AB-32, SB-32 was enacted in 2016 to reach deep decarbonization goals a full 20 years ahead of national goals (80% reduction in GHGs below 1990 levels). The strategy to achieve this goal combines increasing Renewable Portfolio Standards (RPS) for in State and imported electricity, and replacing natural gas fired HVAC infrastructure with thermal / electric heat recovery systems. Electrification of new and existing buildings is central to this goal, including Renewable Energy (RE) as a source of energy for electrified systems. Buildings represent ~ 40% of carbon emissions, and natural gas, either to produce electricity, or for space heating, is the primary source of carbon emissions in buildings (reference to DoE energy statistics).

- AB-32 and SB-32 set clear objectives for GHG reduction
- RPS (Renewable Portfolio Standard) more solar PV, lower carbon intensity electricity
- Building electrification with clean primary energy is the path to eliminating natural gas
- New building codes are eliminating natural gas for HVAC and hot water

2. Age and infrastructure of California Community Colleges

California's Community College System construction began in the late 1950s and early 1960s, with fully half of the buildings approaching 50 years old, with many still using original hydronic (piping) infrastructure. Many Colleges are operating with 20-year-old natural gas fired boilers, that will "age out" in the next 5-10 years. The period from 2020-2030 represents an opportunity to both rebuild our critical Community College energy infrastructure, as well as transform our energy systems to high efficiency low carbon emission infrastructure. The majority of the 2018-19 Capital Outlay Plan for California Community Colleges (ref) is directed to modernization of existing facilities. The convergence of aging infrastructure and decarbonization offers an opportunity to achieve GHG reduction goals through the elimination of natural gas.

- College campuses often have central plants with natural gas boilers / hydronic systems
- Many systems are 50 years old, with need for hydronic upgrades and boiler replacement
- Now is a perfect time for deploying modern electric HVAC, achieving reduction of GHGs

3. Electrification as a path forward - elimination of natural gas

The key mechanism to low carbon emissions is elimination of natural gas from HVAC infrastructure, and that is accomplished by replacing natural gas fired boilers with electric heat recovery systems. As described in the technical component of this whitepaper, electric heat recovery systems "move heat" from one reservoir to another, rather than use combustion or electric resistive systems to provide heat, and traditional mechanical compression to cool. Heat pumps and heat recovery systems are standardized in new building construction in Europe, and are increasingly used in high performance buildings in California, including California's Title 24 building codes requiring Net Zero Energy for new commercial buildings beginning in 2020, and modernization of existing buildings in 2025.

APPENDIX E

- Natural gas is the largest component of most California college GHG inventories
- Natural gas boilers can be replaced by high efficiency electric heat recovery systems
- In many cases, the existing central plant model can be retained with hydronic upgrades

4. Model systems - Stanford Energy System Innovation (SESI)

SESI (Stanford Energy Systems Innovation), a project begun in 2009-2011, is the first large-scale heat recovery system of its kind implemented on a large college or university campus. <http://sustainable.stanford.edu/campus-action/stanford-energy-system-innovations-sesi>

The SESI system replaces a complex natural gas thermal system comprising a 25 year-old cogeneration system, and traditional thermal boiler and mechanical HVAC systems. SESI is a large centralized heat recovery system, with a large (125,614 sq-ft) mechanical room, three large storage tanks (~ 12 million gallons) and a direct substation connection to the power grid. The SESI system provides energy to the entire (~ 11 million sq-ft) Stanford campus, has reduced carbon emissions by two-thirds (2017) and more than 80% by 2025 (SESI presentation). The key advances in this system are:

1. Electrification (more efficient energy use)
2. Thermal storage
3. Advanced energy management and analytics
4. Low carbon energy procured through a PPA

The SESI project is a model for California Community Colleges, beginning with the modeling of existing energy use, creating an energy balance model, analysis of coincident heating and cooling, and application of a heat recovery system. The modeling, design, and specification of a project like SESI requires both expertise as well as extensive resources, as described below. SESI worked with Johnson Controls and a number of other vendors to help organize, analyze and model the current energy load, and prepare engineering requirements for the new system.

5. Modeling, design, and specification of projects

The modeling, design, and specification of a new energy system is the focus of this whitepaper, and specifically what resources and expertise are required to assemble data, identify gaps, analyze power, energy, therms, and btu, and develop a comprehensive energy balance model. Once complete, energy management professionals can analyze the model, and work with professional engineers to build an engineering model for the draft design of a heat recovery system. The draft design serves as an RFI/RFQ to enlist quotes and additional perspective on a systems analysis and design. Building modeling (BIMS) is a second level of energy analysis needed in a project of this magnitude, and is essential for “coupling” the building systems with a centralized heat recovery hydronic system. Through the initial modeling of this pilot study, Foothill College also became aware of instances where heating and cooling were going on simultaneously, due to improper settings in the underlying HVAC infrastructure and controls. These discoveries point to opportunities to reduce energy, and carbon emissions, by an

APPENDIX E

estimated 10% or more, BEFORE replacing the existing system. The technical details of the modeling are described in appendix 1, including datasets showing the BTU flow in and out of a central (HVAC) plant, and the therms and electricity associated with heating and cooling the campus.

- Organization and analysis of thermal plant data is the first step in project exploration
- Electricity (kWh) and natural gas (therms) extracted from utility bills and meters
- BTU transfer (heating and cooling) is a much larger effort, need BTU submetering
- BTU data are used in developing a heat recovery as well as energy balance model

6. Power, energy and emission implications

There are significant power and energy requirements to operating a campus wide heat recovery system, which need to be modeled to understand if existing electricity services will be sufficient, the change in peak demand (kW), the total amount of electricity consumed (kWh), and natural gas displaced. This is one of the more difficult but critical components of modeling, and includes the need to properly size electricity contracts (energy. kWh) including power delivery (kW). The SESI system, which provides (1 mmbtu usable heat and 0.85 mmbtu usable cooling, consumes an estimated 321 million kWh annually, which is less than the 388 million kWh produced by the previous cogen system. Natural gas use, of course, has decreased significantly, and will be essentially “phased out” by 2025. The goal of the FHDA-CCD project is to replace the entire central plant heating and cooling (traditional chiller / boiler HVAC) with a SESI like heat recovery system. It is anticipated that natural gas will be reduced by 50% (initially) leaving cogeneration and some gas fired boilers in service, to be replaced by heat recovery systems at a later date. Foothill has begun modeling a prototype electrical system comprising an additional 500 kW solar PV array, adding 25% to the system generation capacity, and energy storage, to capture and redirect solar PV sourced energy for heat recovery and other building loads.

- Power (kW) and energy (kWh) requirements of thermal microgrids are significant
- Electricity will replace natural gas for a large fraction of heating
- Ideally, electricity will be sourced from solar PV, wind, and/or large hydro electric
- Natural gas used for HVAC represents a substantial GHG emission reduction target
- A combination of additional onsite solar PV / electrical energy storage are a good fit

7. Cost of projects, funding requirements

The cost of a heat recovery system is substantial, the most difficult component of a large capital project, followed closely by the resources to manage a construction project of this size. Even more challenging, very few of these projects have been undertaken at the size of a community college, so even having an approximate idea cost, enough for a capital bond, is challenging. But without a budget, a capital bond can't be created to fund the design and engineering, infrastructure (capital equipment), construction and project management, and commissioning. FHDA-CCD has begun this project through conversations with Stanford University, and vendors

APPENDIX E

Johnson and Johnson, who helped implement the project. FHDA-CCD is budgeting ~ \$100M for a complete system, and will look to combine funding from a capital bond, with ESCO (Energy Service Companies). The College may also look to other large project grants, including ARPA-E, that could help “jump-start” the process.

- Capital cost of a heat recovery system is substantial (~ \$12M for Foothill College)
- Heat pump, thermal storage, hydronic upgrades, etc.
- Additional onsite solar PV and electrical energy storage are strongly recommended
- Project installation, operational assistance, and maintenance are ~ 40% of total cost
- Sources of funding include capital bonds, large government / energy grants

8. Project management of a system in transition

Project management will be critical to implementing an effective, reliable, high performance and low carbon innovation in energy infrastructure. Stanford (SESI) required a professional engineering firm as well as their internal engineering team to develop, source, implement, and commission their system, roughly a 5 yearlong project, that still continues in refinement. A project of this magnitude at a typical California Community College would likely last 2-3 years, and be done in phases, to minimize disruption to campus facilities. Managing disruption of services to a campus serving 10,000 students is a challenge, as most people want the benefits of high performance HVAC system, but not the inconvenience of having everything torn up.

- For many if not most colleges, there will be a transitional time during construction
- HVAC services may be curtailed, or offline for periods of time (several weeks / months)
- Managing expectations of employees and students requires effort and coordination

9. California Community Colleges as leader in decarbonization

California is arguably the leader in combined policy, technical and commercial development, and innovation, not the least of which is our colleges and universities. Academic and commercial research and development, combined with implementation of LEED, ZNE, and integrated low carbon power and energy infrastructure, creates fertile ground for leading edge energy projects like SESI. More importantly, through policy, funding, and developing shared technical expertise, California can provide the combined financial, technical, and project management support to achieve deep decarbonization. California’s decarbonization goals, and support for projects like the (SESI) described in this paper, establish a replicable model for the US, and for the world, and additionally establish California as a technology leader and vendor of products and services to support both new high performance buildings, as well as retrofitting the built environment.

California Community Colleges have a special role in higher education and in the public landscape, as we are visible to so many Californians, students, stakeholders, and the community at large. What we do matters, and especially if we involve the community investing in our infrastructure, reducing greenhouse gas emissions, and creating a better environment.

APPENDIX E

- California is a leader in innovative and advanced energy technology deployment
- LEED construction, ZNE (Zero Net Energy) buildings, energy efficiency reach codes
- Building electrification with low carbon electricity, energy storage and management
- A suite of infrastructure approaches will help California achieve decarbonization goals

10. Value to the community (vendor development)

As mentioned above, vendor development is essential to building an ecosystem of engineers, developers, ESCOs, systems integrators, and financial support for large complex projects like this, which probably range from 50 million to 200 million dollars in scope. The value to the community of having world class (brand name) developers in California not only adds economic value, it adds to our political stature. Beginning with the 2006 landmark legislation Global Warming Solutions Act, California set policy directives that have helped foster commercial development, in carbon markets, building standards, automotive performance, Renewable Energy (RE) development, and in the process, created thousands of jobs, and billions of dollars in value, through a combination of energy savings, environmental protection, and commerce.

- Advanced energy infrastructure investments benefit multiple stakeholders
- Clean energy industry (ESCO), building occupants, and surrounding communities
- These projects pave the way for leadership in decarbonization across all sectors
- California will grow as a leader in advanced energy technology / decarbonization projects
- Thousands of jobs, billions of dollars, energy savings and significant GHG reduction

11. Role of California (State) in support of electrification

Electricity is probably the most important “modern invention” that our technology driven society relies upon every day, and will be the foundation to undo dependence on fossil fuels for the energy that drives everything we do today. With non-emission sources of primary energy available to provide clean, affordable, and reliable electricity, and for the built environment, transition from the legacy of natural gas, which touted “clean burning” but still produces significant carbon dioxide emissions. As California leads on climate, we can also lead on electrification, and support for non-emission sources of that electricity. With very little time to transition to a fossil fuel free world, electrification of buildings, transportation, commerce and industry, are a necessary requirement to begin to unwind a path towards catastrophic climate change. In addition to GHG emissions, heat recovery systems are the next evolution of HVAC, transferring and managing rather than creating heat, and through efficiency and performance, provide economic value, better operation buildings, and ultimately better occupancy comfort.

- Electrification is the “road ahead” for deep decarbonization in California
- Buildings (HVAC) are the best first place to begin reduction in natural gas
- Managed energy systems integrate onsite solar PV, energy storage, advanced HVAC
- Electric Vehicle (EV) infrastructure is integral to decarbonization of the energy system

APPENDIX E

12. All electric buildings in new construction

California has already begun the transition to building electrification through the design and construction of all electric buildings (new and replacement buildings). On college campuses, which often comprise hundreds of buildings and construction that is 50 years old, and sometimes much older, replacement of a building with new construction is a better choice than renovation. New buildings are designed as a “blank slate”, and need not follow the exact architecture of older construction, allowing for greater use of high performance glazing and daylighting, and often employing advanced energy infrastructure including rooftop solar PV, and ground source heat pumps (NASA-Ames Sustainability Base, building N232, completed in 2012.

(and new construction of the nearly all electric 50,000 sq-ft FHDA-CCD Sunnyvale Campus in 2016, and the all-electric (similar sized) new district office, commissioned in late 2019).

These all or nearly all electric buildings have very low Energy Use Intensity (EUI) of 40,000 BTU/sq-ft annual, and are often supplied with low carbon electricity through Power Purchase Agreements (PPA). Compared to adjacent buildings with EUIs of 100,000 BTU/sq-ft annual, using standard grid electricity, these buildings have a GHG output that is 1/100th of the older buildings on campus. Over time, new construction will replace older buildings, but that could take decades, and the opportunity to replace central plant HVAC with heat recovery systems, including local solar electric power, and energy storage to maximize storage of solar PPA energy, is now. As described in the section on thermal (total energy) microgrids, the combination of a number of elements including campus level Building Management Systems (BMS) with energy storage and microgrid controllers, offers the ability to maximize the use of low carbon electricity, either from onsite sources, or through a solar PV PPA. High performance buildings are also competitive in cost with traditional construction, but offer significant operational savings from lower energy use, and often have nearly zero reportable GHG emissions.

- All electric buildings are a path to decarbonization, no natural gas used anywhere
- Energy Use Intensity (EUI) is significantly lower (< 40%) than existing buildings
- Energy efficiency measures including solar PV, glazing and daylighting built into design
- Electricity from onsite solar PV and solar energy PPA lead to zero reportable emissions

13. Support for electrification of transportation

Electrification of transportation is actually a larger component of decarbonization than buildings, and will prove to be a harder challenge than electrification of buildings. Electric vehicles are a significant fraction of California vehicle purchases, as much as 10% of new vehicle purchases, and a very high number of vehicles on California Community College campuses.

Parking lot surveys at FHDA-CCD found (unduplicated) 75 EVs at Foothill College and ~ 90 at De Anza College. 10 % of F/T faculty at one college drives an EV (PHEV or BEV) and EVs were

APPENDIX E

seen in 3% of parking spots at Foothill College (with some duplication). A number of models have been used to estimate the ratio of EVSE to EVs (PHEV or BEV), the ratio can be 3 or 4 to as much as 10. As an example, for 75 electric vehicles observed at Foothill and 100 EVs at De Anza, having 25 EVSE chargers on each campus should provide adequate access to charging, assuming coordination among users.

Supporting electric vehicles, especially Battery Electric Vehicles (BEV), at college campuses assists a large segment of the population to have a “destination anchor” for EV charging. EV growth projections suggest that EV drivers could double or triple by 2025, using the survey numbers from our two campuses, leading to 150 to 300 EVs on campus in 5 years. Using a number halfway between 3-4 and 10 EVs per EVSE, suggests that 30 to 50 EVSE chargers on a modest sized campus is a reasonable target number for 2025. The “bottom up” approach can also be checked against a “top down” approach, where each parking lot of reasonable size and solar PV deployment of 250 to 500 kW per parking lot, has 4 - 8 EVSE located near inverters.

Such a top down approach leads to ~ 48 to 50 chargers on a modest sized parking lot, and power bus architecture located near solar PV can easily be extended to 8-12 EVSE per lot. Ideally, each EVSE should have at least 10 kW solar PV allocated to a carbon free energy “budget” for EV charging. Solar deployments larger than that can also provide energy for electric HVAC services. Progress in electrification of transportation requires investment in infrastructure, including additional onsite solar PV and electrical storage to minimize spikes in demand.

Electric vehicles will only grow in popularity, and by 2030 could represent one in three new cars on campus, by 2040 every other car will either be all electric or an electric hybrid of sometype. Planning for a future with so much electrical demand, integrated into the larger power grid, is difficult to imagine. Autonomous vehicles will additionally play a significant role in transportation for our students and employees. One thing is certain, if we can't control and eventually limit the use of petroleum, we will not be able to manage and reduce radiative forcing from GHGs

- Electrification of transportation is a bigger challenge than electrification of buildings
- EV adoption is significant in 2019, most colleges have at least 100 EVs on campus
- Automakers are expected to release dozens of new electric models in 2022-23
- Growth will double or triple by 2025, hundreds of EVs will be parked on our campuses
- Support for EV charging enables BEV drivers to get home, PHEV to stay on electric
- EVSE is expensive, electric infrastructure needs to be bolstered, locate near solar PV
- Power (kW) and energy (kWh) need to be thought through, EVSE has to be metered
- A future with electrified transportation, and autonomous vehicles, is difficult to imagine

14. Thermal (total energy) microgrids, putting it all together

The concept of a thermal (total energy) microgrid as applied to college campuses is an integrated energy system, including onsite solar PV, cogeneration, electrical and thermal energy storage, utility energy, often including solar Power Purchase Agreements (PPAs), and a microgrid controller to manage energy flows, especially generating, storing, and distributing

APPENDIX E

energy (see figure below from EDF report). Thermal microgrids integrate campus heat recovery HVAC systems into the microgrid foundation, and especially the ability to utilize electricity produced from solar and wind. Advanced energy systems include demand side management through building management systems, and support for EVSE (EV charging).

- Distributed energy generated behind the meter (solar PV and cogeneration)
- Electrical and thermal energy storage
- Heat recovery HVAC linked to solar generation, energy storage, and solar PPA
- EVSE (EV charging) is a growing and integral load also linked to solar energy

15. Conclusions and recommendations

California's Community College system is integral to, and a perfect proving ground for, the path to decarbonization through electrification of buildings, and development of Renewable Energy (RE) projects supplying emission free energy to large customers for extended time (contracts). California's 115 Community College Districts include a significant number of campuses with building and HVAC infrastructure that is prime for upgrading to electric heat recovery systems, which are not only more efficient, their energy can come from zero carbon emission sources. The cost and complexity of these projects is non-trivial, and presents engineering, financial, and logistical challenges, which could delay or prevent individual colleges and districts from going forward with these projects, and perhaps settling for "replacement" rather than "upgrade", locking in carbon emissions for 15-20 years further. Through a coordinated effort, California can develop a holistic approach to identifying campuses and infrastructure prime for upgrading, assist in (matching) funding, provide a centralized source of knowledge for planning, designing, engineering, deploying, and perhaps even managing the next generation of HVAC systems. Community Colleges, because of their complexity, and also the large amount of land (parking lots) and other available space, provide opportunities for combining large scale solar PV installations with onsite energy storage, feeding into a thermal microgrid, combining onsite emission free electricity, with a thermal / electric heat recovery system. This is the path forward to decarbonization, and California Community Colleges can lead the charge in this transition!

- California Community Colleges have significant reach and visibility in our communities
- CCCs have traditionally been "forward looking" in investment in new energy technology
- Solar, LEED/ZNE, EV charging, building electrification, advanced energy management
- Many colleges have 50+ year HVAC infrastructure, ideal for upgrading and replacement
- Costs are significant, and support from the State is essential to advance these projects

16. References

Technical references for heat recovery and decarbonization

Department of Energy - <https://www.energy.gov/energysaver/heat-and-cool/heat-pump-systems>

A Roadmap to Decarbonize California Buildings

APPENDIX E

<http://www.buildingdecarb.org/resources/a-roadmap-to-decarbonize-californias-buildings>

The Path to 2050 and Deep Decarbonization -
<https://www.planning.org/events/activity/9136743/>

17. Appendices

EDF modeling project - Foothill College partnered with Electricity de France (EDF) labs in Los Altos to model the central HVAC plant as an electric heat recovery system.

Technical content, engineering diagrams, financial estimates, supporting white paper content

TOTEM - **T**ool for **O**ptimization of **T**hermal and **E**lectric **M**icrogrids

Diagram SESI Thermal Microgrid

Diagram Foothill College Thermal Microgrid

GHG emission reduction estimates

Project tasks for preparedness

Dissemination paths (SVCE Innovation Grant)

Strategic Energy Innovation - Curriculum Development

FHDA Decarbonization Plan (DRAFT)

18.)

APPENDIX E

Appendix - Electricity de France (EDF) Labs / Foothill College Heat Recovery Modeling Project

In early 2019, Electricity de France (EDF) labs in Los Altos, California, provided seed funding for a decarbonization modeling project at Foothill College. The goal of the project was to develop a heat recovery opportunity model, specify appropriate infrastructure for modernization of the central plant, and estimate project and operational cost, operational savings (and payback period), and projected GHG emissions reduction.

The project was a test case for developing a practice to organize, analyze, and prepare thermal data from heating and cooling in the central plant, to determine if the campus would be a good opportunity for a heat recovery system. For a number of weeks, data was extracted from meter logs, analyzed for integrity, and then entered into various computer applications for visualization.

One specific tool, TOTEM (**T**ool for **O**ptimization of **T**hermal and **E**lectric **M**icrogrids) was developed especially for analysis of thermal data, and developing a profile of simultaneous heating and cooling, which represents the heat recovery opportunity. The project required significant effort to locate data logs for meters, as well as troubleshoot existing meters, and “fill” missing data through analysis of similar time periods in adjacent years.

Once the data is organized and ready for analysis, current utility bills are needed to provide rates (tariffs) for energy costs, and additionally onsite generation (solar PV and cogeneration) are added into the model. Finally, dispatchable loads including EV charging are integrated into the model. TOTEM works fairly quickly to specify the components needed for the future central plant, including HVAC components, thermal and electrical energy storage, and options for different solar PV configurations. Solar PPA contracts are also integrated as a utility input.

The current state of the project has provided a draft model for a thermal (total energy) microgrid comprising a central HVAC plant using an electric heat recovery system, with thermal and electrical energy storage, additional solar PV to provide low carbon energy for HVAC, and EVSE (EV charging). The model estimates current and future energy use and cost, a estimate of capital equipment cost, including upgrades to the thermal hydronic network, and estimated GHG reduction. From these projections, an estimated cost per ton of CO₂ reduced was made.

New capital equipment:

- Heat pump / HVAC
- Thermal storage
- Electric energy storage
- Additional solar PV (500 kW)
- Microgrid controller
- Extension of hydronic system

Energy and costs details are detailed in supplemental material

APPENDIX E

TOTEM Output for design of a Total Energy / Thermal Microgrid at Foothill College Heat Recovery System, Electrical and Thermal energy storage

Thermal generation

Heat recovery chiller 540 tons 9 units

Electric chiller 0 tons 0 unit

Hot water generator 0 kBTU/hr 0 unit

Multistack ARA VersaTemp combined heating and cooling system

60 tons / unit maximum of 20 units, \$75,000 per unit, estimated cost \$4.5 million

Storage

Electric storage 1,114 kWh continuous variable

Hot water storage 23,357 kBTU continuous variable

Chilled water storage 2,905 ton-hr continuous variable

DER generation

Photovoltaics 500 kW nominal 2000 250W panels

Existing capacity 1.5 MW, recommended additional capacity 0.5 MW, total system 2 MW

Cost of solar electric parking lot installation @ \$7.5 / watt installed (includes racking and inverters, upgrades to the electrical system, and minor improvements to the parking lot)

Cogeneration capacity: 4 x 60kW Capstone microturbines, total nameplate capacity 240 kW, real power output ~ 200 kW Natural gas consumption is ~ 200,000 therms a year

Electric energy storage of ~ 1-2 MWh, 250 kW to 500 kW discharge for 2-4 hours, estimated cost of ~ \$750/kWh (installed), total project cost ~ \$1.5M with microgrid controller & analytics


Microgrid controller - for monitoring onsite generation and power management to buildings, energy storage, and time of use optimization of utility energy. (No equipment specification).

Electric Vehicle Supply Equipment (EVSE) future capacity ~ 25 chargers with an estimated power demand of 5 kW (blend of 4 kW PHEV and 7.5 kW BEV). Annual energy = 125,000 kWh


Note that we may have additional "solar parking" (~ 250 kW ?) installed for the EVSE, either as "banks of solar / EVSE" or EVSE located near existing and future solar PV deployments

APPENDIX E

Thermal Microgrids: Technology, Economics and Opportunity - EDF Labs 12/2017

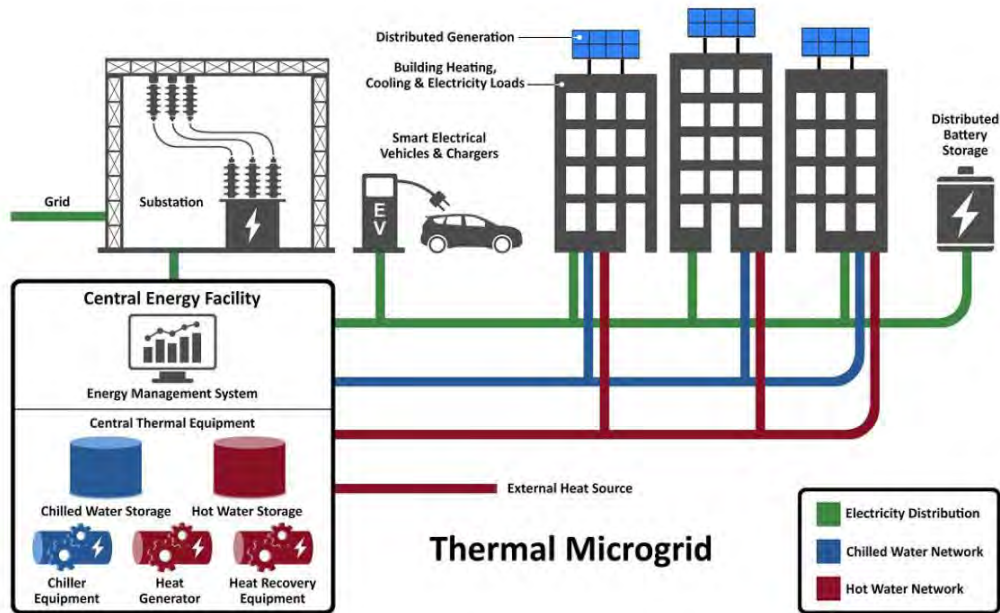

Future Energy System Model

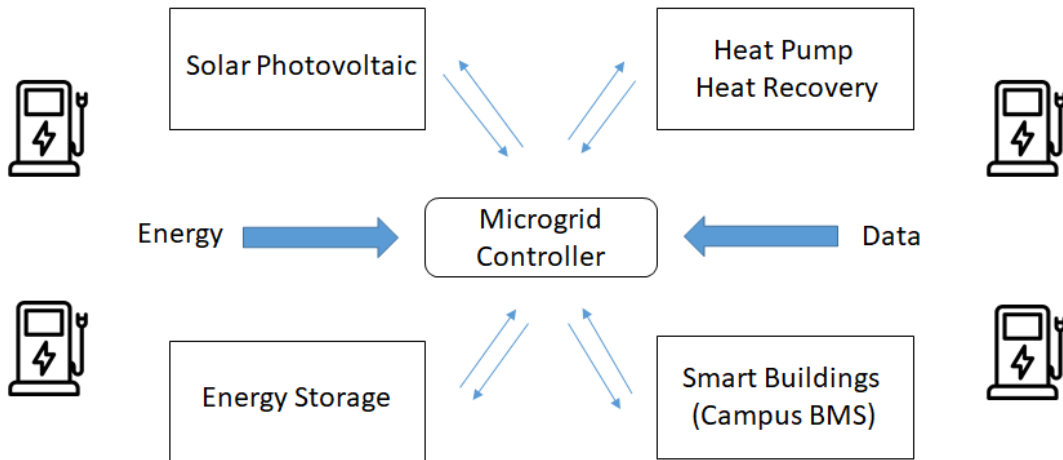

Future microgrid energy architecture with “managed energy” process

Foothill College energy model (presented in FHDA-CCD path to decarbonization 9/25/2019)

APPENDIX E

Appendix - GHG savings estimates for Foothill College in 2025 (projected)

From the 2009-10 GHG inventory:

~ 4.5 M kWh electricity @ 1 lbs CO₂ per kWh = 4.5×10^6 lbs CO₂

450,000 therms natural gas @ 11.7 lbs CO₂ per therm = 5.3×10^6 lbs CO₂

Total carbon dioxide in 2009-10 ~ 10×10^6 lbs CO₂

Replacing the central plant HVAC natural gas boilers with electric heat recovery system reduces natural gas use to cogeneration, ~ 200,000 therms @ 11.7 lbs CO₂ per therm = 2.3×10^6 lbs CO₂. From the 2009-10 base of ~ 9.8×10^6 lbs CO₂ this is a reduction of ~ 75%

The key elements FHDA-CCD central plant / decarbonization plan comprise:

1. Purchase of carbon free electricity
2. Replacing natural gas boilers in central HVAC plant
3. Additional onsite solar PV for HVAC and EVSE
4. Electrical and thermal energy storage
5. Support for EVSE (EV charging)
6. Microgrid controller / energy management system

Infrastructure and operational costs for the system include:

1. Replacement of central HVAC - \$1M
2. Upgrading of hydronics - \$2.5M
3. Upgrading building HVAC - \$500K
4. Additional 500 kW onsite solar PV - \$2.5M
5. Electrical energy storage - \$1M
6. Thermal energy storage - \$1.5M
7. EVSE (EV charging) - ~ \$500K
8. Microgrid controller and analytics - ~ \$750K
9. Project design (ESCO) - ~ \$500K
10. Project deployment - \$1.5 M
11. Commission first year ~ \$250K, \$125K-\$150K MRO per year

Estimated capital cost of project \$12.5 M

Difference in operating cost (~ \$125K/yr)

20 years simple payback ~\$20M / 20 years ~ \$1M per year

~ \$750 per metric ton CO₂ reduced (reduction of ~ 2.9 M pounds / 1,330 tons CO₂ per year)

Operational basis, ~ \$125 -150K/yr (incremental) / 1,330 tons per year ~ \$100 / ton CO₂ reduced

APPENDIX E

Appendix: Key activities required for heat recovery project readiness (this is a work in progress)

1. Have natural gas and electricity utility bills organized and analyzed
 - a. Determine therms used for heating, and cogeneration, if applicable
 - b. Calculate BTU per sq-ft heating and kWh per sq-ft for all uses
 - c. For electricity, gather kW and kWh interval data for an entire year
2. Organize and analyze onsite energy generation
 - a. For every onsite generation source, solar PV, cogeneration
 - b. Gather and organize 15-minute interval data (kW) and calculate kWh
 - c. Combine solar PV data, including 15-minute kW and kWh all arrays
3. Integrate all electricity and natural gas data, develop an energy balance model
 - a. Convert kWh to BTU (3,412 BTU / kWh)
 - b. Therms are in BTU (100,000 BTU/therm)
 - c. Separate therms into heating, cogen, and cogen waste heat
4. Organize thermal HVAC plant data if it exists
 - a. Organize meter data (heating and cooling BTU)
 - b. Natural gas use and BTU transfer
 - c. kWh use and cooling BTU transfer
5. Develop a heat recovery opportunity model
 - a. Organize heating and cooling data into a BTU / interval model
 - b. Display heating and cooling profiles, determine overlap
 - c. Quantify the overlap, prepare data for heat recovery sizing
6. Develop a GHG inventory for electricity and natural gas
 - a. Use carbon intensity of electricity from power mix
 - b. Use 11.7 lbs CO₂/therm for natural gas (cogen and heating)
 - c. Estimate GHGs by end-use activity, and what can be reduced
7. Develop a first draft of GHG reduction opportunities
 - a. Switching to low carbon or emission free electricity
 - b. Replacing natural gas boilers with electric heat pumps
 - c. Add additional solar PV to provide energy for HVAC
8. Develop a plan to replace one or more natural gas boilers with heat pumps
 - a. Take the heating BTU transfer from the thermal data (section 4 and 5)
 - b. Enter the heating data into a tool (e.g. TOTEM) for sizing the unit
 - c. Estimate power, energy, and operating cost from model parameters
9. Develop a 5 year EVSE (EV charging) plan
 - a. Do a physical count of EVs on campus
 - b. Do a survey of employees and students
 - c. Calculate power and energy requirements
10. Develop a draft of a thermal microgrid campus energy system
 - a. Add all energy inputs (electricity and natural gas), utility and onsite
 - b. Add solar PV, electrical and thermal energy storage, heat recovery, EVSE
 - c. Estimate capital and operating costs, energy and GHG savings
11. Prepare an RFI (Request For Information) and post (share) decarbonization goals

APPENDIX E

Decarbonization awareness

Goal is to create awareness about heat recovery systems in deep decarbonization of the California Community College system, and support a path for building a heat recovery system at Foothill College, as a potential case study.

Scope of work:

Work together to write policy documents, guidance, pieces of procurement design and construction, to speed a master planning and strategic approach, where to start. Overall master plan for decarbonization

1. Overall master plan for decarbonization
2. Campus assessment and readiness
3. Path to approach project description (RFI/RFQ)
4. Engagement of vendors
5. Project management

Language in an RFQ for a design build tiger team. It will take effort at the State level to understand how to support California community colleges in planning, preparing, organizing, leading up to a decarbonization project.

Incremental or it could complete. That could be a question for engineers,

Problem statement: decarbonization is complicated, and above the level of most (or any) community college. A toolkit is methodology or framework and growing body of work, creating a roadmap for decarbonization, that includes early adoption, before mature industry solutions exist. Phase 1 identifies the problem. Creating a process to catalyze decarbonization at the CCC level, a phase 1 approach, that will create awareness. The roadmap could be very similar for the two different sets of schools. Answers may be different, but the process could be similar:

Preparedness:

Energy balance modeling, electricity, natural gas, heating, and cooling. Availability of onsite solar, and/or emission free electricity contracts. Support / commitment letter.

Thesis project (goal) would be to document the process that we are going through to develop a plan to prepare Foothill to decarbonize using advanced energy systems architecture / solutions. Lay the groundwork for continuing our project goal (commitment) of deep decarbonization.

Appendix: Education

APPENDIX E

Robert Cormia presented a short lecture on decarbonization and thermal microgrids to Strategic Energy Innovation (SEI) at a meeting of Climate Corp fellows in Santa Rosa. The presentation was well received, and SEI offered Robert an opportunity to develop curriculum for Climate Corp on the topic of decarbonization. Robert began work on the project in December 2019.

1. Introduction - complex energy systems, decarbonization, and transitional strategies
2. Foundational review of energy systems
3. Transition from utility to distributed generation
4. Energy versus power, the reality of demand charges, and solar PV production curves
5. Integrating energy storage, analysis and management of complex energy profiles
6. Exit natural gas, the rise of building electrification, and heat recovery systems
7. Heat recovery primer
8. Heat recovery assessment toolkit
9. Electric Vehicle (EV) charging
10. Thermal microgrids, total / managed energy systems
11. Decarbonization paths, how do we do this?
12. Partners and projects, building your campus energy future

Target audience

1. Students in certified energy management (CEM) certificate programs
2. Internship training in campus energy systems, especially HVAC central plants
3. Technician training - introduction to heat recovery

Curriculum provided

1. Overview of existing onsite energy technology (solar PV and cogen)
 - a. Existing solar PV curriculum
2. Introduction to microgrid concept (onsite energy generation, energy storage, demand side management, microgrid controller, solar PPA and utility interface)
 - a. Block diagram, definitions, design of small microgrid systems
3. Fundamentals of electric heat pump systems (thermodynamics of heat exchange)
 - a. New curriculum to be shared with engineering faculty
4. Replacement of natural gas boilers with electric heat recovery systems
 - a. Commercial datasheets, heat recovery opportunity toolbox
5. Concept of a thermal microgrid
 - a. Component diagram of microgrid with heat recovery, hydronic systems, additional onsite solar PV, solar PPA, energy storage, microgrid controller
6. Case studies of thermal microgrid modeling, design, and deployment
 - a. Stanford SESI (central plant), Foothill College (EDF study)
 - b. Vendor “total energy solutions”, managed energy microgrids (EDF)

APPENDIX E

Appendix: FHDA-CCD Decarbonization Plan (DRAFT) - Robert D. Cormia - November 2019

Foothill De Anza Community College District (FHDA-CCD), has a long history and commitment to environmental leadership, sustainability, and investment in clean energy technology. This includes infrastructure improvements, LEED certified buildings, and extensive onsite solar energy. On September 17, 2018, Chancellor Judy Miner committed FHDA-CCD to an 80% reduction in Greenhouse Gases (GHGs), during a decade of decarbonization, from 2020-2030. This goal would be achieved through a combination of purchasing clean electricity, replacing natural gas HVAC systems with electric heat recovery infrastructure, and support for Electric Vehicle (EV) charging. These initiatives take time, planning, and resources, combined with commitment, strategy, and management of multi-year projects that are technically complex. These projects are also embedded in the larger evolution of modern energy systems, and the reinvention of modern electric utilities. This executive summary will outline 5 key elements of the FHDA-CCD decarbonization plan, and a path to achieve our goals in the next decade.

1. Purchase of clean electricity (solar PPA)
2. Electric Vehicle (EV) charging support
3. Replacing natural gas HVAC with electric heat recovery systems
4. Developing a thermal microgrid architecture
5. Employing advanced energy management tools / processes

College districts face a number of challenges and opportunities in a path to decarbonization, including funding, planning and expertise, and the ability to manage and integrate complex engineering projects. FHDA-CCD, and specifically Foothill College, working with Electricity de France Innovation Labs in Los Altos, CA, developed the five part plan based on EDF lab's experience working with Stanford University's Energy System Innovation (SESI), the City of Palo Alto, and EDF's experience as a global thought leader in decarbonization.

Purchase of clean electricity (opportunity 2020)

Purchasing electricity sourced from zero carbon emission primary energy (solar, wind, and hydroelectric) is the easiest, fastest, and least expensive step in decarbonization, with significant reduction in reportable GHG emissions, with low incremental cost. Purchasing electricity through cooperative buying collectives makes it even easier and more affordable. The incremental cost for FHDA-CCD to switch to a renewable energy sourced contract is roughly \$100 a day, and reduces reportable emissions by 3,000 tons of carbon dioxide per year, or \$12.5 per tonne CO₂ avoided. As discussed later, developing larger thermal microgrids like SESI may require investment in a solar project, but a purchasing cooperative can lessen the difficulty of this task. (Stanford invested in a long-term solar PPA project for a significant fraction of their electricity, and will "own" the output of the project for ~ 20 years). Plans for purchasing clean electricity are currently being discussed, with a one-year bridge contract available in early 2020, and a solar Power Purchase Agreement (PPA) available in mid-2021.

APPENDIX E

Electric Vehicle (EV) charging support

Beginning in 2013/14, FHDA-CCD installed 10 EVSE charging stations at De Anza College. These chargers experienced difficulty from misuse, software issues, and a lack of support from the vendor (no maintenance contract). In 2019/20, these chargers will be replaced with a more robust solution, including a maintenance contract. Concurrently, a small number of chargers will be installed on the Foothill College campus, primarily at the new District Office. An extensive survey of vehicles in parking lots, and online survey of staff (and later, students) revealed a significant number of Electric Vehicles (EVs), operated by staff and students. An early model was developed to support EV charging based on a 1:5 ratio of EVSE/EV, where ~ 20 EV chargers would be located at Foothill, ~ 25 additional chargers at De Anza, 2-3 at Sunnyvale campus. Initially operating at ~ 4-5 hours a day, at ~ 5 kW (average demand for level 2 charging) the additional power and energy demand would be ~ 100 kW and 80,000 kWh per year, and at De Anza, ~ 125 kW and 120,000 kWh per year. This would equate to about 1% of annual electrical energy use, which could be offset by additional parking lot solar PV, which would also accommodate the transition from natural gas to electric heat recovery systems.

Replacing natural gas with electric heat recovery systems

After switching to carbon free electricity, the remainder of campus emissions arise from natural gas for heating buildings, and cogeneration of heat and power for the swimming pool. Currently, ~ 60% of FHDA-CCD GHG emissions are assigned to natural gas, with about 40% from cogen (cogeneration of heat and power) and 60% from space heating. The Sunnyvale Campus was designed as a nearly all electric building, utilizing electric heat recovery and thermal storage for HVAC. The new District office is all electric, with a solar PV capable roof. Beginning in 2019, Foothill College undertook a joint project with Electricity de France Innovation labs in Los Altos, to develop a model for a heat recovery system, similar to Stanford Energy Systems Innovation (SESI), to replace the natural gas fired boilers and traditional chillers in the central plant. This project, in progress, has shown the potential for heat recovery to lessen heating loads, as reduce the campus's natural gas use by at ~ 60%. The modeling effort will yield a draft specification for the central plant replacement with electric heat pumps, which will be included in a future capital bond (March 2020). If funded, the project would likely be completed ~ 2025.

Developing a thermal microgrid architecture

Distributed generation has long been part of the FHDA-CCD energy strategy, including significant onsite solar PV, as well as cogeneration of heat and power. Onsite energy production provides nearly half of Foothill's electric energy needs, and about a third of De Anza's electricity needs. As the District plans to replace natural gas with electric heat recovery systems, and as EV charging needs grow, each campus will need more power (kW) and energy (kWh), especially as utilities enforce time-of-use tariffs, as well as need integrated demand side management, to both balance an increasingly decentralized power system, as well as distribute increasingly larger flows of solar energy, especially as Renewable Portfolio Standards (RPS) surpass 33% and grow to 50% by the end of the decade. Energy storage is the technical

APPENDIX E

mediator between solar energy over generation, and peak shaving (demand management). Thermal microgrids, a concept developed by Electricity de France, in concert with Stanford (SESI) to describe the combination of electric microgrids, heat recovery and thermal energy storage, electric energy storage, EV charging, and a microgrid controller, with the ability to monitor and manage campus power demand, local power generation, and interface (and integrate) with the local distribution grid, and larger transmission system, where large utility scale generation (the source of Power Purchase Agreements) exist. Thermal microgrids generate, store, manage, and distribute electrical and thermal energy, in a highly integrated manner, with clean energy electric inputs, merged with local onsite solar generation, and blended utility energy. Thermal energy microgrids are more complex to develop, more complicated to operate, and requires rigorous modeling and design. New buildings with electric heat recovery (and thermal energy storage), onsite solar PV, electric energy storage, and integrated microgrid controllers with demand side management, are more straightforward to design, then the comprehensive replacement of natural gas in large-scale central plant designs.


Employing advanced energy management tools / processes

Operating a thermal (total energy) microgrid, i.e., a “managed energy system” requires sophisticated integrated energy and data management tools, powered by machine learning systems that build experience into active energy management. This includes buildings, central plants, energy storage, EV charging, and Integrated Demand Side Management (IDSM) which ties local managed energy systems into the surrounding electric power distribution grid. Energy management tools will likely evolve as part of the new system architecture, as Stanford (SESI) has done with Johnson Controls. Advanced energy management provides benefits in the cost of energy, alleviating congestion during peak demand, maximizing the distribution of solar energy generation, alleviating curtailment, and ensuring the EV charging does not cause excessive power and energy use, especially during peak demand.

Together, these five trends will unite clean sources of electricity with modern electric building systems, thermal energy storage, active energy management, and support for electric mobility. FHDA-CCD is committed to a decade of decarbonization, beginning with the purchase of clean electricity, followed by a thoughtful budgeting of funding for an electric heat recovery / thermal energy HVAC infrastructure replacing natural gas fired boiler systems. It is imperative that Foothill College finish its collaborative study with EDF, to provide a reasonable cost estimate for a capital bond measure, the most likely source of funding for the infrastructure development.

This decarbonization plan will be further described in the FHDA-CCD facilities and energy master plan. We also plan to coordinate our energy system planning and development process with other community colleges of similar age and infrastructure, also facing the challenges and opportunities of decarbonization. This is especially important in helping California meet accelerated 2030 - 2050 decarbonization goals, including electrification of transportation.

Thermal Microgrids: Technology, Economics and Opportunity

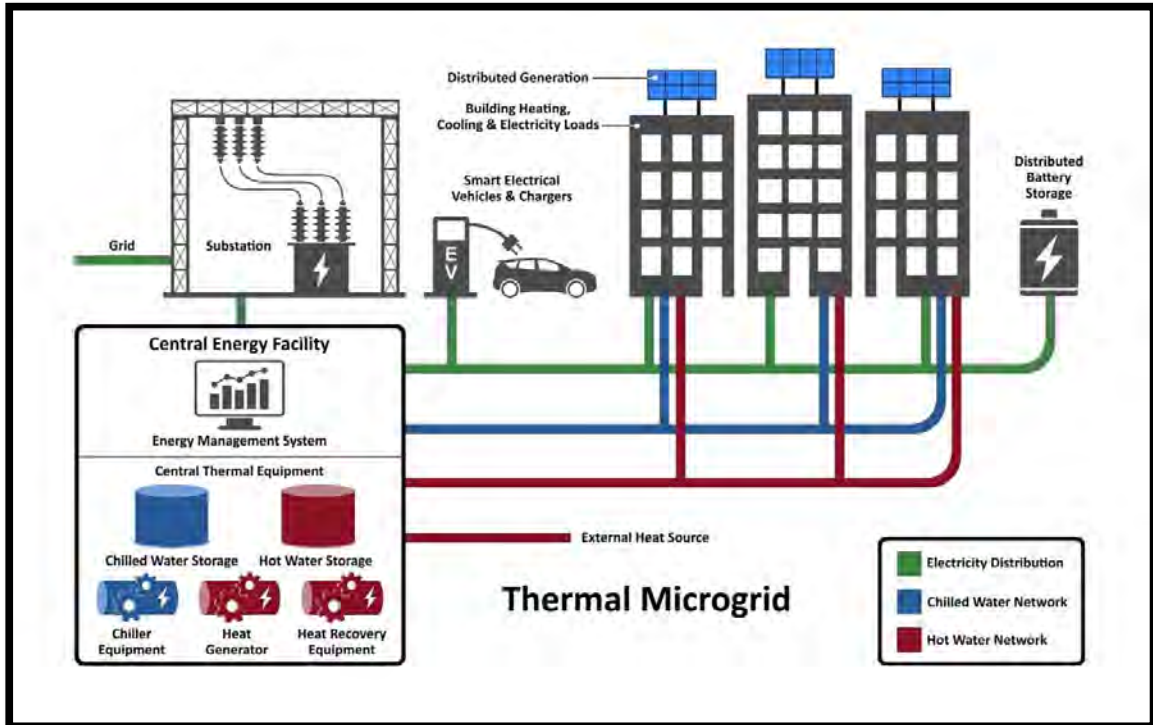

EDF Innovation Lab

Aimee Bailey, PhD
Stephanie Jumel, PhD

December 2017

Funding provided by:



About this Report

This report was completed as a part of a collaboration between EDF Innovation Lab, Stanford University and the City of Palo Alto Utilities for the project *Leveraging Experience from Stanford and EDF to Develop Information and Tools for Thermal Microgrid Feasibility Assessments*, funded by the American Public Power Association (APPA) Demonstration of Energy & Efficiency Developments (DEED) program. The project objective is to provide information and tools to support municipal utilities in evaluating the feasibility of deploying thermal microgrids. Deliverables of the project include i) a white paper describing the technology, economics and market of thermal microgrids and comparing them to alternatives (this report); ii) a case study report describing the Stanford Energy System Innovations (SESI) project, in which their campus-wide cogeneration system was transformed into to renewable electricity powered heat recovery with low temperature hot water distribution; iii) a suite of tools for assessing technical and economic feasibility; and iv) two municipal case studies applying the tools to carry out feasibility assessments.

Contact

For questions or comments regarding this report, please contact:

Aimee Gotway Bailey, PhD
Principal Energy Analyst
EDF Innovation Lab
aimee.bailey@edf-inc.com
p: +1 650-209-3904
m: +1 650-284-9062

For questions regarding APPA's DEED program, please contact the program administrator:

Michele Suddleson
DEED Program Director
American Public Power Association
MSuddleson@publicpower.org
p: +1 202-467-2960
m: +1 240-876-1519

© 2017 EDF
EDF Innovation Lab
4300 El Camino Real
Los Altos, CA 94022, USA

Reference:

Thermal Microgrids: The Technology, Economics and Opportunity; Report Nr. EIL-R-2017-1231, December 31, 2017, EDF Innovation Lab, Los Altos, USA

Acknowledgements

First, the authors gratefully acknowledge funding from the American Public Power Association (APPA) Demonstration of Energy & Efficiency Developments (DEED) program and the ongoing program management support and guidance from Michele Suddleson, DEED Program Director.

In addition to the APPA, several individuals and organizations contributed to this white paper by providing their perspectives, expertise and feedback. The authors gratefully acknowledge the contributions of two stakeholder groups convened through the project.

The Utility & Other Users Forum (abbrev. “Utility Forum” or “Stakeholder Forum”) reviewed and provided feedback on the white paper outline and draft report to ensure applicability and transferability of the results to a broad audience. Utility Forum participants included representatives from the APPA DEED membership, California’s Investor-Owned Utilities (IOUs), community choice aggregator (CCA) community, and several commercial entities.

Peer Reviewers for the white paper were comprised of renowned industry experts representing multiple sectors (e.g. regulatory entities, non-profit organizations, private sector, etc.). Their contributions led to rigor and accuracy of the deliverables.

- ❖ Jeff Byron, former California Energy Commissioner
- ❖ Keith Dennis, National Rural Electric Cooperative Association
- ❖ Bertrand Guillemot, Dalkia (EDF Group)
- ❖ Jerry Schuett, Affiliated Engineers
- ❖ Robert Turney, Johnson Controls
- ❖ Joe Vukovich, Natural Resources Defense Council

The authors are responsible for the final content and any mistakes.

Table of Contents

About this Report	2
Contact	2
Acknowledgements	3
Table of Contents	4
List of Acronyms	6
Executive Summary	8
1. Introduction & Background	10
1.1 What is a “Thermal Microgrid”?	11
1.2 Recent Trends Driving Interest in Thermal Microgrids	13
1.3 Goals and Objectives for Local Energy System Development	14
1.4 Summary of Opportunity	15
2. Technology Description	17
2.1 Central Equipment	17
2.1.1 Heat Sources	17
2.1.2 Cooling Sources	19
2.1.3 Thermal Storage	19
2.2 Thermal Network	20
2.2.1 Integrating Heat Supply into the Thermal Network	21
2.2.2 Thermal Network Piping	22
2.3 Building Interconnection Equipment	22
2.4 Building Heating and Cooling Equipment	23
2.5 Energy System Performance	23
3. Overview of Project Economics	24
3.1 Primary Fixed Costs	24
3.1.1 Central Equipment Costs	24
3.1.2 Thermal Network and Building Interconnection Costs	24
3.2 Primary Ongoing Costs	25
3.3 Other Costs	25
3.4 Synergies with Other Utility Services & Customer Needs	25
3.5 Comparison of Project Economics Across System Design	26
4. Feasibility Assessment	28
4.1 Pre-Feasibility Assessment for Thermal Microgrid Design	29
4.2 Methodology for Techno-Economic Feasibility Assessment	31
4.3 Key Feasibility Drivers	32
5. Assessment of Potential in the U.S.	34
 EDF Innovation Lab	 4

6. Utility Business Models for Thermal Services	36
6.1 Ownership & Governance Structure	36
6.2 Metering & Rate Structures	37
7. Conclusions, Outlook & Next Steps	39
Appendix A. Further Reading	40
Appendix B. Energy Technology Potential Assessment	41
B.1 Introduction to Technology Potential Assessments	41
B.2 Application to Thermal Microgrids	42

List of Acronyms

Acronym	Term
AMI	Advanced Metering Infrastructure
APPA	American Public Power Association
BAU	Business as Usual
BTU	British Thermal Unit
CCA	Community Choice Aggregation
CCF	Centum Cubic Feet
CCHP	Combined Cooling, Heat and Power
CHC	Combined Heat and Cooling
CHP	Combined Heat and Power
DEED Program	Demonstration of Energy & Efficiency Development Program
DER	Distributed Energy Resource
DG	Distributed Generation
DHC	District Heating and Cooling
DOE	Department of Energy
DR	Demand Response
EIA	Energy Information Administration
ETS	Energy Transfer Station
GHG	Greenhouse Gas
GIS	Geographic Information System
GJ	Gigajoule
GW	Gigawatt
GWh	Gigawatt-hour
HHV	Higher Heat Value
HP	Heat Pump
HRC	Heat Recovery Chiller
HVAC	Heating, Ventilation, and Air Conditioning
IDEA	International District Energy Association

Acronym	Term
IEA	International Energy Agency
IOU	Investor Owned Utility
IRR	Internal Rate of Return
kW	Kilowatt
kWh	Kilowatt-hour
LCA	Life cycle assessment
LCOE	Levelized Cost of Electricity
MES	Multi-Energy System
MMBTU	Million British Thermal Units
MW	Megawatt
MWh	Megawatt-hour
NPV	Net Present Value
NREL	National Renewable Energy Laboratory
O&M	Operations and Maintenance
POU	Publicly Owned Utility
PV	Photovoltaic
PVC	Present Value Cost
SESI	Stanford Energy System Innovations
SHP	Separate Heat and Power
SPV	Special Purpose Vehicle
TWh	Terawatt-hour
UNEP	United Nations Environment Programme

Executive Summary

Addressing global climate change is the single greatest environmental challenge and opportunity faced by humankind. Energy provided for transportation, agriculture, industry, and buildings has enabled the vast advancement of humanity, yet the way humankind is producing, managing and using energy is threatening its very long-term existence. This report provides information about energy usage specifically in the buildings sector, and outlines a practical pathway for providing energy to buildings in a sustainable and economic way. The report includes information on a case study of how this has already been implemented at scale, as well as providing tools to help others evaluate such systems for their buildings.

Based on multiple studies carried out across the energy community in numerous countries, the emerging practical and scalable pathway to sustainable building energy supply is the combination of electrification and clean energy, following economic and sustained application of energy efficiency efforts. This conclusion is driven by the relative techno-economic feasibility of decarbonizing the generation of electricity as opposed to the use of renewable natural gas or transitioning to non-carbon fuels such as hydrogen. Power and cooling of buildings, when electricity-based, is readily made sustainable upon decarbonizing the electricity source. Heating and hot water, on the other hand, is predominantly supplied by fossil fuel such as natural gas. Decarbonization heating and hot water therefore requires a switch to a different, non-fossil fuel powered equipment.

Building electrification, however, need not rely on electric resistance appliances alone: electric-powered heat pumps can help catalyze this technological transformation. Electric heat pump appliances are commercially available and even more efficient than electric resistance and natural gas appliances, which unlocks the technological and economic transition to an all-electric system for building energy supply. Furthermore, heat pumps are flexible in that they can be used both to harvest waste heat from existing building cooling processes (heat recovery) as well as extract heat from ground, water, or air sources to augment heat recovery when needed in winter when waste heat alone is insufficient to meet building heating and hot water needs.

Discussions of building electrification and supporting policies have been gaining traction, yet the primary focus is building-level appliance switch-out (i.e. switching from a natural gas to an electric water heater in a building). An alternative approach is to develop a decarbonized energy system that is optimized for a group of buildings. These district energy systems are networks of underground pipes carrying steam, hot, or cold water used to heat and cool buildings. District energy has many advantages compared to building-level alternatives, including economies of scale from aggregating a collection of loads from numerous buildings; waste heat recovery technologies that are not available or efficient at a building-level scale; and, load and resource diversity that enable optimized central equipment sizing and resultant enhanced efficiency. Deploying heat pumps via a district energy system, adding thermal energy storage, and using advanced energy management programs can increase the efficiency and system resiliency, and lower the cost of electrification such that it becomes the least cost alternative for long term building energy supply. Collectively these components can be thought of as a thermal energy microgrid, much in the same way the combination of on-site renewable electricity, electricity storage, and electric vehicles can be thought of as an electric microgrid. The concept of electric microgrids has gained much attention as of late, yet given that two thirds of total energy use in buildings is thermal while electricity is but one-third, greater attention should be focused on the opportunity.

This white paper explores district-scale electrification incorporating both electricity and thermal (heating and cooling) services via so-called thermal microgrids as a technical pathway for decarbonization. Stanford University's campus energy system is the inspiration of the thermal microgrid approached and used throughout the white paper to illustrate its potential for achieving environmental, economic and other requirements for local energy systems.

1. Introduction & Background

Addressing global climate change is the single greatest challenge and opportunity faced by humankind. The energy sector in specific must play a decisive role in enabling the successful transition to a decarbonized economy, given that energy generation and usage contributes disproportionately to historic and current global greenhouse gas (GHG) emissions. Within the U.S., buildings are responsible for approximately 40% of all energy usage and a third of emissions, a significant portion of which is from appliances burning natural gas and other carbon-based fuels for heating and cooking¹. The continued use of carbon-based fuels in buildings is not sustainable unless either supplanted by sustainable biogas sources or coupled with carbon capture and storage (CCS). However, both biogas and CCS are more expensive, less efficient, and impractical at scale compared to electrification combined with clean electricity². Therefore, substantial fuel switching in the building sector from fossil fuel to electricity - also called electrification - combined with continued electricity decarbonization and energy efficiency are required to achieve science-based GHG emissions reductions targets³. These are also the conclusions of the international energy community as shown in references cited throughout the report.

Discussions of building electrification and supporting policies have been gaining traction in some regions⁴, yet the primary focus is building-level appliance switch-out (i.e. switching from a natural gas to an electric water heater in a building). However, with increasing energy efficiency practices reducing building heating and cooling loads, it may be increasingly difficult to size equipment appropriately. One could alternatively take a district approach and develop a decarbonized energy system that is optimized for a group of buildings. In fact, in 2013, the United Nations Environment Program (UNEP) surveyed low-carbon cities worldwide to understand key factors for their success in achieving zero or low GHG emissions targets and increased integration of energy efficiency and renewable energy, and district energy was identified as a best practice approach for providing a local, affordable and low-carbon energy supply⁵. District energy systems are networks of underground pipes carrying steam or hot/cold water used to heat and cool buildings. Historically, district energy development accelerated in the late twentieth century to achieve higher primary energy efficiency when the systems relied on volatile, imported fossil fuels, and to combat urban air pollution from open coal fires and oil-fired boilers. District energy systems have many advantages compared to building-level alternatives, including economies of scale from aggregating a collection of loads from dozens of buildings; waste heat recovery technologies that are not available or efficient at a building-level scale; and, load and resource diversity that enable optimized central equipment sizing and resultant enhanced efficiency.

¹ U.S. Energy Information Agency; U.S. Environmental Protection Agency's "Inventory of U.S. Greenhouse Gas Emissions and Sinks: 1990–2015"

² California's Energy Future: The View to 2050, California Council on Science and Technology, May 2011; Williams, J.H. et. Al., The Technology Path to Deep Greenhouse Gas Emissions Cuts by 2050: The Pivotal Role of Electricity, Science, Volume 335, January 6, 2012; Pathways to Deep Decarbonization, Deep Decarbonization Pathways Project; Southern California Edison's The Clean Power and Electrification Pathway Realizing California's Environmental Goals (Nov 2017).

³ Ibid.

⁴ E.g. California


⁵ United Nations Environment Programme, District Energy in Cities - Unlocking the Potential of Energy Efficiency and Renewable Energy (2015)

This white paper explores district-level electrification incorporating both electricity and thermal (heating and cooling) services via so-called thermal microgrids as a technical pathway for decarbonization. The objective of this white paper is to address the following questions.

- What is a “thermal microgrid”?
- What are the advantages and disadvantages of thermal microgrids compared to alternatives?
- What are the costs, GHG emissions impacts and water usage requirements compared to alternatives?
- What are the primary feasibility drivers?
- What is the potential of this technology in the U.S.?
- What business model structures could a municipal utility use for delivering thermal services via a thermal microgrid?

1.1 What is a “Thermal Microgrid”?

Figure 1: Illustration of a thermal microgrid

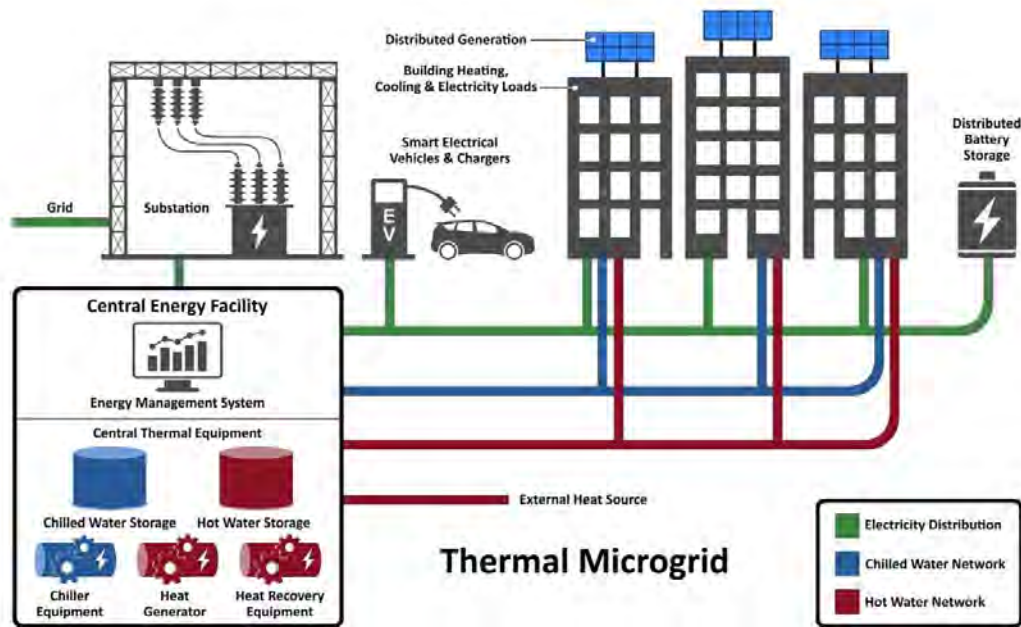

We define a thermal microgrid as follows.

A thermal microgrid utilizes energy efficiency; renewable electricity powered heat recovery; thermal storage; and, advanced analytics and controls to provide co-optimized power and thermal services to a group of interconnected and controllable energy loads within a defined boundary.

The concept is illustrated in Figure 1. The term *microgrid* is used to emphasize benefits associated with traditional electricity-focused microgrids, such as local renewable energy utilization, enhanced community resilience and reliability, systems-optimized control and dispatch of the collection of loads

and resources, and ability to meet critical loads during larger grid disturbances. The adjective *thermal* is added to denote that the microgrid also incorporates thermal services such as hot water, steam, and/or chilled water, in addition to electricity. Similar concepts have been introduced in prior studies, leading to a variety of other terminology, such as *energy district*, *multi-energy system*, *renewable district energy*, *multi-energy microgrid*, *energy microgrids*, *smart energy system*, and, most significantly, *4th generation district heating*⁶.

The hallmark of a thermal microgrid is the utilization of renewable electricity powered waste heat recovery as the cornerstone of the system design, enabled by low-temperature district heating networks and low energy buildings. At its heart, it is district scale electrification. This new category of district energy systems is inspired by Stanford’s recent transformation of their cogeneration system to a thermal microgrid, called Stanford Energy Systems Innovation (SESI)⁷. Burning fossil fuels in traditional district energy systems (e.g. combined heat and power) is replaced in thermal microgrids by advanced heat recovery utilizing heat pumps powered by renewable energy generation, either on-site or from grid-supply.

Table 1: Common energy system architectures

Non-District Energy Systems	<ul style="list-style-type: none"> ● Building-Level refers to an energy system configuration where buildings use electricity and/or gas to power on-site appliances for heating and cooling needs.
District Energy Systems	<ul style="list-style-type: none"> ● Separate Heat and Power (SHP, District Heating or District Cooling) is a heat or cooling network that provides thermal services independently from the generation, management and provision of power. ● Combined Heat and Cooling (CHC) is the use of a centralized system to simultaneously provide heat and cooling services for a district. ● Combined Heat and Power (CHP or cogeneration) is the use of a centralized plant to simultaneously generate electricity and heat for a district. ● Combined Cooling, Heat, and Power (CCHP or trigeneration) is the simultaneous generation of electricity, heat and cooling for a district.

Most regions of the U.S. rely on building-level energy systems (Table 1, top). However, district energy systems are widespread across Europe and Asia, in addition to being prevalent in certain applications in the U.S., including specifically the central business districts of major cities, hospitals, university and corporate campuses, and military bases. There are several possible district energy system architectures, as outlined and defined in the bottom of Table 1. Traditional district energy in the U.S. uses fossil fuels as the main heating source and steam as the energy carrier. More recently, natural gas has emerged as a preferred fuel source given its availability, price, and reduced emissions, and hot

⁶ Henrik Lund, Sven Werner, Robin Wiltshire, Svend Svendsen, Jan Eric Thorsen, Frede Hvelplund, Brian Vad Mathiesen, “4th Generation District Heating (4GDH) Integrating smart thermal grids into future sustainable energy systems”, Energy 68 (2014) p1.

⁷ <https://sustainable.stanford.edu/campus-action/stanford-energy-system-innovations-sesi>

water is increasingly used as the energy carrier in place of steam. Heat distributed to buildings can be used for space and water heating, or it can be processed by an absorption chiller to be converted to chilled water for cooling.

The primary district energy system architectures represent traditional architectures largely developed with fossil-fuel fired technologies. Thermal microgrids could fall under Combined Heat and Cooling (CHC) or Combined Cooling, Heat and Power (CCHP), depending on whether there is significant renewable energy supply located on-site (CCHP) or sited remotely from utility-scale plants (CHC)⁸. Although there need not be power generation on-site, the power system is not separate and independent from the thermal network: there is substantial coordination and optimization between electricity usage and the thermal networks, primarily via centralized thermal storage, leading to enhanced opportunities for efficiency gains. For instance, thermal storage incorporated into SESI enables over 20% more waste heat recovery from the overlap in heating and cooling needs across campus. Moreover, thermal storage incorporated into a central energy facility design enables electricity load shifting from on-peak to off-peak periods, enhances reliability and resilience by being able to continue to provide thermal services during grid disturbances, reduces the installed chiller capacity requirements, and aids in the integration of local, variable renewable energy generation. None of these benefits can be realized with building-level systems or any energy system configuration where the operation of the electricity and thermal networks are largely decoupled.

Please see section 2 for greater detail of the description of the technologies underlying thermal microgrids and alternatives.

1.2 Recent Trends Driving Interest in Thermal Microgrids

Industry experts and prominent academics cite the “three D’s” as the primary drivers behind the current energy system transformation: decentralization, decarbonization and digitization⁹.

- **Decentralization.** The traditional paradigm of centralized power generation is being up-ended with the rise of customers and communities opting to take greater control over their energy production, management and use. Increasing adoption of behind-the-meter solar, smart thermostats and other building energy management devices enabled by exponentially decreasing costs and novel business/financing structures¹⁰ combined with capacity and reliability considerations of the transmission grid are leading to a new, decentralized grid paradigm. Currently, distributed solar generation is estimated to reach 140 gigawatts (GW) by 2040, up from only 2 GW in 2010¹¹.
- **Decarbonization.** Local and state governments across the U.S. have adopted climate goals and corresponding energy policies and regulations to promote decarbonization of the energy

⁸Traditional CHP and CCHP systems combust fossil fuel in an integrated process to generate electricity and heat simultaneously. In this white paper, CHP and CCHP need not refer to an integrated thermal process, but simply to co-locating power generation within the thermal microgrid boundaries and integrating it into the overarching system optimization, management and control.

⁹ <https://energy.stanford.edu/from-directors/nurturing-innovation-during-strategic-inflection-point-global-energy>

¹⁰ E.g. third-party ownership models for rooftop solar (lease and power purchase agreements)

¹¹ [https://www.eia.gov/outlooks/aeo/pdf/0383\(2017\).pdf](https://www.eia.gov/outlooks/aeo/pdf/0383(2017).pdf)

sector. Prominent policies include, for instance, renewable portfolio standards, incentives for distributed renewables deployment, and cap-and-trade programs for GHG emissions. These collective policies have supported renewables deployment, such that in 2016, renewables have grown to make up two thirds of all electricity capacity additions¹².

- **Digitization.** Currently, nearly half of U.S. electricity customers have advanced metering infrastructure (AMI) (aka *smart meters*) - the backbone of the smart grid transformation - which represents a doubling of AMI deployment since 2010¹³. More generally, the increased deployment of low-cost sensors, advanced control technologies, and artificial intelligence is fundamentally changing every facet of the energy sector, from home thermostats to utility rate-making.

The same three drivers behind the larger energy system transformation are ultimately responsible for driving interest in thermal microgrids, which are a decentralized technical pathway for achieving deep decarbonization enabled by advanced digital capabilities.

1.3 Goals and Objectives for Local Energy System Development

As referenced above, there are several considerations for local energy system deployment, and stakeholders must first identify and prioritize goals to evaluate a thermal microgrid versus an alternative energy system. The following are the most typically cited categories of goals, many of which are interrelated. Once goals are identified, stakeholders then identify objectives used to achieve each goal, which may be qualitative and/or quantitative. The goals and objectives are prioritized based on the community's shared priorities and values, taking into account the relative trade-offs between each.

- **Economics.** Energy and thermal services costs are a primary concern for all stakeholders. Thermal microgrids leverage economies of scale and enhanced efficiency to reduce costs, as does any district energy approach. The efficiency gains through advanced heat recovery improves the economics further. An economic assessment of a local energy system is typically evaluated using present value costs of the system over the lifetime, which can be compared across a variety of different system designs incorporating both electricity and thermal services.
- **Reliability and resiliency.** Communities that are prone to natural disasters and/or that have customers with critical loads may identify reliability and resiliency as a system design goal. Thermal microgrids incorporate distributed energy and storage and advanced analytics and controls, which enables detection and ride-through of local grid disturbances. Thermal microgrids, like CHP¹⁴, can be used to enhance reliability and resiliency.
- **Reliance on fossil fuels.** The reliance of an energy system on fossil fuels has price risk implications, in addition to environmental ones. Historically, price shocks of imported fossil fuels have resulted in reduced rate stability. Although domestic production of natural gas through fracking has resulted in low prices for multiple years, the lifetime of an energy system can be up to 40 years. Natural gas prices over this period are uncertain. Price risk volatility can

¹² <https://www.eia.gov/todayinenergy/detail.php?id=25172>

¹³ <https://www.eia.gov/electricity/data/eia861/>

¹⁴ http://www1.eere.energy.gov/manufacturing/distributedenergy/pdfs/chp_for_reliability_guidance.pdf

be mitigated by transitioning to advanced waste heat recovery and renewable energy in the thermal microgrid design.

- **Environmental impact.** Minimizing the environmental impact of the energy system is another key goal of cities, campuses, and utilities driven by community preferences for renewables and action on climate change. Thermal microgrids are highly efficient because of their use of advanced waste heat recovery and renewable energy, enabling them to achieve environmental outcomes not possible on a building-level scale at comparable costs or at a district scale utilizing fossil fuel based systems. GHG emissions, local particulate matter and indoor air quality are the most common focus areas, all of which are improved using thermal microgrids.
- **Water usage.** Especially in drought-prone regions, water usage is a key consideration of the energy system design, due to both financial impact and availability of a scarce resource. Leveraging advanced waste heat recovery using heat pumps in the thermal microgrid design reduces water usage, because the waste heat that is recovered would in most cases be discharged using evaporative cooling towers.
- **System flexibility.** Given that energy systems can have a lifetime of up to 40 years, the ability of the energy system to meet future community needs and do so in a way that minimizes the prospect of stranded assets is another key consideration, especially in regions experiencing significant growth. Thermal microgrids can source electricity and heat using several types of technologies, allowing a community flexibility to optimize supply over the long lifetime of the system.
- **Local economic development.** As opposed to utility-scale power generation sited in remote areas of the state used to power building-level equipment, thermal microgrids incorporate central energy facilities (e.g. heat pumps, thermal storage) sited locally, which grant the opportunity for local workforce and business development.
- **Local control.** Another key goal of developing a local energy system is also simply for the community to have local control.

As discussed under each category above, thermal microgrids rank favorable in each category.

1.4 Summary of Opportunity

Given the transformation of the energy sector driven by the “three D’s” (section 1.2), now is the time to explore the role of thermal microgrids for achieving clean, affordable and reliable energy systems to serve communities. Public power is uniquely positioned to lead the exploration and development of thermal microgrids, for several reasons. First, municipal electric utilities considering a prospective thermal microgrid are in an informed position to evaluate and act on trade-offs and synergies with other public sector utilities. Municipalities often have several public-owned utilities in addition to electric power, such as wastewater and potable water systems. These additional systems/services can be utilized for heat recovery and exchange in the thermal microgrid, as discussed in greater detail in section 2.2. Similarly, electric and thermal utility services can achieve cost savings through coordinating trenching. A waste heat recovery based system will obviate the need for a local cooling tower, and the associated health risks (e.g. Legionnaires' disease). A municipal electric utility can assess these trade-offs and synergies to maximize the cost-effectiveness across the provision of utility services to the

community. Second, the thermal microgrid, like an electric-only microgrid, is embedded in the larger grid. Public power can standardize interconnection procedures and develop innovative policies and rate structures that harness the value in the flexible and controllable load. Third, the success of local energy system deployment hinges on the ability to navigate complex, multi-stakeholder processes to achieve community goals. Public power agencies have decades - in some cases over a century - of experience serving their communities by leading energy infrastructure deployment, making them ideal entities for steering thermal microgrid development. Fourth, historically, municipal utilities across the U.S. have shown leadership on environmental issues. Direct accountability to the communities they serve enables public power more flexibility in prioritizing non-economic goals of the local energy system (e.g. environmental impact), compared to for-profit utility business models. For all the above reasons, there is arguably no better institution than public power to lead thermal microgrid exploration.

2. Technology Description

As described in the prior section, a *thermal microgrid* utilizes a combination of energy efficiency, thermal storage, and renewable energy powered waste heat recovery or other renewable heat supply to provide co-optimized power and thermal services to a group of interconnected and controllable energy loads within a defined boundary. A thermal microgrid therefore includes several categories of technologies, including:

- one or more **heat and cooling sources**, including **thermal storage**;
- one or more **power generation systems**¹⁵, from clean energy, either located on-site or remotely;
- a **thermal network** of pipelines - including both supply and return – running from the central energy facility to the buildings; and
- **building interconnection equipment** to couple the thermal network to the heating and cooling systems located at the customer site.

Thermal microgrids, like other district energy systems, provide significant flexibility since several technology options are available for most of these functions, and indeed heat and electricity supply sources may be swapped out over time given changes in policies and technology costs and performance. Ultimately, the combination of technologies selected for the final system design depend on the scale of the project, local resource availability, and special performance characteristics, among other factors, and must be analyzed on a case-by-case basis.

The following three sections provide an overview of technology options incorporated into a thermal microgrid, divided into three categories: central equipment, thermal network, and building interconnection equipment. The fourth and final section considers the various energy system architectures (Table 1) and the resultant range of estimated systems efficiency, emissions, and water usage one can expect given available technology choices compared to conventional alternatives.

2.1 Central Equipment

2.1.1 Heat Sources

The viability of a district energy system hinges on availability of a low-cost heat source. Heat can be generated or recovered from a variety of sources, either as single output process or in conjunction with power (e.g. CHP). The historical choice for heat production is a thermal power station or a dedicated CHP plant. In the framework of achieving deep decarbonization, however, there are multiple renewable/recovered heat sources that can deliver high-temperature (high grade) heat. Others can provide low-temperature (low grade) heat and then be used in conjunction with heat pumps to achieve a higher output temperature. Table 2 describes a variety of renewable/recovered heat sources that can be leveraged for a thermal microgrid, categorized by high-grade and low-grade heat.

¹⁵ Background information on renewable electricity generation systems are not addressed in this report.

Table 2: Possible waste and renewable heat sources, categorized as either high-grade or low-grade heat

High Grade Heat	<ul style="list-style-type: none"> ● Waste Heat Recovery from Industrial Processes (200-1,800 °F). Waste heat from industrial processes is commonly available, varying in temperature from extremely hot process industry flue gases down to lower temperature refrigeration exhaust. This heat source is often used in large-scale district energy systems, or for more localized systems when combined with other heat sources. ● Deep Geothermal (150-350 °F). Recovering geothermal heat requires deep boring into the ground. Boring costs are substantial and can make this renewable energy source cost-prohibitive depending on specifics of the site. Yet when economically feasible, deep geothermal offers a renewable heat source for base load needs. ● Waste Heat Recovery from Municipal Waste Incineration (130-300 °F). The combustion of municipal waste to provide electricity and/or heating (aka <i>waste-to-energy</i>) has been practiced in Europe for many years. Waste incineration occurs continuously throughout the year, making this a base load heat source. ● Biomass (130-300 °F). Biomass can be used as fuel for large boilers or for CHP plants, a common choice for district energy systems. Sources of biomass include wood chips, clean construction and demolition lumber, yard waste, tree trimmings and multiple forms of agricultural waste such as oat hulls, etc. Biomass can also be used within existing fossil-fueled boilers as a co-firing to reduce emissions. ● Solar Thermal (175-275 °F). Using solar energy as a heat source for district energy systems was traditionally considered infeasible on a year-round basis and utilized only for seasonal heat. Now by integrating thermal storage capacity, solar thermal energy is viable at almost any latitude for many countries. The solar energy can either augment existing heat sources in a thermal network, or feed a stand-alone system incorporating thermal storage to provide thermal heating year-round.
Low Grade Heat	<ul style="list-style-type: none"> ● Waste Heat Recovery from Building Cooling Process (50-80 °F). Stanford's state-of-the-art system uses the overlap in heating and cooling needs by capturing waste heat from the cooling network return pipe. The overlap in thermal needs leading to opportunity for waste heat recovery has been found to be a robust phenomenon across climate zones and building uses, and should be the first heat recovery source to be pursued given the same heat pump equipment can be used for both heating and cooling needs to capture this opportunity¹⁶. ● Waste Heat Recovery from Municipal Wastewater (50-80 °F). Sewage is a heat source that is available in almost every community. A few degrees of heat can be extracted before or after sewage treatment. In the former case, the heat source is, of course, contaminated. In the latter case, the process is post-sanitation, but source temperature is significantly lower. ● Shallow Geothermal (50-80 °F). Shallow geothermal (aka <i>geoexchange</i>) is the recovery of heat from within several yards of the earth's surface, where the temperature remains relatively constant. Shallow geothermal as a heat source is becoming increasingly common for district energy systems. ● Other Waste Heat Recovery Opportunities. There are a variety of other sources of waste heat, a largely untapped potential energy source, including high heat loads from data centers and air- and water-source heat.

¹⁶ See the SESI case study companion deliverable for more information.

Incorporating multiple heat sources is a standard strategy to improve overall energy system efficiency and increase the penetration of renewable heat sources. Choosing the heat source or sources that are best suited for a local energy system depends upon local resources, climate, system design parameters, source temperature, and customers' thermal needs, among other factors.

2.1.2 Cooling Sources

District cooling has potential to help overcome challenges in the cooling sector¹⁷ compared to a building-level cooling approach, while providing multiple additional benefits as described in section 1.3. Conventionally, large commercial customers have electric chillers on-site, which use electricity and a refrigeration cycle to produce cooling. District cooling schemes similarly incorporate chiller equipment in a central plant to produce chilled water. Other cooling source options include the efficient use of renewable electricity in large heat recovery chillers (water-to-water heat pumps), the combination of absorption heat pumps/chillers with a heat source such as those listed in the prior section, or natural cooling (aka *free cooling*) from surface water when considered to not be an environmental concern. Table 3 shows the primary cooling sources used in district energy systems.

Table 3: Cooling sources

- **Heat Recovery Chillers (HRCs) in a Heat Network.** As illustrated by SESI, cooling can be produced from a heat network using large HRCs located at a central plant.
- **Absorption Heat Pumps/Chillers with a Heat Source.** A heat source can be used to produce chilled water using absorption heat pumps/chillers, either located at the building site or at a central plant. Alternatively, a centralized trigeneration system utilizing similar equipment can produce a separate cold supply to serve a district, in addition to power and heat.
- **Surface Water (40-75 °F).** Also known as hydrothermal, lakes, rivers and oceans can be used as cooling source or as a heat sink. Some systems use surface water not just as a cooling source, but in a combined scheme to prepare or provide potable water supply, such as Toronto District Cooling. When the source temperature is not sufficiently low to directly feed the thermal network, a chiller is used to reduce the temperature.

2.1.3 Thermal Storage

Thermal storage is a key technology for enabling optimized system operation of a thermal microgrid. Thermal storage systems incorporated into the overall energy system design can increase the amount of heat recovery potential that can be economically exploited, enable electricity load shifting from on-peak to off-peak periods, enhance reliability and resilience by being able to continue to provide service during grid disturbances, and reduce the chiller capacity requirements. To achieve these use cases, the storage system is charged and discharged daily based on results from system-wide optimization. Chilled water is the most common form of cool storage, although ice or ice slurry could also be used. Hot storage is simply hot water, although hot storage is less common in the U.S. compared to Europe.

¹⁷ For instance, in large swaths of the U.S., the system peaks of the electricity grid are driven by AC load, and some building cooling needs are increasing given growth of computer and server use, which are heat generators.

2.2 Thermal Network

The *thermal network* is the distribution network of pipes, energy transfer stations, valves and controls to deliver steam, hot water or chilled water from a central energy facility to end customers. Each service in a thermal network consists of a pair of pipes: the *supply* that carries water or steam from the central energy facility to end customers, and the *return* that carries water or steam/condensate back from the end customers to the central energy facility. A district energy approach to serving a community will have an advantage over a building-level approach whenever the cost savings of the energy source and central equipment compared to conventional building-level systems is greater than the capital costs of the distribution network. Therefore, design choices of the thermal network and resultant costs and savings play a significant role in overall district energy system cost-effectiveness. Figure 2 illustrates the three types of thermal networks.

- A **heat network** directly provides the required heat supply to the buildings. A heat network can also provide cooling at the building via on-site absorption chillers.
- A **cooling network** directly supplies the required cooling supply to the buildings. It can also provide heat at the building via on-site heat pumps.
- A **tempered water system**, often referred to as an anergy network in Europe, provides heat or cooling supply directly to the building, whenever the temperature level of the demand is compatible with the network temperature.

The thermal needs of users are primarily domestic hot water and space heating and cooling. In a thermal network, heat transfer is quantified by the flow and temperature difference (*delta T*) between the water in the supply and the return.

Analogous to an electricity grid, a thermal network has a network operator that directly controls the outgoing water temperature and typically opens and closes circulation valves at the delivery points to regulate flow based on building needs throughout the thermal network. The network operator ensures that all customer needs are met, including those at the furthest customers at the end of the network. The return loop temperature is not controlled directly, but is a result of the operating scheme. The return temperature in a heat network is usually kept as low as possible: just high enough to ensure thermal needs of all customers are met, but not higher, so as to maximize overall system efficiency by reducing thermal losses from transportation through the pipes and minimizing pumping energy. Incorporating multiple heat sources can help facilitate operating the thermal network with a low return temperature, to improve efficiency and increase renewable energy penetration. For instance, the renewable heat source could supply 60-80% of peak demand, and comparatively low-cost backup units could be incorporated into the system design to be used as reinforcement during the rarely-occurring peak hours.

Figure 2: Schematic view of three thermal networks: heat, cooling, and tempered water networks¹⁸


Heat Network



Cooling Network



Tempered Water Network

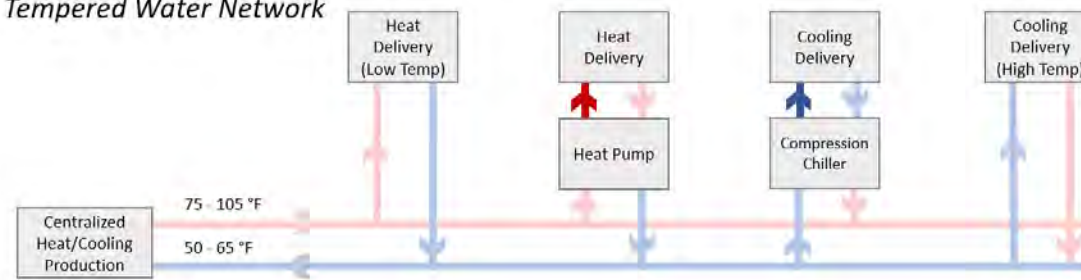

2.2.1 Integrating Heat Supply into the Thermal Network

Most heat sources are only available at limited temperature levels, as indicated in Table 2 (section 2.1.1) and Table 3 (section 2.1.2). The methodology for integrating heat sources into the network supply is determined by the temperature difference between the heat source and the supply and return temperatures of the thermal network. The three cases are as follows.

- When the heat source temperature is higher than the thermal network supply temperature, the heat source can directly feed the thermal network in the supply loop.

¹⁸ Translated and adapted from: Loic Quiquerez, “Décarboner le système énergétique à l'aide des réseaux de chaleur: état des lieux et scénarios prospectifs pour le canton de Genève”, PhD Thesis, 2017.

- When the heat source temperature is in between the supply and return temperatures, the heat source can directly feed the thermal network in the return loop.
- When the heat source temperature is lower than the return temperature of the network, the heat source cannot directly feed the thermal network, and heat pumps are necessary to bring the temperature up to the required level.

2.2.2 Thermal Network Piping

There are a variety of materials available for thermal network piping, the selection of which will depend on the energy system architecture (Table 1), thermal network architecture (Figure 2), energy carrier, supply and delivery temperatures, desired flow rate, the local environment, materials costs, installation costs, and anticipated lifetime, among other factors. For hot water distribution systems, the most common piping material is steel with one to several inches of polyurethane insulation and a water vapor jacket applied around the pipe (aka *pre-insulated steel pipes*). For chilled water systems, steel or ductile iron piping has been used historically, although high density polyethylene is increasingly common. When steel pipes are used, they are typically coupled with a leak detection system to enable timely identification of leaks before they result in corrosion and damage. Chilled water piping can be pre-insulated, coated for corrosion protection, or left bare. The up-front and installation costs for pre-insulated piping of a chilled water distribution network are significantly more expensive compared to non-insulated piping. Therefore, a detailed thermal analysis is carried out for a chilled water distribution network to weigh the costs and benefits of insulation for a specific system. The three most important factors that will determine the distribution losses in the thermal network are 1) the thermal conductivity of the piping material, 2) the thermal conductivity of the surrounding soil, and 3) the temperature difference between the fluid and the surrounding soil. Additional factors that impact distribution losses include the pipe diameter, flow velocity, depth of the piping, and distance between buried supply and return piping.

2.3 Building Interconnection Equipment

The thermal network can interconnect with customer buildings in two ways.

- **Direct Connection.** The district energy system's supply (i.e. steam, hot water or chilled water) is directly pumped through the customer's building heating and cooling equipment (e.g. radiators).
- **Indirect Connection.** The district energy system is coupled to the building via heat exchangers used to transfer heat between the supply and the customer's building system, keeping the supply isolated from the building heating and cooling system.

The customer building interconnection may be referred to as an *energy transfer station* (ETS). Most district heating systems use indirect connections, while most district cooling systems use direct connection due to the relatively small differential temperatures in chilled water systems. Major determinants of whether to use a direct or indirect connection include the system supply pressure at the building, current building equipment, and building height. Direct connections have the advantage of requiring less space, lower maintenance costs, and lowest return temperatures, maximizing the "delta T" between the supply and return leading to overall higher system efficiency and cost-effectiveness. However, they require increased power consumption to maintain sufficient pressure at the building interconnection points, make leak detection more challenging, and reduce reliability overall. When the pressure difference does not allow a direct connection, an indirect connection is

used. Indirect connections are advantageous in that they provide compatibility for building interconnections with any district energy system pressure and temperature.

Controls are installed at the interconnection points to limit the maximum flow rate and keep the thermal network in balance. In addition to controls, heat meters and isolation valves and filters are also installed for billing and equipment protection, respectively.

2.4 Building Heating and Cooling Equipment

Although technically outside of the purview of the district energy system owner and operator, customers' building heating and cooling equipment must be compatible to interconnect and receive thermal services. The building system should be sized to meet peak demand, and no more: an oversized building heating system results in oversizing the entire thermal network to meet customers' needs. Of particular importance is the operating temperature of the building's heating systems: the building supply temperature must be lower than the thermal network supply temperature, and the building's supply and return temperature should be adjusted to reduce the return temperature as much as possible. The more critical design criterion is the building return water temperature – this should be driven as low as possible for maximum system efficiency.

2.5 Energy System Performance

A generalized comparison of energy system performance evaluated based on energy efficiency, emissions, and water usage can be challenging, given that a variety of local conditions will ultimately impact the actual system viability. Nonetheless, here we provide a simplified, high-level evaluation of performance of two energy system architectures, SHP and CHC¹⁹. To carry out the comparison, we assume a common fuel (natural gas) and make the following assumptions.

- Electricity consumption from the grid is provided by a new natural gas fired combined cycle power plant with a 52% efficiency²⁰.
- District heating is from new natural gas fired equipment with an 85% efficiency on a higher heating value (HHV) basis.
- District cooling from new chiller and cooling towers has an efficiency of 0.5KW/ton.
- Heat recovery chillers have an efficiency of 1.5KW/ton.

We compare SHP to a CHC system powered from grid electricity, by evaluating how much natural gas is required to provide one ton of chilling and 17,100 BTU of heating. Given the above assumptions, the total required using SHP is 23,339 BTU. This is compared to the total from CHC is 9,845 BTU. Therefore, CHC would use 57% less natural gas than SHP, and consequently result in a commensurate amount of GHG reductions. Limiting the use of evaporative cooling towers to reject waste heat further reduces water usage in the CHC design, of particular significance in drought-prone regions of the country.

¹⁹ This section is paraphrased from the SESI case study companion deliverable, included here for completeness.

²⁰ *Thermal Efficiency of Gas-Fired Generation in California: 2015 Update*, California Energy Commission.

3. Overview of Project Economics

The deployment of a thermal microgrid is a major infrastructure project that incorporates substantial fixed project costs, along with ongoing electricity/fuel and operations and maintenance costs. However, in addition to the system design maximizing efficiency resulting in cost-effectiveness, the project may also lead to additional significant offsets: costs that would need to be incurred if maintaining the existing energy system, such as expensive electric distribution system upgrades. The subsections below outline and describe the typical project cost categories for thermal microgrids.

3.1 Primary Fixed Costs

Fixed costs for a thermal microgrid - or many district energy system configurations - can easily run in the hundreds of millions of dollars, potentially making up half of the total system costs over the anticipated lifetime, with the balance being made up by operations and maintenance (O&M), electricity, and fuel. The primary categories of infrastructure costs for thermal microgrids are as follows²¹.

3.1.1 Central Equipment Costs

Thermal microgrids have central equipment that includes, for instance, heat sources, heat pumps, chillers and thermal storage. Depending on the energy sources used, the specific fixed costs in production capacity and unit variable costs related to the production of a unit heat and be very different from one system to another. Centralized renewable electricity generation equipment located on-site, such as distributed solar PV, may also be incorporated into the system design.

3.1.2 Thermal Network and Building Interconnection Costs

Distribution occurs via the thermal network, which consists of underground pipes, energy transfer stations, pumps and controls carrying steam or hot/chilled water, as described in section 2.2. With regard to costs, the key parameter is linear thermal density, or the amount of heat/cooling distributed annually per linear foot of the thermal network. Unit thermal network costs are inversely proportional to linear thermal density. Explained another way, the largely fixed costs of the distribution network and customer connections can be shared across more units of thermal service when the customer load is denser, resulting in a more cost-effective system. Building interconnection costs can be many multiples of the thermal network itself and vary depending on building type and corresponding thermal load.

It is worth noting that even if the per unit costs of delivering thermal services is higher in low-density areas, district energy can still be cost-competitive, especially if/when the heat sources are cheap and distribution losses are minimized. Furthermore, on the other extreme, high-density urban centers can present their own set of challenges, since thermal network installation can be complicated and expensive in crowded underground space.

²¹ Cost estimates based on the European market can be found in United Nations Environment Program's 2015 report, "District Energy in Cities - Unlocking the Potential of Energy Efficiency and Renewable Energy".

3.2 Primary Ongoing Costs

The two largest sources of ongoing costs are O&M and electricity/fuel, which are approximately proportional to units of energy sold²². O&M costs consist of maintaining the central energy facility equipment, in addition to any building interconnection equipment. The thermal network itself requires little maintenance and has an expected lifetime much longer than the central equipment. Supply equipment can be switched out one or more times while maintaining the same distribution network. O&M can comprise up to a fifth of the total costs over the system lifetime, depending on the energy system architecture and other system design choices.

Electricity and fuel are the other main source of ongoing costs. Depending on the energy system architecture, supply sources, and climate, among other factors, electricity and fuel of a new energy system can make up half of the total lifetime system costs. Thermal microgrids are designed around renewable electricity powered heat recovery; therefore, electricity costs can be substantial and fossil fuel sources are minimized, used only for capacity serving peaking and backup needs.

3.3 Other Costs

Although Section 3.1 and 3.2 cover the primary up-front and ongoing costs for a thermal microgrid, there are many other costs that are material, including the following.

- **Project development costs.** Often starting multiple years prior to breaking ground, feasibility studies, detailed engineering designs, and permitting and planning applications require substantial resources to carry out.
- **Customer acquisition.** For a new local energy system development, it can take significant time and resources to acquire a set of core customers to form the anchor loads for the system. To encourage building owners to subscribe for thermal services, some district energy developments under-recover fixed costs in the early years of the system lifetime.
- **Metering, billing, customer service and administration.** Like any utility service, a district energy system operator must meter, bill, respond to customers, and operate in accordance with municipal, state and federal laws and regulations. A portion of these costs - specifically billing, customer service and administration costs - may be shared across multiple utility services. Heat metering equipment costs are often already accounted for under building interconnection costs.

3.4 Synergies with Other Utility Services & Customer Needs

As discussed in section 1.4, public power is in a unique position to lead in the development of district energy systems because of their ability to identify and capitalize on cost savings across multiple utility services. Coordinating infrastructure projects for the thermal network and electricity grid is one major example of this. As described above, thermal networks are underground networks. Trenching and pipe installation for the thermal network could be coordinated and combined with installing (new development) or undergrounding (existing development) the electricity distribution system. Power lines and supply and return piping can be arranged in such a way to mitigate any potential negative impacts of elevated temperatures on the power lines. Insulating foam boards can also be added

²² O&M is also often expressed in terms of percent capital costs.

around the power lines if they must be within close proximity to the thermal network. Combining the installation of piping and installing/undergrounding power lines can result in substantial savings for communities. These potential savings should be taken into account in the evaluation of cost-effectiveness of the various local energy system options. Similarly, deploying a thermal microgrid can help delay or avoid major infrastructure investments in the electric distribution system for neighborhoods undergoing new development or major redevelopment accompanied by a substantial increase in electricity demand.

In addition to coordinating costs across utility services, there are also customer considerations that can be factored into whether a district energy system architecture is preferable over a building-level system. Having a district energy system reduces on-site capital expenditures required of customers. For Austin Energy, for instance, the primary motivation for exploring a central cooling plant was to reduce development costs for new buildings in a brownfield redevelopment area. The district cooling system precluded the need for chiller equipment installed in the new buildings, an offset to customer-financed capital projects. Although these costs would have been incurred by the customer, as opposed to the utility, customer preferences nonetheless play a significant role in determining the preferred local energy system design.

3.5 Comparison of Project Economics Across System Design

Prior to deciding on a specific system design, one must compare the project economics to alternatives, such as CCHP, CHP, SHP, and a building-level system. Furthermore, there also may be several different design variations within each of the aforementioned categories. A *business as usual* (BAU) system design is defined as a continuation of the existing energy system and used as a baseline for comparison. Section 4 (next section) describes techno-economic feasibility assessments, which aid in arriving at the subset of system design options that are sufficiently promising for more detailed evaluation.

As with any major infrastructure project, a variety of methodologies can be used to carry out the economic assessment. The methodology used in this report is to calculate the present value of projected cash flows. Standard project finance inputs such as discount rate, project lifetime, cost input estimates, cost of debt, etc. are all incorporated into the assessment. Sensitivity analyses can be used to determine to what extent the results change given changes in input assumptions. When assessing project economics, it is also critical to accurately capture all costs and benefits of each system including potential offsets, such as those described in section 3.4.


For illustration, Figure 3 summarizes the results of the economic assessment of multiple central energy replacement options, duplicated here from the SESI Case Study. Along the horizontal axis are all system design options considered, categorized by power source (on-site gas cogeneration, grid power, grid power plus solar), heat network (steam or hot water), and level of heat recovery (none, modest heat recovery, and major heat recovery). On the left vertical axis is present value costs in millions over the anticipated 35-year system lifetime (2015-2050). Costs are broken down by four sources: electricity, natural gas, O&M, and capital. Water usage and GHG emissions are plotted along the right vertical axis to reflect the environmental impact of each system design option. Figure 3 is specific to Stanford's detailed evaluation of replacement options for their 1987 cogeneration plant (BAU). However, the relative trends between energy system design options are transferable to other locations.

APPENDIX E



Thermal Microgrids: The Technology, Economics and Opportunity

Figure 3: Stanford's central energy facility replacement options

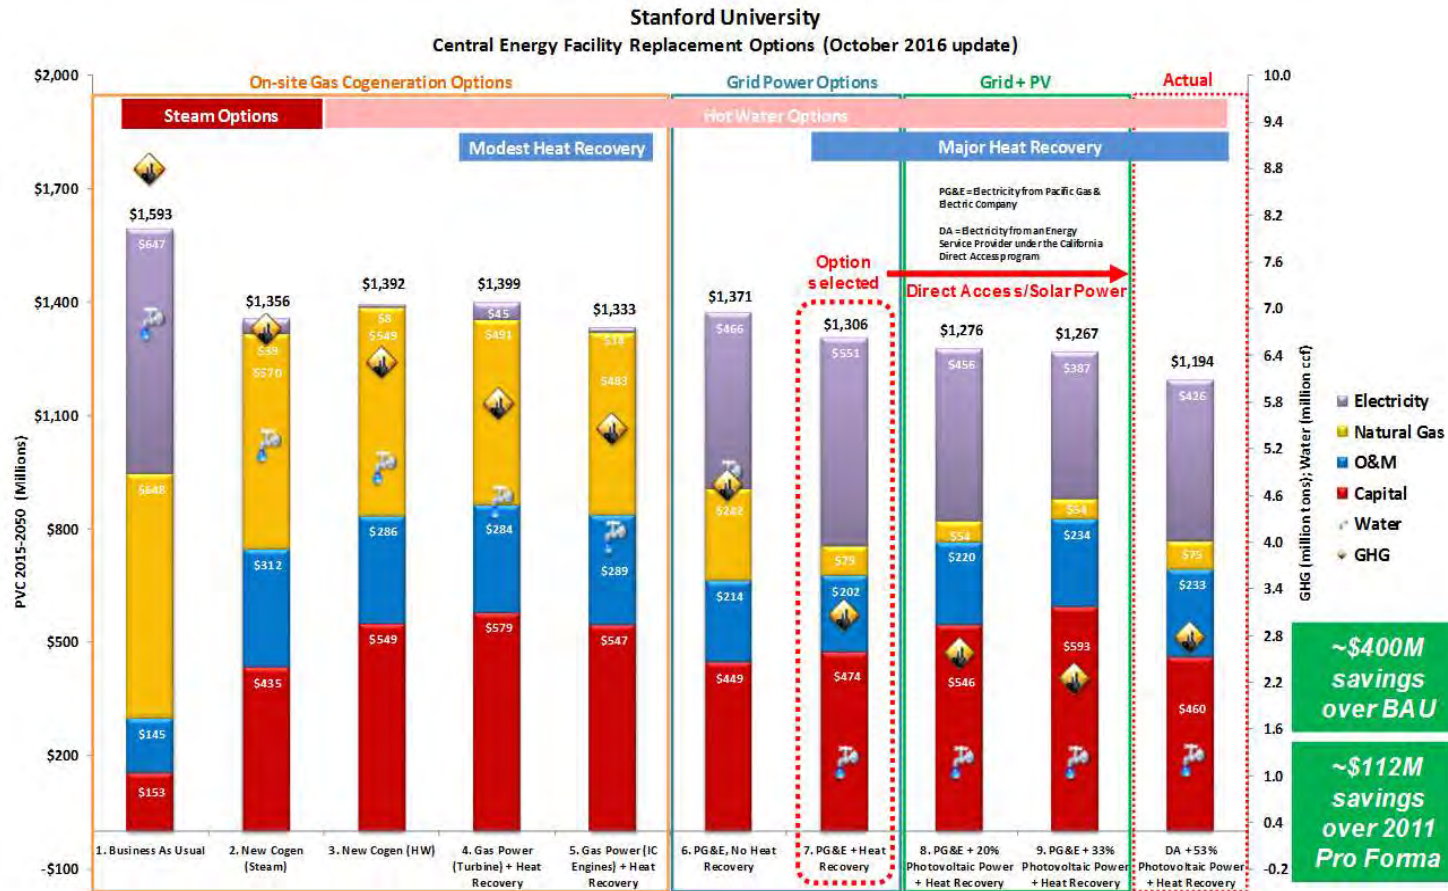

4. Feasibility Assessment

The progression of district energy system design can be categorized into four stages, as shown in Table 4. As a project advances through each stage, the number of system design options under consideration narrows, estimates of project costs are refined, and project risk declines.

Table 4: Stages of a district energy project

1. Pre-Feasibility	<ul style="list-style-type: none"> This is the initial stage of assessment when all system design options are under consideration. Pre-feasibility assessments are typically carried out several years in advance of the beginning of project construction and require minimal input. Tools for pre-feasibility assessments may be referred to as <i>screening tools</i>.
2. Feasibility	<ul style="list-style-type: none"> The second stage is the feasibility assessment. The category of models to determine whether a given system design is technically and economically feasible subject to the operational constraints of component technologies and other physical limitations of the system operation fall within the general category of <i>techno-economic feasibility models</i>. More detailed input data is required at this stage in the assessment, such as hourly heating and cooling loads and long-term forecasts for electricity and fuel prices. The outcome of a feasibility assessment may be expressed in a chart such as that shown in Figure 3. At the end of this stage, stakeholders decide on the final energy system architecture and have estimates for equipment sizing.
3. Engineering Design	<ul style="list-style-type: none"> The next stage is detailed engineering design of the identified system architecture, and refined costing.
4. Request for Bids	<ul style="list-style-type: none"> The final step of the project is issuing a request for bids. At this stage, all aspects of system design are finalized.

This white paper focuses on models and methodologies that fall within the first two stages: pre-feasibility and feasibility. Given promising results from results of these two stages, additional time and resources can be devoted to carry out a more detailed technical and financial assessments. Please note that a companion deliverable of this four-part APPA-funded project catalogues and describes pre-feasibility and feasibility tools for thermal microgrids. Discussion of specific tools and their capabilities is reserved for that deliverable, scheduled to be released in Summer 2018.

Prior to beginning any modeling work, stakeholders should determine a prioritized list of goals, such that a subset of system design concepts can be evaluated via a pre-feasibility assessment. As discussed in section 1.3, a community may have a variety of goals for its local energy system. One goal could be, for instance, reducing GHG emissions by 40% by 2030, which a thermal microgrid would be instrumental in helping to achieve. Stanford's goals were to minimize GHGs and energy and water usage within reasonable cost, for instance.


Also prior to the pre-feasibility assessment, the boundary must be defined within which the local energy system will serve customers. Multiple geographic boundaries could be evaluated, adjusted iteratively throughout the design phase. For the case of Stanford, the geographic region of interest included the university campus.

4.1 Pre-Feasibility Assessment for Thermal Microgrid Design

A common component to any feasibility assessment is collecting the heating and cooling loads of all buildings within the district, or, if historical data is unavailable, modeling the loads using building energy modeling tools. Calculating hourly heating and cooling loads is needed to determine the overlap in heating and cooling needs and the resultant waste heat recovery potential. Significant waste heat recovery potential warrant further investigation into the feasibility of a thermal microgrid.


Figure 4 shows the historical hourly heating and cooling loads for Stanford campus over a calendar year. This figure accounts for hot and cold storage in the calculation of heat recovery potential. In addition to Stanford, substantial opportunity for waste heat recovery is observed in other regions, as shown in Figure 5. As shown on each figure, even in significantly different climate zones and on non-research university campuses, the potential for waste heat recovery is substantial. Stanford’s administrative campus is currently under construction and utilizes a SESI system design²³.


Figure 4: Stanford’s campus-wide hourly heating and cooling needs over a year, indicating heat recovery potential for a system incorporating hot and cold thermal storage

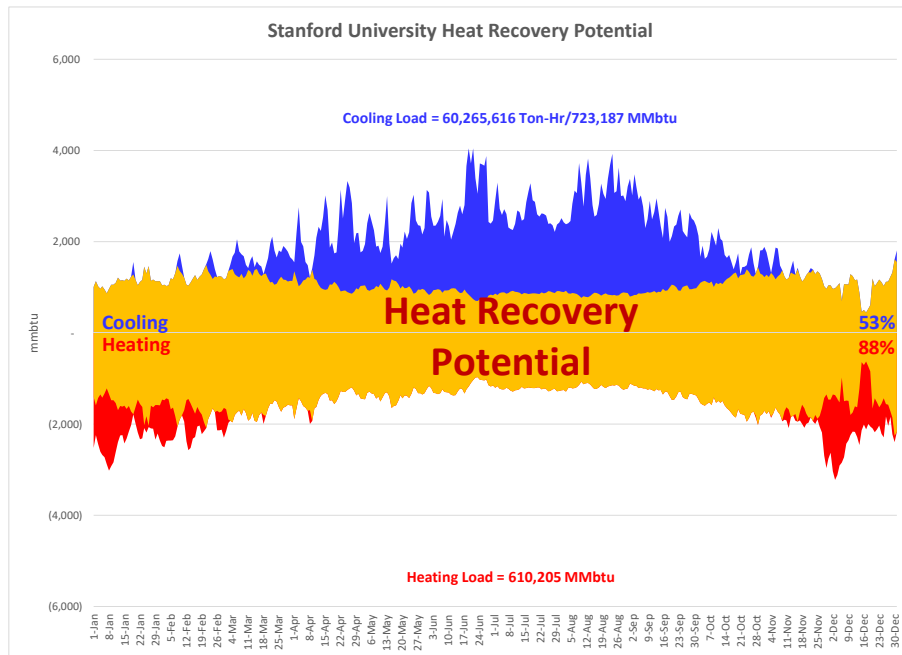

²³ <https://redwoodcity.stanford.edu/>

Figure 5: District hourly heating and cooling needs over a year for Stanford’s Redwood City administrative campus (top), University of Illinois Urbana Champaign (middle), and University of California Davis.

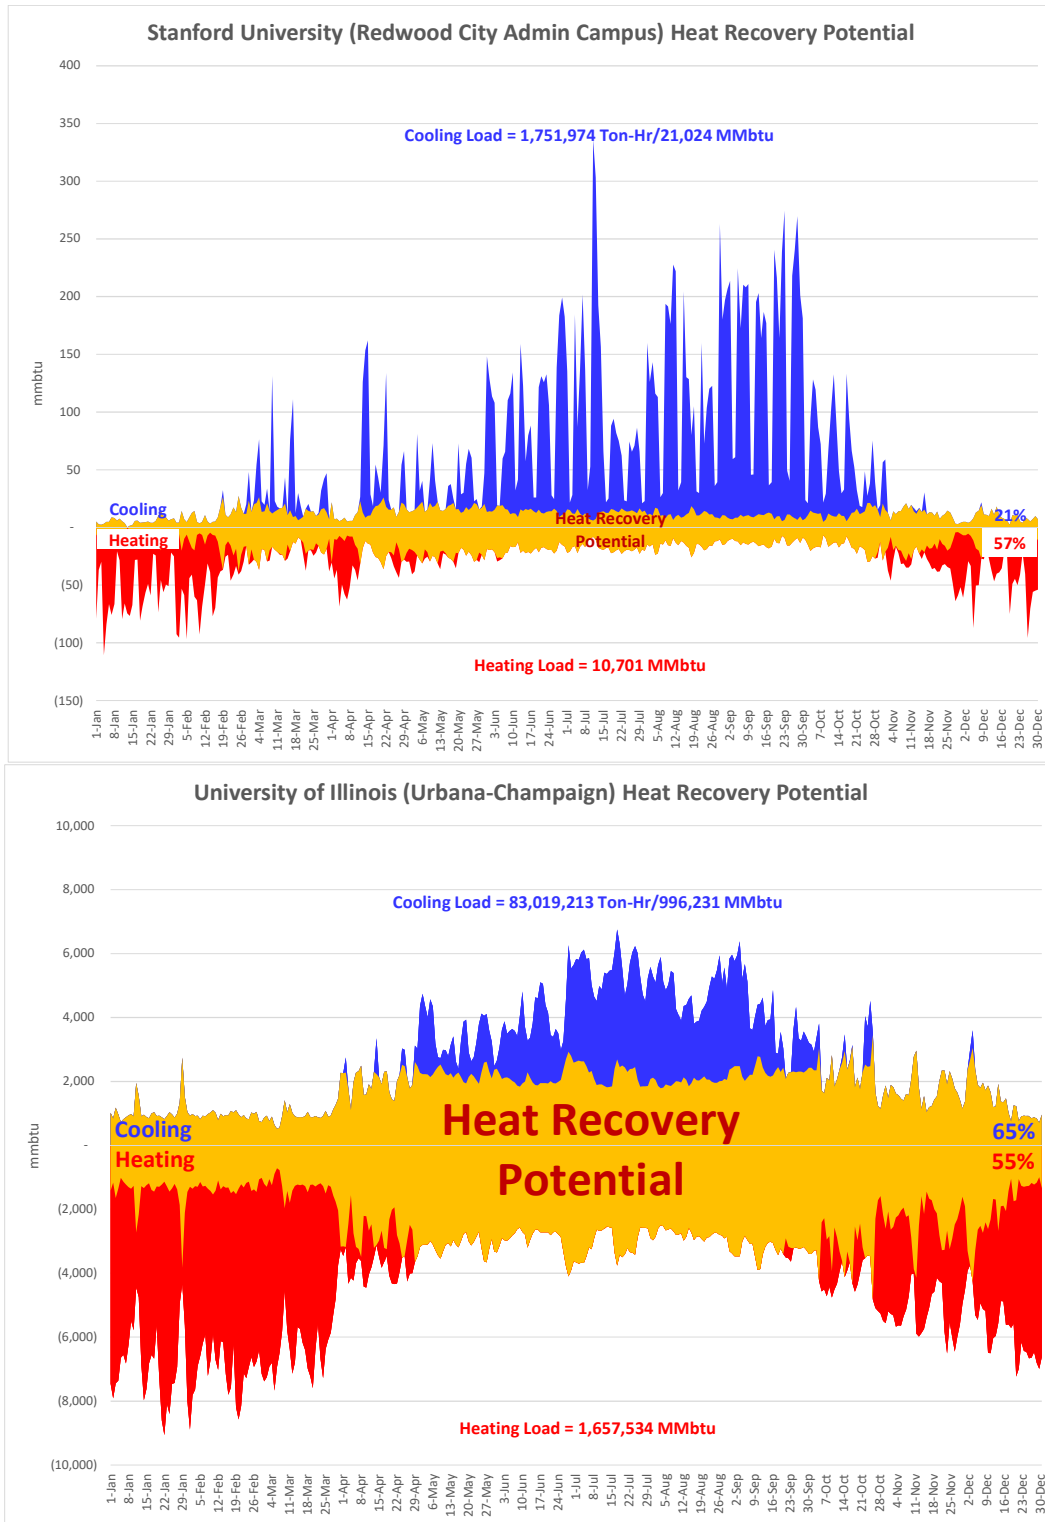

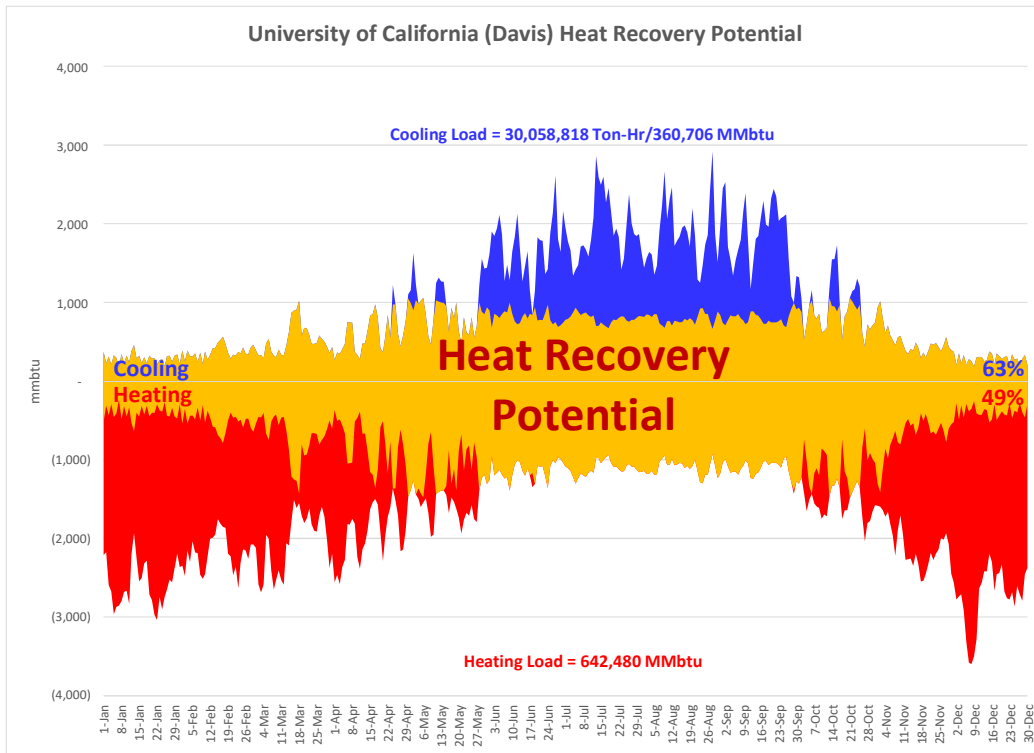

When building waste heat recovery potential is minimal given low coincident cooling needs, the system design can incorporate supplemental heat sources, such as renewable heat recovery from the ground, surface water, or air, or other described above (Table 2). In addition to thermal microgrid system design options, building-level design options and traditional district energy system architecture (i.e. CHP) could also be evaluated simultaneously for comparison purposes.

Note that these diagrams depict the maximum overlap of heating and cooling that could be considered. Conditions such as density of load, difficulty of thermal grid installation and other constraints may limit the number of buildings can be economically connected to the thermal grid.

4.2 Methodology for Techno-Economic Feasibility Assessment

Upon narrowing the system options after the pre-feasibility assessment, the next stage is determining project feasibility. The basic methodology is as follows. Examples from Stanford’s energy system transformation are included for illustrative purposes. Note that some of the data will already have been collected for the pre-feasibility assessment.

1. **Gather input data.** There are three main categories of input data.
 - a. *Heating and cooling load profiles.* The energy system must be designed to meet the heating and cooling needs of the region over the system lifetime. As such, heating and cooling load profiles are a key input to the model. Building loads vary depending on the specific building use (hospital, office building, etc.), time-of-day, season, and building age, among other factors. The higher the load data resolution (temporal and spatial), the more confidence one can have in the results of the feasibility assessment,

but the more onerous the study. Two features of the load profile are the base load (minimum level of demand) and the peak load (maximum demand), which are often expressed on an hourly basis and are critical for determining appropriate system design and sizing. If historical load data is unavailable, one can estimate the heating and cooling load profiles using building simulation models or by making rough assumptions based on square footage, climate zone, building use, etc. Irrespective of whether historical data is available, one must consider anticipated *future* energy consumption and development over the project lifetime, which can be decades. Figure 4 (above) shows Stanford's hourly heating and cooling over a calendar year, in addition to the heat recovery potential.

- b. *Electricity, fuel and emissions price forecasts.* Forecasts for electricity, fuel and emission prices are key inputs to the model, especially to compare to baseline system designs. Often multiple forecasts are used to identify a range of potential outcomes.
 - c. *Technology characteristics.* If it is not already integrated into the model, information about component technologies incorporated into the system design must be provided as inputs, such as lifetime, rated capacity, operational constraints, capital cost, fixed and variable operations and maintenance costs, efficiency and emissions rate. Technology information may be included in libraries already integrated with the modeling tool.
 - d. *Other.* In addition to the primary data categories, the user may provide other inputs such as discount rate, financing costs, and any specific stakeholder objectives identified (e.g. a GHG emissions cap).
2. **Run techno-economic feasibility model.** Using the input data gathered in the prior step, run the model for all system designs of interest. Output of a model run may include present value cost (PVC), GHG emissions, and water usage. Financial output could be framed in terms of cost-effectiveness from a customer, utility, and/or societal perspective. Results from Stanford's are shown in Figure 3 (above).
 3. **Iterate through steps 1-4, modifying design choices, input assumptions, and objectives.** Depending on the outcome of the model runs, one may wish to evaluate modifications to the initial geographic region, system designs and other input assumptions. In this respect, the techno-economic feasibility assessment is an iterative process that may lead to alternative design options that were not originally considered.

4.3 Key Feasibility Drivers

The primary feasibility drivers of a thermal microgrid compared to a building-level system design are the following.

- **Load density.** The primary feasibility driver of a district energy system is the density of heating and cooling needs within the geographic region of interest. Heating and cooling networks are more localized than electric networks. Furthermore, the thermal network is a major source of project costs: the closer the buildings and the denser the load, the more cost-efficient the thermal network will be. The International Energy Agency (IEA) estimates that a region can be

served economically with district energy if the heating load density is at least 0.93 kWh per square foot or the linear heat demand is at least 9,146 kWh per foot²⁴.

- **Cost of heating and cooling supply.** The cost of source heat is another primary feasibility driver. Advanced heat recovery enables low cost source heat for a thermal microgrid design. In addition to waste heat recovery from the building cooling process as in the Stanford energy system design, other renewable and waste heat recovery opportunities include data centers, industry, and air-, water- or ground-source heat, for instance.
- **Load diversity.** Sizing each individual building for its annual peak demand is inherently more expensive than sizing a collection of buildings with load diversity. Especially with increasingly ambitious energy efficiency targets for buildings, the problem of sizing will become increasingly challenging. Advanced communications and controls to operate the resources and loads of the thermal microgrid can capitalize on load diversity and further enhance efficiency gains. Even though university campuses can capitalize on their high load diversity given different building uses, even aggregating loads of the same use (e.g. single family residential) can provide benefits. Load diversity, nonetheless, can be considered a key feasibility driver.
- **Implementation Difficulty.** The ease and relative cost of the implementation of the thermal network to connect the buildings is another key consideration and feasibility driver.

²⁴ District Heating and Cooling, Frederiksen and Werner (2013).

5. Assessment of Potential in the U.S.

Although a comprehensive quantitative study of the potential of thermal microgrids in the U.S. is beyond the scope of this white paper, we can provide insight on the potential based on existing literature, and technology and policy trends. Many types of state and federal energy and environmental regulations would serve to promote thermal microgrids and their energy efficient, cost-effective approach to decarbonization, including a carbon tax, a cap-and-trade program, energy efficiency targets, and local air quality standards. As referenced in prior sections, there are several non-technical barriers that could significantly inhibit thermal microgrid deployment, such as the following.

- **General familiarity with district energy and advanced waste heat recovery** in the U.S. is lower relative to Europe and Asia, given the lower incidence rate of projects. Additional effort is required for stakeholder education – especially policy makers and the public – to ensure thermal microgrids are considered alongside other options for decarbonization.
- **Parts of the value chain for district energy are under-developed in the U.S.**, resulting in too few vendors to create a competitive market. Furthermore, thermal microgrid systems such as Stanford’s are an emerging system design on the global stage, meaning expertise with this system type is even more scarce. Government policies to support upstream development of the value chain could help spur efficient market development.
- **Complex, multi-stakeholder processes** for energy infrastructure development can be a major inhibitor to district energy deployment. Active engagement of stakeholders and consideration and responsiveness to concerns will aid in navigating the project development process.
- **Securing the large initial investment** required for capital outlay is another challenge. Sticking points for potential investors include depreciation duration, access to finance, and potential financial risk given uncertainties in the final rates, actual building load, and energy market evolution (policy and regulations), for instance.
- **Timing of building equipment replacement** in existing developments, unless advanced building retrofits are considered, is a critical practical factor in district energy deployment and of primary importance to potential customers. The development of the thermal network could potentially be timed, such that it is developed in phases, matching natural replacement times of buildings.
- **Space constraints** for siting and hosting central energy equipment for district energy can also be a challenge in some areas. Regions with sufficient thermal density are more likely to encounter space constraints.
- **Customer acquisition** can be another challenge, given factors such as negative perceptions about reliance on long-term contracts for heat supply. Although on the customer side, these downsides are counterbalanced by consumer convenience of not having responsibility for boilers and fuel purchases.
- **Project replicability** is another barrier. Unlike with CHP, where there are now several packaged system options available in a variety of system sizes, thermal microgrids have not reached that

state of maturity. Standardization would allow for streamlined installation and maintenance and lower overall project risk.

- **Economic and policy uncertainties over the long project lifetime** are also a barrier. The world is rapidly changing, making long-term investment decisions, such as energy infrastructure development, more challenging.

As mentioned above, carrying out a comprehensive potential assessment for thermal microgrids across the U.S. is a complex undertaking beyond the scope of this white paper. However, it is the subject of ongoing R&D activity. Please see Appendix B for general background on energy technology potential assessments and application to thermal microgrids.

6. Utility Business Models for Thermal Services

District energy systems, like electricity and gas networks, are natural monopolies. There are multiple design choices for utility business model for thermal services, which are largely similar to the options available for municipal electric utilities. The subsections below identify and describe some of the primary business model design considerations.

6.1 Ownership & Governance Structure

There are multiple ownership and governance structures for municipal utilities that can be utilized for thermal services, just as they are used for electric utilities. Each structure has strengths and weaknesses, and the best ownership and governance structure for a specific system will depend on the community's desired amount of control, investment, and risk, as well as the overarching local energy system goals and objectives. Whatever business model is chosen, it should ensure that all stakeholders achieve financial benefits from the development of a district energy system, including the investors, owners, operators, end customers and municipalities.

Four common business models for district energy systems are as follows.

- **Enterprise fund and operational department within a university or local government.** Municipal utilities that exist within a municipal government or university typically establish themselves as an enterprise fund and an operational department within the organization. The City of Palo Alto's Utilities Department and Stanford's SESI are both established in this way. The governance structure of the department is the same as the larger organization. For instance, a city council will act as the governing body for the municipal utility. Utility directors are granted authority by the governing body to make procurement decisions within approved limits. Procurement exceeding this authority or decisions with important policy implications may require the full review and approval of the governing body.
- **Special district independent from existing local governments.** The second option is to establish a special district - typically referred to as a municipal utility district in this context - that is organizationally independent from established municipal and county governments and is governed by its own set of elected or nominated board members. The sole purposes of the district would be to develop, own and operate the utility, and the governing board is defined upon creation, contingent upon constraints in the enabling state legislation.
- **Community-owned non-profit cooperative.** Third, a municipality can form a private, wholly community-owned non-profit cooperative, where customers (owners) have indirect representation for selecting the board. This model is common in Europe.
- **Community-owned limited liability corporation.** The fourth option is to form a private, wholly-owned subsidiary, with a board comprised of representatives of local building owners, local electric utilities and municipalities. This is typically achieved using a special purpose vehicle (SPV). Although structured as a for-profit entity, municipalities often own stakes in the company. District Energy St. Paul has this ownership and governance approach. In Germany,

utility services are commonly provided by *stadtwerke*, which typically are structured as a limited liability, for-profit entity majority-owned and therefore controlled by a municipality²⁵.

There are also a variety of other public-private partnership structures that could be used, such as joint ventures and concession models²⁶. Moreover, a completely privately owned, for-profit corporation could develop, own and operate a thermal microgrid. However, the downside of this model is that a for-profit entity has a higher cost of capital and they do not incorporate community-driven governance approaches that may be needed to make the project a success. Furthermore, such a project must comply with zoning, environmental, health and safety requirements. Navigating compliance with such laws and regulations requires cooperation with local agencies. Therefore, most successful district energy business models incorporate the public sector in some way.

Advisory commissions comprised of industry experts from within the community may be established and leveraged to provide an additional layer of review and stakeholder feedback that could be incorporated into any of the organizational structures described above.

6.2 Metering & Rate Structures

Thermal microgrid systems that serve multiple customers must incorporate metering equipment to measure customer-level energy usage, so that accurate billing can be carried out for all entities within the service territory. For systems that cover a region with existing electric utility accounts, the existing electrical metering equipment should be sufficient for accurate billing for electric service. However, submetering equipment at the building level may be desired. State or local regulations may dictate what rates may be charged in the submetering context. For instance, in California, the same rate as the local utility must be used for electricity charged to tenants.

The thermal services provided by the local energy system will require separate, dedicated metering infrastructure. Furthermore, the metering equipment and approach will be dependent upon the medium of delivery: water vs. steam. For water-based systems, the focus of this report, a simple approach is to install a single meter at the building for each network for measuring supply and return water temperature. The temperature differential can then be used to determine the amount of heat delivered to the building, which is used to charge the customer. This same approach can be applied for both the chilling and the heating loops. Of course, this is only one approach for metering thermal services. An alternative is charging based on square footage or an engineering estimate of energy needs. Ultimately, the community and the governing board must decide on appropriate cost-recovery mechanisms for their energy system, compliant with local, state and federal regulations.

For heating, cooling, and hot water consumption, charging based on square footage or estimation of usage, based on common engineering standards, may be the easiest and most straight forward option. The electrical equivalent to this is “master metering”, where the public utilities commission designates baseline quantities of electricity for the average residential customer’s reasonable energy needs²⁷. This

²⁵ See for instance Munich’s *stadtwerke*, Stadtwerke München GmbH: swm.de (English option)

²⁶ For more case studies of district energy systems with various ownership and governance structures, please see the IEA Technology Collaboration Programme on District Heating and Cooling including Combined Heat and Power, Governance Models and Strategic Decision-Making Processes for Deploying Thermal Grids.

²⁷ Please note that this approach is only appropriate when the functional use and occupancy time of all spaces is similar. If vast differences exist, various factors must be applied to higher load spaces to account for greater heating and cooling consumption.

same type of metric may need to be developed for district-scale heating and cooling. Metering the water flow is another option, though this can be costly and problematic.

7. Conclusions, Outlook & Next Steps

The “three D’s” -- decentralization, decarbonization and digitalization -- are driving the transformation of the energy sector, and concurrently encouraging consideration of efficient district electrification as a technology pathway for achieving clean, affordable and reliable energy systems to serve communities. There are several non-technical challenges to market uptake, as described in this report. Nonetheless, they are not insurmountable, and public power in particular is in a unique position to overcome them.

Further evaluation of the market potential and the transferability of thermal microgrids across climate zones and community circumstances is needed, while comprehensive evaluation of technology pathways for decarbonization and resultant policy formulation at the state and local levels are both still in formative stages. This white paper is the deliverable for Part 1 of a four-part APPA-funded project, *Leveraging Experience from Stanford and EDF to Develop Information and Tools for Thermal Microgrid Feasibility Assessments*. The following companion deliverables are either completed or in development, with anticipated publication dates included in parentheses.

- Part 2: Case study describing the Stanford Energy System Innovations (SESI) project, in which their campus-wide cogen system was transformed into to renewable electricity powered heat recovery with low temperature hot water distribution. (Early 2018)
- Part 3: A compilation of tools for assessing technical and economic feasibility of thermal microgrids. (Summer 2018)
- Part 4: Case studies applying the tools to carry out techno-economic feasibility assessments of regions within municipal utility service territories. (Fall 2018)

Please see Appendix A for additional further reading.

Appendix A. Further Reading

The following on-line references provide additional information on district energy project development and its role in achieving deep decarbonization.

- [*Community Energy: Planning, Development and Delivery*](#), IEA (2010). This free guide was developed to help land use planners and prospective project developers "understand and create or influence energy maps [...] and other information for use in master plans or development plans; gain an understanding of energy use in buildings and developments; recognize where there are opportunities for district energy projects, and understand the value of incorporating thermal energy considerations in planning efforts; translate energy opportunities into financially viable and deliverable, sustainable projects; [and] understand the stages of developing an energy project and who is involved in each."
- [*District Energy in Cities: Unlocking the Potential of Energy Efficiency and Renewable Energy*](#). UNEP (2015). This report: "identifies modern district energy as the most effective approach for many cities to transition to sustainable heating and cooling, by improving energy efficiency and enabling higher shares of renewables. Countries such as Denmark have made modern district energy the cornerstone of their energy policy to reach their goal of 100 percent renewable energy, and, similarly, other countries, such as China, are exploring synergies between high levels of wind production and district heating."

Locally appropriate policies are required to harness the multiple benefits of district energy systems, lower upfront costs and reduce financial risk for investors. This publication is one of the first reports to provide concrete policy, finance and technology best-practice recommendations on addressing the heating and cooling sectors in cities through energy efficiency improvements and the integration of renewables, both of which are central to the energy transition. These recommendations have been developed in collaboration with 45 champion cities, all of which use district energy, with 11 of them using it to achieve 100 per cent renewables or carbon-neutral targets."

The following recent textbooks can provide more detailed technical information for interested readers.

- [*District Heating and Cooling*](#), Svend Frederiksen and Sven Werner (2013).
- [*Advanced District Heating and Cooling \(DHC\) Systems*](#), Edited by R. Wiltshire (2016).

Appendix B. Energy Technology Potential Assessment

B.1 Introduction to Technology Potential Assessments

Energy technology potential assessments are customarily divided into four stages²⁸. First, *resource potential* is the energy content of the resource after accounting for any theoretical physical potential and constraints. Second, *technical potential* is the market size of a technology after considering resource potential and all technical limitations and constraints, such as technology efficiencies, land-use constraints, or topological constraints to arrive. Third, *economic potential* takes the technical potential and accounts for projected costs and benefits such as technology and fuel costs to arrive at the level of technology deployment that is economically viable (i.e. cost-effective). Fourth, the *market potential* is an estimate of the ultimate, realistically achievable market size, using the technical potential and accounting for all remaining factors affecting deployment, such as policies and regulations, consumer behavior, and competing products. At each stage of the assessment from resource potential to market potential, the estimated market size decreases, often considerably. The potential for an energy generation technology is calculated in terms of megawatts capacity, or megawatts capacity thermal equivalent for a district energy system such as a thermal microgrid. Table 5 illustrates the stages of a potential assessment using rooftop solar PV as an example.

Table 5: Illustration of energy technology potential assessment for rooftop solar PV in the U.S.

Resource Potential	<ul style="list-style-type: none"> Resource potential is the average annual solar energy reaching building rooftops in the U.S. This value could be estimated, for instance, using location-based solar irradiance data from the National Oceanic and Atmospheric Association (NOAA) meteorological stations and satellite imagery analysis for building roof footprints.
Technical Potential	<ul style="list-style-type: none"> Technical potential is the average annual solar electricity that could be generated if solar PV was installed on all suitable rooftops, which can be estimated, for instance, using geographic information systems (GIS) analysis to calculate the solar suitable area of rooftops after eliminating surfaces that are too steeply sloped, poorly oriented, shaded, cluttered with rooftop equipment, or otherwise unable to accommodate solar panels. The calculation accounts for solar PV panel and inverter efficiencies to estimate output.
Economic Potential	<ul style="list-style-type: none"> Economic potential is the fraction of technical potential that is cost-effective, which occurs when the total value created from system (i.e. bill savings) exceeds the system costs (solar PV panels, inverters, permitting, maintenance, etc.) over the system lifetime.

²⁸ See, for instance, NREL's page on renewable energy potential assessments: <https://www.nrel.gov/gis/re-potential.html>.

Market Potential

- Market potential is the estimated achievable adoption of rooftop solar PV, which uses the economic potential as an input and accounts for regulations and policies to support rooftop solar PV adoption (e.g. streamlined permitting), demographic data, consumer behavior, and comparison to competition (e.g. grid supply).

B.2 Application to Thermal Microgrids

The technical potential of thermal microgrids is the market size based on the technology's ability to meet end-customer energy needs. The technical potential for thermal microgrids can be divided into two parts: i) meeting the additional electricity load from electrification using carbon-free electricity, and ii) meeting the thermal needs of a site by converting the on-site building energy equipment from an existing fossil-fuel based system to a thermal microgrid leveraging advanced waste heat recovery. Regarding the former, using rough approximation, switching natural gas to electricity would result in an additional annual usage of 2,300 TWh²⁹. This additional electricity load must be met by decarbonized electricity supply. The National Renewable Energy Laboratory (NREL) carried out an extensive GIS-based analysis to calculate the technical generation potential of several renewable energy technologies in the U.S. The result was hundreds of thousands of TWh of technical potential across the U.S.³⁰. Although the study does not go so far as to consider technical feasibility of renewable energy integration, given a variety of renewable energy technologies were evaluated in the NREL study, with different hourly, daily and seasonal production profiles, and that the resultant technical potential is many orders of magnitude greater than the very rough anticipation of need from building electrification, one can safely assume there is sufficient renewable energy generation technical potential to accommodate electrification of the building sector, whether by districts or by a building-level approach. This general conclusion is consistent with regional and national decarbonization studies, all of which indicate that decarbonization is not limited by technical potential of clean energy supply³¹.

Given the above result, the technical potential is limited by feasibility of deploying the thermal network and the potential for renewable or waste heat recovery. Technical potential for the technology can be expressed in terms of system capacity in gigawatts thermal equivalent to meet the thermal needs of the study region, or for district heating potential exclusively, petajoules. A rigorous technical potential assessment would account for technical performance and limitations of on-site energy efficiency measures, thermal storage technologies, central and distributed heat recovery equipment, and

²⁹ Annual U.S. natural gas usage in 2016 in the commercial and residential sectors totaled 7,450,000 million cubic feet (U.S. EIA). Using the 2016 annual average heat content of natural gas of 1,037 BTU per cubic foot (U.S. EIA), this equates to approximately 7,700 million MMBTU. As an approximation, we assume all natural gas used in the residential and commercial sectors is used for space and water heating. Using rough approximation, switching natural gas to electricity would result in an additional annual usage of 2,300 TWh, using 3,412 BTU per kWh and assuming the appliance efficiency of each are equivalent. For reference, annual U.S. electricity sales in 2016 totaled 3,762 TWh.

³⁰ A. Lopez et al., U.S. Renewable Energy Technical Potentials: A GIS-Based Analysis, NREL/TP-6A20-51946, July 2012.

³¹ See footnote 2.

topological or system constraints of the heating and cooling networks. Carrying out a calculation of the technical potential would incorporate the following steps³².

1. Select regions where the density of thermal load exceeds a specified threshold that makes thermal microgrids – and the development of a thermal network in a district energy system more generally – viable. As mentioned above, a region may be suitable for district energy if the heating load density is at least 0.93 kWh per square foot or the linear heat demand is at least 9,146 kWh per foot³³. This can be used as a floor for load density in the technical potential assessment. In all other regions with insufficient thermal density, building-level electrification is a more suitable decarbonization pathway.
2. Model the hourly heating and cooling needs of the collection of buildings within each region that has sufficiently high thermal density. Thanks in part to the Open Government movement, an increasing amount of data is published by cities and states, including GIS data sets of land zoning (e.g. residential, commercial) and building information (e.g. number of floors, square footage, age). These data can be combined with other data sources (e.g. weather, census data, satellite imagery) and advanced analytics such as machine learning algorithms to model thermal loads quickly across large potential markets.
3. Estimate thermal microgrid potential in terms of megawatts capacity thermal equivalent needed to meet thermal loads of each region, calculated taking into consideration the overlap in heating and cooling loads; ground-, water-, and air-source heat recovery opportunities; hot and cold thermal storage; and, advanced analytics and controls. If a site has multiple thermal requirements (i.e. chilled and hot water), the thermal microgrid can be sized to meet the largest of the loads. This results in the total technical potential.

The technical potential is a necessary input for estimating a realistically achievable market size.

Economic and market potential builds on the technical potential by taking into account all other considerations to reach an ultimate estimated market size. Economic potential includes costs and benefits of deploying technically feasible systems. As mentioned previously, a district energy approach is generally economically advantageous if the cost savings from centralized versus building-level energy equipment is larger than the substantial costs of developing the thermal network. Furthermore, the cost-effectiveness of the distribution network is dependent upon the thermal density of customer demand, where the denser the load, the more cost-effective the service. Inputs for estimating the economic potential would include all the cost categories identified in section 3 over the system lifetime, which are compared to a baseline system design to determine cost-effectiveness. A comprehensive study of the potential of thermal microgrids in the U.S. is beyond the scope of this white paper, but the subject of ongoing R&D activity.

³² See the following reference, for instance, for a technical potential study of district heating in the U.S.: Gils, H.C., et.al. “GIS-Based Assessment of the District Heating Potential in the USA.” *Energy* 58 (2013): 318–29

³³ District Heating and Cooling, Frederiksen and Werner (2013).

BENCHMARKING STUDY

Attached is the Benchmarking Study dated August 2021 prepared in support of the Energy Master Plan.

APPENDIX F



Foothill-De Anza Community College District ENERGY BENCHMARKING STUDY

August 2021

**Prepared for the
Foothill-De Anza Community College District
Energy and Sustainability Advisory Committee (ESAC)**

**Prepared by
Sullivan Consulting, LLC**

Table of Contents

Summary.....	2
Energy Usage at each Campus	2
<i>Foothill College</i>	3
<i>De Anza College</i>	3
<i>Sunnyvale Center</i>	4
<i>Green Power</i>	5
Greenhouse Gas Emissions	6
<i>Avoided GHG Emissions</i>	7
Energy Performance.....	8
<i>Benchmarking</i>	9
<i>DGS ZNE Target EUI</i>	10
Conclusions and Recommendations.....	11
Appendices	12
Appendix A - Foothill College Monthly Energy Usage 2018-2019	12
Appendix B - De Anza College Monthly Energy Usage 2018-2019.....	12
Appendix C - Sunnyvale Center Monthly Energy Usage 2018-2019	12

Summary

Sullivan Consulting, LLC, prepared this Energy Benchmarking Study on behalf of the Foothill-De Anza Community College District Energy and Sustainability Advisory Committee (ESAC) to support developing an Energy Master Plan (EMP) for the district. The district consists of two college campuses and one educational center: Foothill College and De Anza College, and the Foothill College Sunnyvale Center. Sullivan Consulting utilized the US EPA Energy Star[®] Portfolio Manager software to perform the benchmarking process with results for each site compared to national average energy usage for university and colleges and California Community College energy usage data. Benchmarking metrics included annual energy usage (kBtu/hour), greenhouse gas (GHG) Emissions (metric tons CO₂e/hour), Energy Use Intensity per campus gross square footage (kBtu/GSF), and GHG Emissions Intensity (metric tons CO₂e /GSF).

The energy benchmarking results are detailed in the following pages of this report and include both tabular and graphical representations of district energy performance. This effort is a starting point for energy planning by identifying relative energy performance at the campus level. More detailed energy benchmarking at the whole building level on the campuses will be recommend in the Energy Master Plan. The study concluded that Foothill-De Anza district energy performance is significantly better than the national median for colleges and universities and the California Community College system-wide median. These results demonstrate that the district's past energy and sustainability activities have successfully reduced energy use and GHG emissions over time. However, new California regulations for energy efficiency, renewable energy, and carbon reduction will require that the district do even more to achieve these goals. The data and results of the Benchmarking Study will serve as a valuable guide to the district for these efforts.

Energy Usage at each Campus


Monthly energy usage measured in kilowatt-hours (kWh) for grid purchased electricity and solar photovoltaic (PV) electricity generated on-site and therms for utility-supplied natural gas are tracked in the district Gridium Energy Information System (EIS). Sullivan Consulting uploaded the usage data to the EPA Portfolio Manager software account for each site. EPA Portfolio Manager provides the benchmarking tools and analysis features for the study. Energy usage and generation units are converted to thousand British Thermal Units per hour (kBtu/hr) to allow an apples-to-apples comparison of energy use across fuel sources. Since on-site classes and employee attendance were suspended due to COVID-19 in 2020 and 2021, resulting in low energy use years, the calendar years 2018 and 2019 were selected as the baseline years for benchmarking purposes.

The monthly energy usage at each campus for 2018 and 2019 are described graphically in the figures below. Data tables of monthly energy use are included in the Appendices.

Foothill College

Foothill College is a full-service college campus located in Los Altos Hills and was initially constructed in 1958. The campus sits on 128 acres with 63 buildings totaling 623,670 gross square feet. As detailed in Figure 1, most of Foothill College's energy usage is natural gas. The natural gas usage is due to a central plant cogeneration system and natural gas-fired hot water boilers used for space heating (HVAC). This energy usage peaks in the winter months due to the heating load. This gas usage is problematic to achieving the district's goals for carbon and GHG emissions reductions. A recommendation of the Energy Master Plan will be to perform an Electrification Study and a Thermal Storage Analysis utilizing electric heat pumps for hot water production to reduce or eliminate natural gas use.

Figure 1 - Foothill College Monthly Energy Usage (kBtu/hr), 2018-2019

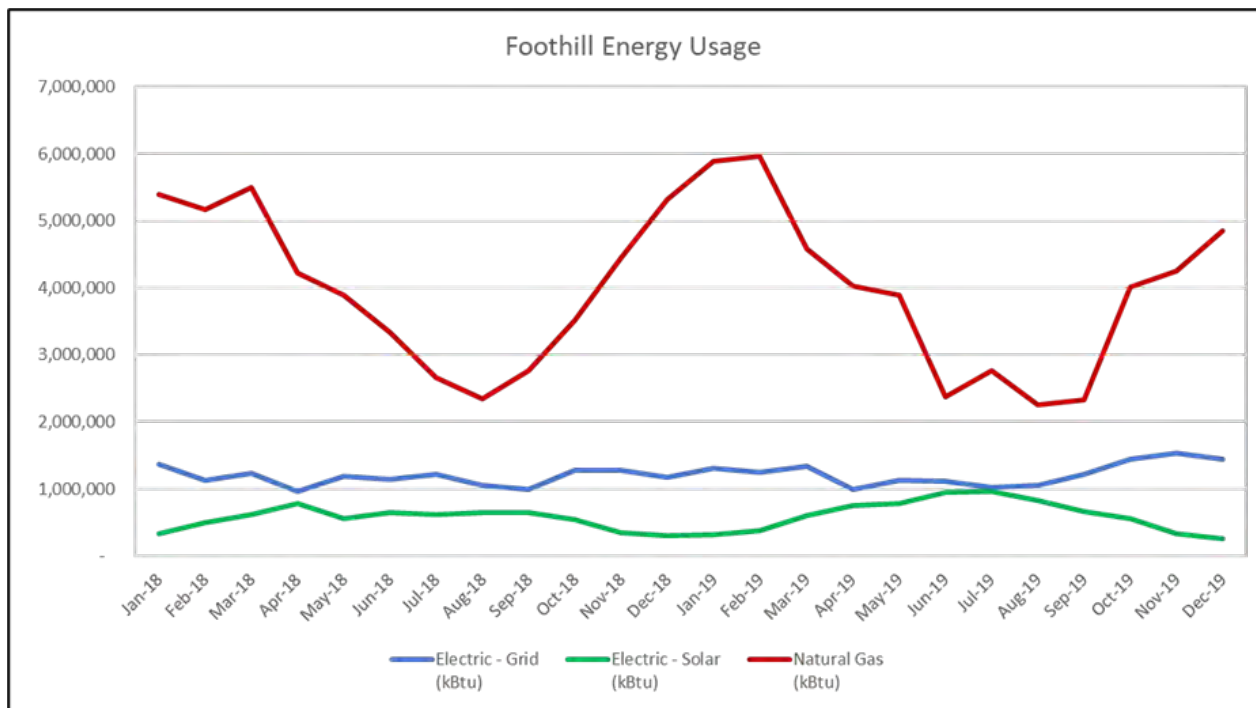


In addition, the figure above illustrates the relationship between grid-purchased electricity to on-site generated solar photovoltaic (PV) electricity. The district has installed 1.5 megawatts (MW) of solar PV on the campus which appears to be appropriately sized for the total campus electrical load. However, additional solar PV will be evaluated in a feasibility study proposed for the Energy Master Plan.

De Anza College

De Anza College is a full-service college campus located in Cupertino with original construction in 1967. The campus is built on 112 acres with 74 buildings totaling 1,480,137 gross square feet. As detailed in Figure 2, as with Foothill, most energy usage at De Anza College is natural gas. This is primarily due to the cogeneration pool heating systems and hot water heating natural gas-fired boilers.

As described above, the replacement of the natural gas systems should be evaluated through the Electrification Study conducted during the Energy Master Plan Implementation. The grid purchased and PV generated electricity relationship looks appropriate, but the planned PV feasibility study during the EMP implementation will determine if additional PV is warranted. The district would like to maximize PV at the campuses for economic reasons and to reduce GHG emissions.

Figure 2 – De Anza College Monthly Energy Usage (kBtu/hr), 2018-2019

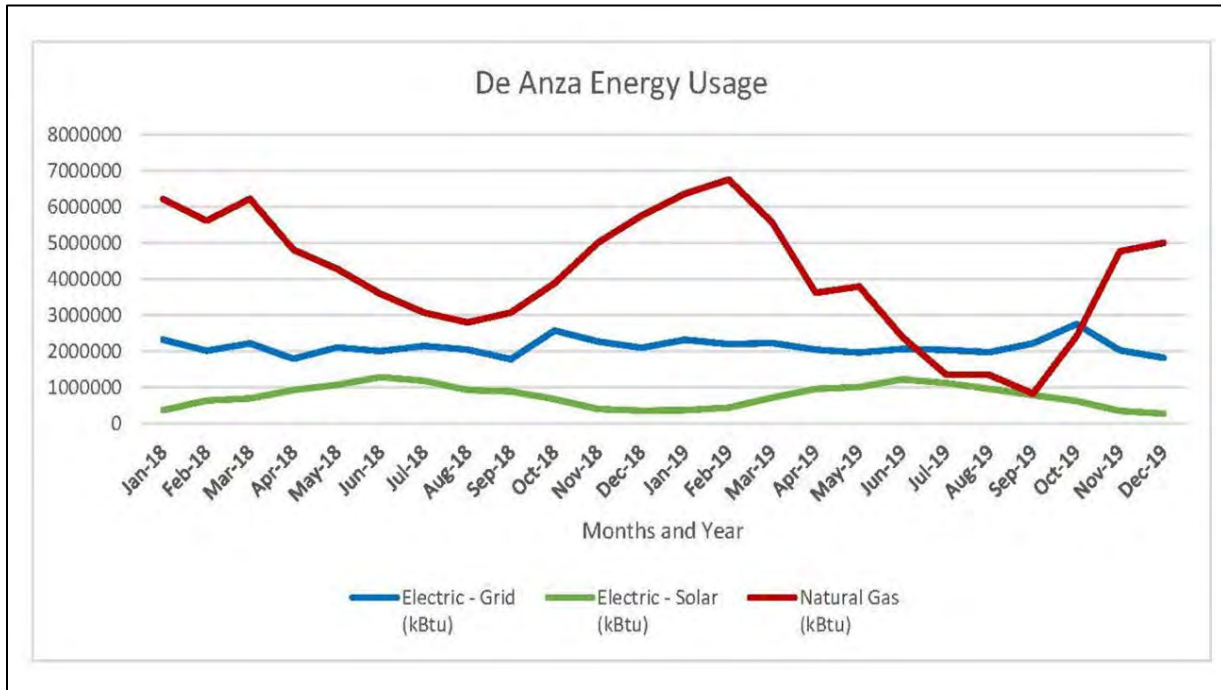


Sunnyvale Center

The Foothill College Sunnyvale Center serves as a regional educational center and workforce resource advancing the region's economic well-being by serving employer training needs, developing a quality workforce, and serving as a key player in local and regional workforce development initiatives. The Sunnyvale Center is a single-building campus located at the former Onizuka Air Force Station site in Sunnyvale. It is a two-story, 46,882 sq. ft. facility constructed in 2016 as a state-of-the-art LEED Platinum building.

As indicated in Figure 3, the Sunnyvale Center has a very low natural gas load, and its energy usage is primarily electric. The electricity is all grid-purchased from Silicon Valley Clean Energy and is 100% renewable and carbon-free. While this would meet the district's GHG reduction goals, the proposed photovoltaic generation study from the Energy Master Plan implementation will evaluate PV at the site as an economic opportunity.

Figure 3 – Sunnyvale Center Monthly Energy Usage (kBtu/hr), 2018-2019

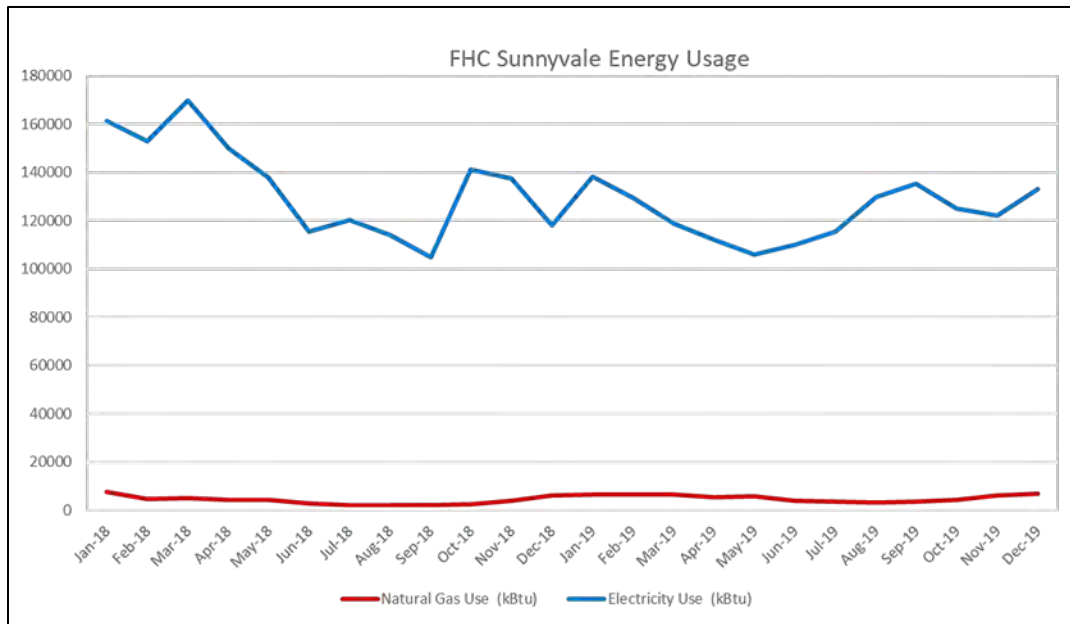

Green Power

Green power is defined as renewable energy sources and specific clean energy technologies that emit fewer GHG emissions relative to other sources of energy that supply the electric grid. Green power can be provided directly from an on-site renewable system or purchased from the utility or independent green power supplier. The customer must retain the Renewable Energy Certificates (RECs) for electrical power to be considered green. Onsite green power includes solar PV or wind power. Offsite Green power sources in Portfolio Manager include solar, wind, geothermal, biogas (landfill gas), biomass, and small hydropower. The offsite green power illustrated is based on the utility power content labels. The table below details the green power content for the district for the calendar year 2019.

Table 1 – Green Power (kWh), 2019

Property Name	Year Ending	Electricity Use - Grid Purchase (kWh)	Green Power - Onsite (kWh)	Green Power - Offsite (kWh)	Percent of Electricity that is Green Power
De Anza College	12/31/2019	7,529,923	2,596,570	2,033,079	46
Foothill College	12/31/2019	4,356,115	2,166,201	1,176,152	51
FHC Sunnyvale Center	12/31/2019	432,218	N/A	432,218	100

Greenhouse Gas Emissions

Greenhouse gas (GHG) Emissions include carbon dioxide (CO₂), methane (CH₄), and nitrous oxide (N₂O) gases released into the atmosphere as a result of energy consumption at a property. GHG emissions are expressed in carbon dioxide equivalent (CO₂e), a universal measure that combines each greenhouse gas's quantity and global warming potential. Emissions are reported in four categories, as follows:

- **Direct Emissions** are emissions associated with on-site fuel combustion (e.g., natural gas or fuel oil).
- **Indirect Emissions** are emissions associated with electricity purchases, district steam, district hot water, or district chilled water. These emissions occur at the facility's central plant, but they result from the property's energy consumption and contribute to the overall GHG footprint.
- **Biomass Emissions** are emissions associated with biogenic fuels such as wood or biogas (captured methane).
- **Total Emissions** are the total sum of all emissions.

The GHG emissions at all three campuses are in the Direct and Indirect categories as there is no biomass generation in the district. In addition, the emissions calculated are related to energy generation and usage only and do not include GHG emissions from vehicles, transportation, or commuting.


Table 2 below describes the total GHG emissions for each campus for the calendar year 2019. The district will use this as a baseline for GHG emissions reduction strategies.

Table 2 – Total GHG Emissions, 2019

Property Name	Year Ending	Total GHG Emissions (Metric Tons CO ₂ e)
De Anza College	12/31/2019	4053.2
Foothill College	12/31/2019	3491.9
FHC Sunnyvale Center	12/31/2019	101.1

Figure 4 below provides a graphical comparison of all three campuses for 2019 Total GHG emissions. This clearly illustrates the emission magnitude of each campus.

Figure 4 – Total GHG Emissions Comparison, 2019

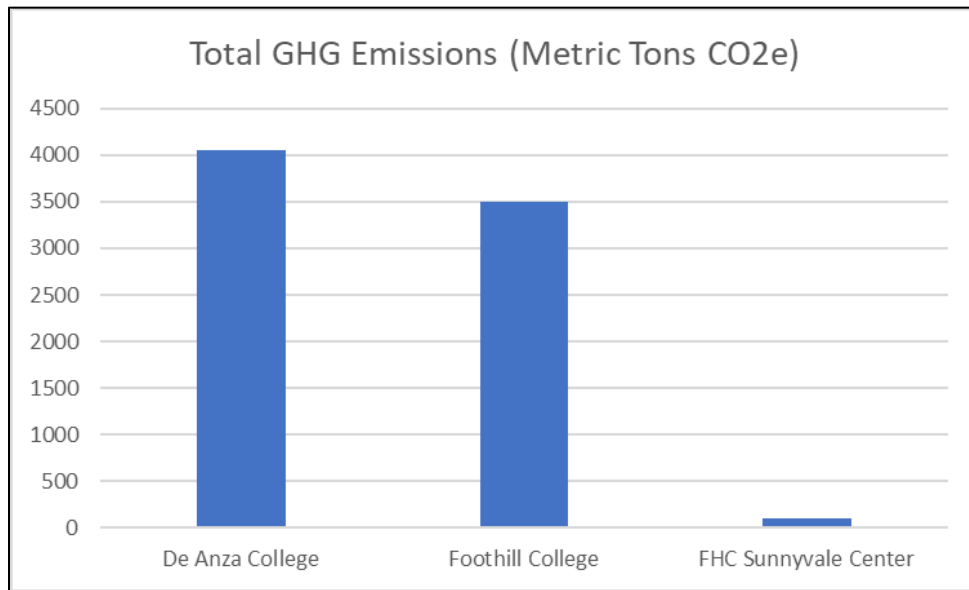

Avoided GHG Emissions

Avoided GHG Emissions are the emissions benefits associated with green power use. Avoided emissions may be either *on-site* or *offsite*.

- Onsite Avoided Emissions are the emissions benefits of the on-site renewable energy system (when the Renewable Energy Certificates (RECs) have been retained) due to the reduction in grid-supplied electricity.
- Offsite Avoided Emissions occur with the purchase of grid green power (which comes with RECs) from a utility or an independent supplier.

Foothill-De Anza district benefits from Onsite Avoided Emissions due to the significant amount of solar PV energy generated on-site. In addition, the district also benefits from Offsite Avoided Emissions based on the renewable energy content of grid purchased electricity from Constellation Energy for Foothill and De Anza campuses (27% renewable content) and Silicon Valley Clean Energy at the Sunnyvale Center (100% renewable content).

Table 3 below details the Total and Avoided Emissions for the three campuses for 2019.

Table 3 – Total and Avoided Emissions, 2019

Property Name	Year Ending	Total GHG Emissions (Metric Tons CO2e)	Avoided Emissions - Onsite Green Power (Metric Tons CO2e)	Avoided Emissions - Offsite Green Power (Metric Tons CO2e)
De Anza College	12/31/2019	4,053.2	1,098.2	859.9
Foothill College	12/31/2019	3,491.9	916.2	497.4
FHC Sunnyvale Center	12/31/2019	101.1	N/A	182.8

Energy Performance

The energy performance metric used to benchmark the district facilities is Energy Use Intensity (EUI). EUI is the energy use per square foot at a property. EUI enables the comparison of energy usage of different properties or individual buildings and measures relative energy efficiency.

EPA Portfolio Manager uses two different EUI categories for benchmarking: Site EUI and Source EUI.

- Site EUI is based on the annual amount of all the energy consumed on-site, regardless of the source. It includes energy purchased from the grid and renewable energy generated and consumed on-site such as solar and wind (excess renewable energy generated on-site and exported to the utility is excluded from site energy use).
- Source energy is the total amount of raw fuel that is required to operate the property. In addition to what the property consumes on-site, source energy includes losses during the generation, transmission, and distribution, thereby enabling a complete assessment of energy consumption resulting from building operations. For this reason, Source EUI is the best way to quantify the energy performance of buildings. The State of California Department of General Services (DGS) has adopted source energy and Source EUI to evaluate state building energy performance. Therefore, Source EUI was used in this Benchmarking Study to understand the complete energy impact of the facilities and compare the district's energy performance to other similar facilities.

The Energy Performance of the three district campuses/sites is described in Table 4 below. The data is based on calendar year 2019 energy usage.

Table 4 – Energy Performance (EUI) 2019


Property Name	Site Energy Use (kBtu)	Source Energy Use (kBtu)	Site EUI (kBtu/ft ²)	Source EUI (kBtu/ft ²)	Total GHG Emissions (Metric Tons CO ₂ e)	Total GHG Emissions Intensity (kgCO ₂ e/ft ²)
De Anza College	78,795,293	127,253,259	82.4	133.1	4,053	4.2
Foothill College	69,445,147	98,558,219	96.8	137.4	3,492	4.9
FHC Sunnyvale Center	1,537,328	4,194,968	32.7	89.3	101	2.2

Source Energy and Source EUI have been highlighted in the figure. These metrics will be used to compare the district energy use of other similar facilities and campuses.

Benchmarking

The district EUI data for 2019 was benchmarked against the national median Source EUI for Colleges/University buildings (data from Portfolio Manager) and the median Source EUI of the California Community College system. The median EUI of the CCC system was determined based on the annual energy usage reports submitted to the CCC Chancellors Office by the districts. The latest data available was for the Fiscal Year 2017-2018.

Figure 5 – Foothill and De Anza Benchmarking Data, 2019

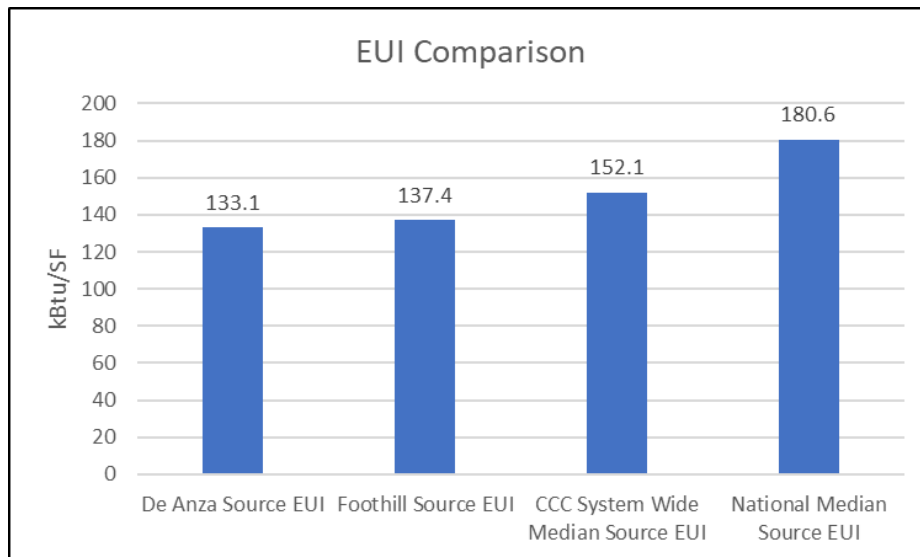


Note: System-wide data is FY 17-18, with 61 of 72 districts reporting.

Figure 5 illustrates the benchmarked data for Foothill and De Anza colleges. The figure shows that both Foothill College and De Anza college have significantly lower EUI than the national median EUI of 180.6 and the CCC system-wide median of 152.1.

It was considered inappropriate to benchmark the Sunnyvale Center to a college/university campus use. It was determined that the center would be benchmarked against the national median for an Adult Education building use. While this is the national median and not the ideal benchmark, it is still a relative energy performance indicator. The national median Source EUI is 110.4, while the Sunnyvale Center outperforms this with a Source EUI of 89.3. Figure 6 illustrates the benchmarked data for Sunnyvale Center

Figure 6 – Sunnyvale Center Benchmarking Data

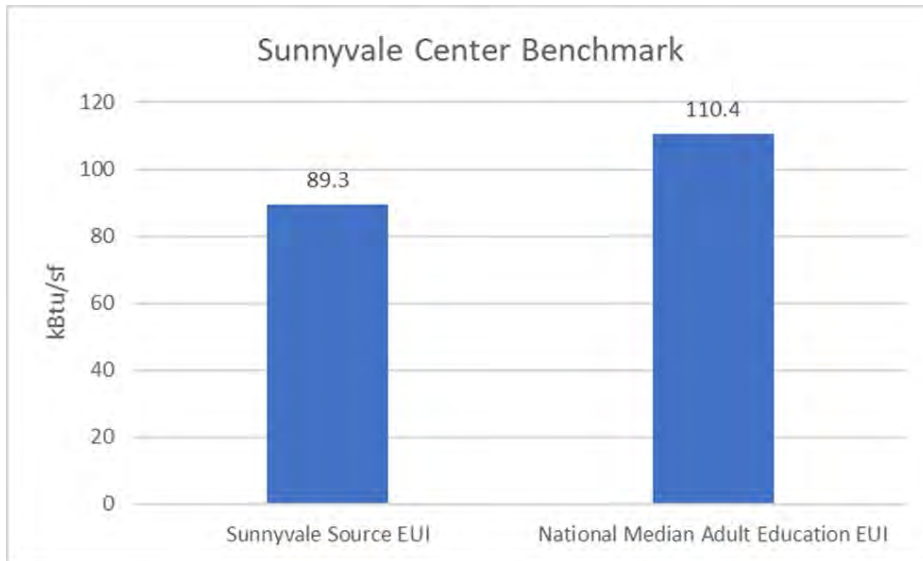

DGS ZNE Target EUI

The California Department of General Services has developed guidelines and targets for state buildings to achieve Zero Net Energy (ZNE). They have set a target EUI for each climate zone to assist state agencies in benchmarking their facilities to the ZNE standard. All three district campuses are in California Climate Zone 4, with a ZNE Source EUI target of 95 kBtu/SF. Sunnyvale Center meets this target with a Source EUI of 89.3. Both Foothill and De Anza campuses will likely need to improve energy efficiency, drastically reduce or eliminate natural gas usage, and install additional renewable energy to meet the ZNE target.

Conclusions and Recommendations

The conclusions and recommendations from the Benchmarking Study are as follows:

- District Energy Performance is significantly better than the national median as well as the California Community College median for the same building/campus type
- The deployment of large-scale solar PV generation at Foothill and De Anza significantly improves GHG emissions performance
- The LEED Platinum rated Sunnyvale Center is highly energy-efficient and surpasses the DGS standard for ZNE EUI targets. It also uses 100% renewable content grid electricity, with less than 110 tons of annual CO₂e emissions.
- Both Foothill and De Anza campuses will need to improve energy efficiency, add additional on-site and offsite renewable energy, and reduce natural gas usage to meet the ZNE target.
- Additional onsite solar PV is needed for electrification of HVAC projects, and additional electric vehicle supply equipment (EVSE)
- It will be a significant challenge for the electrification of natural gas usage at all three district sites to achieve the carbon reduction goals of the Energy Master Plan
- Building-level Benchmarking at both Foothill and De Anza campuses would be valuable in developing improvement strategies and should be considered as a recommendation in the Energy Master Plan

The Energy Usage Data Tables for 2018 and 2019 are included in the Appendices of this report.

Appendices

Appendix A - Foothill College Monthly Energy Usage 2018-2019

Appendix B - De Anza College Monthly Energy Usage 2018-2019

Appendix C - Sunnyvale Center Monthly Energy Usage 2018-2019

APPENDIX F

Energy Use By Calendar Month (Not Weather Normalized)

Property: Foothill College (ID 15226581)

Calendar Year: 2018-2019

Month	Electric - Grid (kBtu)	Electric - Solar (kBtu)	Natural Gas (kBtu)
Jan-18	1,375,012	325,672	5,389,200
Feb-18	1,134,862	504,259	5,161,200
Mar-18	1,227,133	613,447	5,490,499
Apr-18	964,893	776,745	4,225,100
May-18	1,183,848	564,335	3,894,100
Jun-18	1,143,269	649,038	3,327,500
Jul-18	1,221,080	610,468	2,657,800
Aug-18	1,048,538	647,598	2,337,200
Sep-18	991,790	655,046	2,762,100
Oct-18	1,280,506	547,646	3,508,200
Nov-18	1,284,461	340,309	4,442,600
Dec-18	1,172,241	306,411	5,309,600
Jan-19	1,314,217	310,976	5,881,599
Feb-19	1,253,524	380,602	5,966,501
Mar-19	1,339,336	608,001	4,576,700
Apr-19	991,029	753,383	4,028,100

APPENDIX F

Energy Use By Calendar Month (Not Weather Normalized)

Property: Foothill College (ID 15226581)

Calendar Year: 2018-2019

Month	Electric - Grid (kBtu)	Electric - Solar (kBtu)	Natural Gas (kBtu)
May-19	1,123,834	775,735	3,895,100
Jun-19	1,113,332	954,954	2,377,000
Jul-19	1,027,684	962,713	2,770,100
Aug-19	1,055,212	828,413	2,257,100
Sep-19	1,222,919	668,486	2,327,900
Oct-19	1,448,329	562,444	4,009,000
Nov-19	1,537,754	334,618	4,257,001
Dec-19	1,435,896	250,751	4,844,900
Total	28,890,700	13,932,052	95,696,102

APPENDIX F

Energy Use By Calendar Month (Not Weather Normalized)

Property: De Anza College (ID 15178421)

Calendar Years: 2018-2019

Month	Electric - Grid (kBtu)	Electric - Solar (kBtu)	Natural Gas (kBtu)
Jan-18	2,322,220.9	371,020.9	6,210,999.4
Feb-18	2,013,649.7	636,320.9	5,614,800.5
Mar-18	2,223,689.2	698,433.0	6,224,499.3
Apr-18	1,798,871.1	933,239.9	4,817,500.2
May-18	2,112,911.6	1,071,381.5	4,283,800.1
Jun-18	2,010,132.0	1,288,589.7	3,592,500.0
Jul-18	2,152,262.4	1,181,630.2	3,072,300.0
Aug-18	2,049,127.9	926,199.6	2,799,899.9
Sep-18	1,783,268.1	887,780.2	3,072,499.8
Oct-18	2,579,963.2	677,546.5	3,887,699.8
Nov-18	2,267,536.8	402,305.5	5,020,800.9
Dec-18	2,097,182.2	359,024.3	5,759,999.3
Jan-19	2,319,658.4	371,143.7	6,372,499.8
Feb-19	2,205,390.6	447,531.6	6,756,999.2

APPENDIX F

Energy Use By Calendar Month (Not Weather Normalized)

Property: De Anza College (ID 15178421)

Calendar Years: 2018-2019

Month	Electric - Grid (kBtu)	Electric - Solar (kBtu)	Natural Gas (kBtu)
Mar-19	2,229,943.5	712,244.8	5,576,898.5
Apr-19	2,049,472.5	956,881.7	3,619,500.0
May-19	1,972,173.5	1,010,272.7	3,794,000.1
Jun-19	2,064,642.0	1,225,535.9	2,389,300.2
Jul-19	2,036,384.1	1,124,274.2	1,358,699.9
Aug-19	1,979,219.2	964,152.5	1,348,400.2
Sep-19	2,224,054.2	785,589.1	829,800.1
Oct-19	2,756,674.1	629,640.3	2,426,600.1
Nov-19	2,031,344.4	353,687.1	4,769,298.9
Dec-19	1,823,144.1	278,542.0	5,001,700.3
Total	51,102,915.7	18,292,967.5	98,600,996.3

APPENDIX F

Energy Use by Calendar Month

Property: Foothill Sunnyvale Center

Calendar Year: 2018-2019

Month	Natural Gas Use (kBtu)	Electricity Use (kBtu)
Jan-18	7,570.0	161,469.5
Feb-18	4,820.0	152,939.5
Mar-18	5,010.0	169,893.7
Apr-18	4,160.0	150,083.6
May-18	4,400.0	137,715.1
Jun-18	2,830.0	115,417.7
Jul-18	2,320.0	120,075.1
Aug-18	2,220.0	113,984.7
Sep-18	2,000.0	104,901.9
Oct-18	2,630.0	141,140.8
Nov-18	3,800.0	137,616.2
Dec-18	6,300.0	118,017.7
Jan-19	6,690.0	138,363.4

APPENDIX F

Energy Use by Calendar Month

Property: Foothill Sunnyvale Center

Calendar Year: 2018-2019

Month	Natural Gas Use (kBtu)	Electricity Use (kBtu)
Feb-19	6,680.0	129,308.0
Mar-19	6,370.0	118,621.6
Apr-19	5,280.0	112,278.7
May-19	5,700.0	105,840.2
Jun-19	3,850.0	109,832.3
Jul-19	3,780.0	115,421.1
Aug-19	3,390.0	129,939.2
Sep-19	3,480.0	135,159.6
Oct-19	4,310.0	125,032.7
Nov-19	6,100.0	122,006.3
Dec-19	6,970.0	132,924.7
Total	110,660.0	3,097,983.3

GLOSSARY OF TERMS

Acronyms

AASHE	Association for the Advancement of Sustainability in Higher Education
AB	Assembly Bill
ACBO	Association of Chief Business Officers
ASHRAE	American Society of Heating, Refrigerating and Air-Conditioning Engineers
BES	Battery Energy Storage
BMS	Building Management System (also known as Energy Management System)
BOG	Board of Governors
BTU	British Thermal Unit, a unit of energy measurement
CAP	Climate Action Plan
CARB	California Air Resources Board
CCA	Community Choice Aggregation
CCC	California Community College
CCD	Community College District
C&D	Construction & Demolition
CCFC	Community Colleges Facilities Coalition
CEC	California Energy Commission
CEQA	California Environmental Quality Act
CH₄	Methane (a greenhouse gas)
CO₂	Carbon Dioxide (a greenhouse gas)
CO_{2e}	Carbon Dioxide equivalent
CPUC	California Public Utilities Commission
EIS	Energy Information System
EMP	Energy Master Plan
EMS	Energy Management System (also known as Building Management System)
EO	Executive Order
EPA	Environmental Protection Agency
EPC	Energy Performance Contract
ESAC	Energy and Sustainability Advisory Committee
ESCO	Energy Services Company
EUI	Energy Use Intensity
EV	Electric Vehicle
DR	Demand Response
FEMP	Federal Energy Management Program
FCCC	Foundation for California Community Colleges
FMP	Facility Master Plan
GHG	Greenhouse Gas
HFCs	Hydrofluorocarbons (a greenhouse gas)
HVAC	Heating, Ventilation, and Air Conditioning
IOU	Investor-Owned Utility
IPCC	Intergovernmental Panel on Climate Change
IRR	Internal Rate of Return
kWh	Kilowatt-hour

LCCA	Life Cycle Cost Analysis
LCFS	Low Carbon Fuel Standard
LEED	Leadership in Energy and Environmental Design
MBCx	Monitoring Based Commissioning
MWh	Megawatt-hour
NGOM	Net Generation Output Meter
N₂O	Nitrous Oxide (a greenhouse gas)
NPV	Net Present Value
O&M	Operations and Maintenance
OBF	On-Bill Financing
PFCs	Perfluorocarbons (a greenhouse gas)
PG&E	Pacific Gas & Electric
PPA	Power Purchase Agreement
PSPS	Public Safety Power Shutoffs
PV	Photovoltaic (Solar Panel)
RCx	Retro commissioning
REC	Renewable Energy Credit or Renewable Energy Certificate
RFP	Request for Proposal
ROI	Return on Investment
SB	Senate Bill
SESI	Stanford Energy Systems Innovation
SF₆	Sulfur Hexafluoride (a greenhouse gas)
SPB or SPP	Simple Payback Period
STARS	Sustainability Tracking Assessment and Reporting System
Therms	Natural Gas Energy Measurement
T&D	Transmission and Distribution
TES	Thermal Energy Storage
TOTEM	Tool for Optimization of Thermal and Electric Microgrids
VMT	Vehicle Miles Traveled
WRI	World Resources Institute
ZNE	Zero Net Energy

GHG Emissions Definitions

Scope 1 Emissions - all direct emissions from sources owned and controlled by the college, such as carbon dioxide released by burning natural gas on site.

Scope 2 Emissions – all indirect emissions from consumption of purchased energy utilities, such as electricity, heat, or steam.

Scope 3 Emissions - all indirect emissions not covered by Scopes 1 and 2 and includes emissions from student and staff commuting.